PUB SINGAPORE'S NATIONAL WATER AGENCY

# Best Practice Guide in WATER EFFICIENCY

## Buildings Version 3



Produced by:
PUB, Singapore's National Water Agency

Published in November 2026.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without prior permission of PUB.

Whilst PUB has used reasonable endeavours to ensure that the information provided in the publication is accurate and up to date as at the time of issue, it reserves the right to make corrections and does not warrant that it is complete.

This guide should be read together with prevailing legislation, codes and PUB requirements. Where there is any inconsistency, the prevailing statutory or regulatory requirements shall apply.

PUB disclaims all liability and responsibility for any loss caused to any person by any act or omission, due to the materials contained in this publication.

If you have any comments, questions or suggestions about this publication, please direct them to:

Tel: 1800-CALL-PUB (1800 2255 782)
Email: pub_conserve@pub.gov.sg
Website: https://eservices.pub.gov.sg/helpandfeedback/report

# PREFACE

By 2065, Singapore's water demand could almost double, driven by economic activity and population growth. The non-domestic sector is expected to account for about two-thirds of total demand. By then, NEWater and desalination will meet the majority of Singapore's future water demand.

The aim of this Best Practice Guide in Water Efficiency - Buildings is to provide professional engineers, developers, building owners and facilities managers, and managing agents involved in water management, with the basic knowledge of designing, maintaining and operating a water-efficient building. We have also compiled best water efficiency practices in this publication to help you in your journey towards sustainable water use.

# ACKNOWLEDGEMENTS

This guide could not have been possible without the participation, assistance of and invaluable insights from the following organisations. Their contributions are appreciated and gratefully acknowledged.

CapitaLand Limited

City Developments Ltd

Marina Bay Sands Pte. Ltd.

Housing & Development Board

Ministry of Education

Surbana Jurong Private Limited

Singapore Plumbing Society

Institute for Environment and Sustainability (IES),
Lee Kuan Yew School of Public Policy,
National University of Singapore

Building and Construction Authority

National Parks Board

Singapore Green Building Council

Singapore Institute of Architects

Board of Architects

Ho Bee (One-North) Pte Ltd (The Metropolis)

Keppel Bay Tower LLP

Management Corporation – Strata Title Plan No. 1008 (Parkway Parade)

Mee Toh School

NHG Health (Khoo Teck Puat Hospital)

National University Health System (Ng Teng Fong General Hospital)

# CONTENTS


| | |
|---|---|
| **1. Introduction** | 7 |
| **1.1 Pricing** | 7 |
| **1.2 Mandatory measures** | 7 |
| 1.2.1 Mandatory flow-rate requirements | 8 |
| 1.2.2 Mandatory Water Efficiency Labelling Scheme (WELS) | 8 |
| 1.2.3 Mandatory Water Efficiency Management Practices (WEMP) | 12 |
| **1.3 Facilitation measures** | 12 |
| **2. Best Water Efficiency Practices** | 13 |
| **2.1 Building owners' guide to accounting for water use** | 13 |
| 2.1.1 Installing private water meters | 13 |
| 2.1.2 Water consumption monitoring practices | 14 |
| 2.1.3 Charting and analysing water consumption | 16 |
| **2.2 Identify and repair leaks** | 18 |
| 2.2.1 Regular leak test | 18 |
| 2.2.2 Signs of a leak | 18 |
| 2.2.3 Fault-reporting system | 19 |
| **2.3 Adopt a low-pressure water system** | 20 |
| 2.3.1 Pressure reducing valve (PRV) | 20 |
| 2.3.2 PRV installation configuration | 21 |
| 2.3.3 Intermediate tank | 21 |
| **2.4 Use water-efficient fittings/appliances/equipment** | 22 |

# CONTENTS


| | |
|---|---|
| **2.5 Water conservation in cooling system** | 24 |
| 2.5.1 Design a cooling system | 24 |
| 2.5.2 Water efficiency opportunities in cooling towers | 25 |
| 2.5.3 Reducing Cooling Tower Water Consumption Through Treatment Technologies | 33 |
| **2.6 Adopt water-efficient landscape designs & irrigation systems** | 37 |
| 2.6.1 Landscape design | 37 |
| 2.6.2 Understanding water use in the landscape | 38 |
| 2.6.3 Water-efficient irrigation practices | 40 |
| **2.7 Adopt water-efficient general washing practices** | 42 |
| **2.8 Use alternative water sources for non-potable water usage areas** | 43 |
| 2.8.1 Rainwater harvesting | 43 |
| 2.8.2 Air-conditioning condensate reuse | 45 |
| 2.8.3 Greywater recycling and reuse | 49 |
| **2.9 Adopt water efficiency management systems (SS ISO 46001)** | 52 |
| **2.10 Water conservation efforts during dry weather** | 53 |
| **3. Case Studies** | 54 |
| **4. Water Saving Practices Checklist** | 59 |

01

# Introduction

Managing water demand is essential in ensuring a sustainable water supply. PUB adopts a three-pronged approach to water conservation – Pricing, Mandatory measures and Facilitation measures.

## 1.1 Pricing

In Singapore, water is priced to reflect its scarcity, value and the full costs of its production and supply.



## 1.2 Mandatory measures

PUB has mandated measures that help businesses use water more efficiently. These include mandating maximum allowable flow rates, water efficiency labelling for water fittings and appliances, installation of water fittings that meet minimum water efficiency ratings in new developments and existing premises undergoing renovations, and mandating water efficiency management practices for large water users.



### 1.2.1 Mandatory flow-rate requirements

To prevent excessive water flow, PUB limits the maximum allowable flow rates at water fittings. These requirements* are shown below.

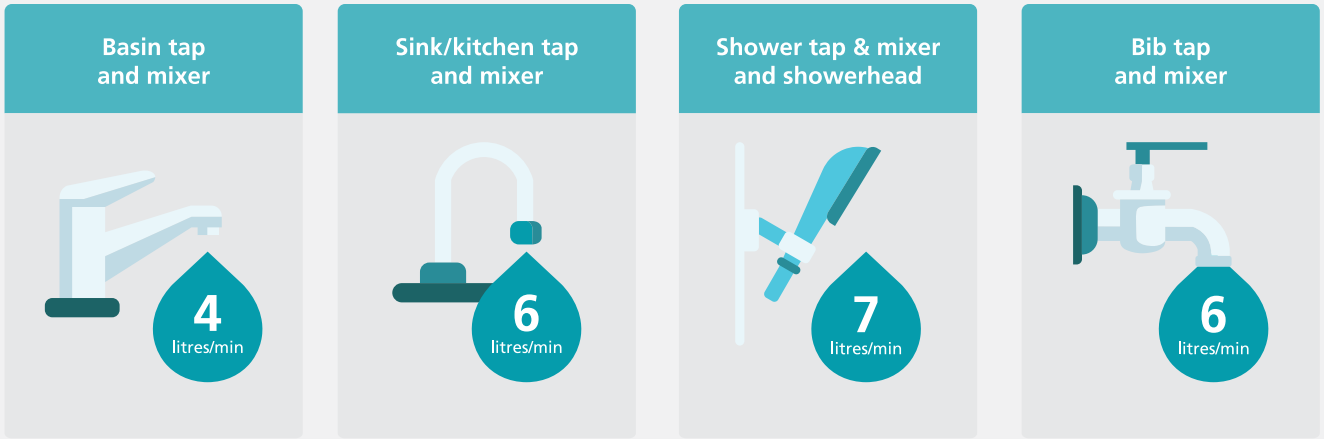


*These can be found in the Singapore Standard 636 - Code of Practice for Water Services and the Public Utilities (Water Supply) Regulations*

### 1.2.2 Mandatory Water Efficiency Labelling Scheme (WELS)

Water efficiency labelling was made mandatory in July 2009 to help consumers make more informed purchasing decisions and encourage suppliers to introduce more water-efficient products into the market. This scheme covers water fittings such as taps and mixers, dual-flush low-capacity flushing cisterns (LCFCs), urinal flush valves and waterless urinals. As part of the scheme, suppliers are required to label the water efficiency of water fittings and appliances on all their displays, packaging and advertisements. Mandatory WELS was extended to cover washing machines and dishwashers for household use from October 2011 and October 2018 respectively.

From 1 January 2022, mandatory WELS was extended to water-closet (WC) flush valves, commercial dishwashers, washer extractors, and high-pressure washers. All WC flush valves for sale and supply shall be labelled with 2-tick or 3-tick ratings, while the commercial equipment shall meet the minimum water efficiency standards.



To complement Mandatory WELS, minimum water efficiency standards for water fittings were also introduced.

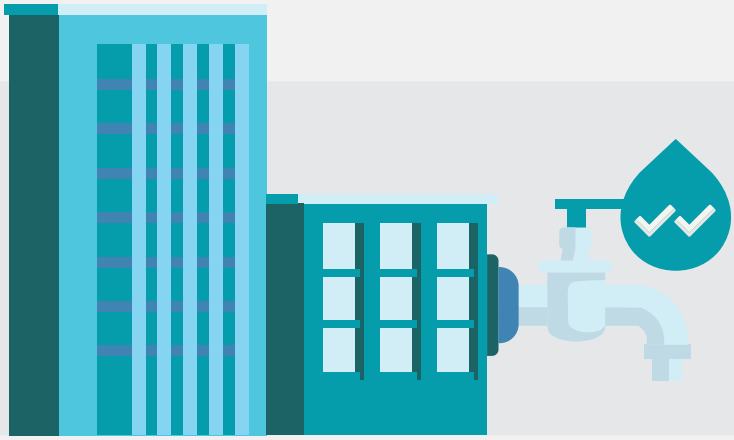

All new developments and existing premises undergoing renovation are required to install water fittings with at least 2-tick water efficiency rating.

Since October 2018, the mandatory WELS was extended to cover dishwashers for household use and all dishwashers shall be 1/2/3/4-tick rating.



From April 2019, all water fittings covered under the mandatory WELS offered for sale and supply shall be at least a 2-tick water efficiency rating.



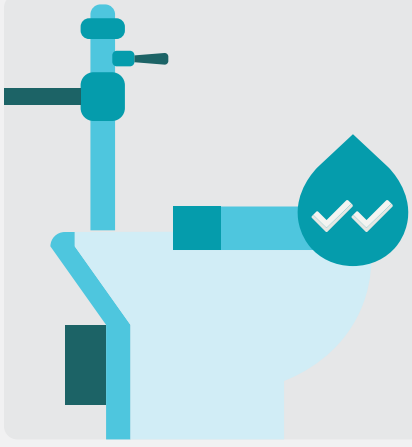

From 1 January 2023, only water-closet (WC) flush valves with at least 2-tick water efficiency rating are allowed in new and existing non-residential premises undergoing renovation. For public hygiene reasons, the National Environment Agency requires the WC flush valves in public toilets to be of sensor-operated type.

WELS Ratings

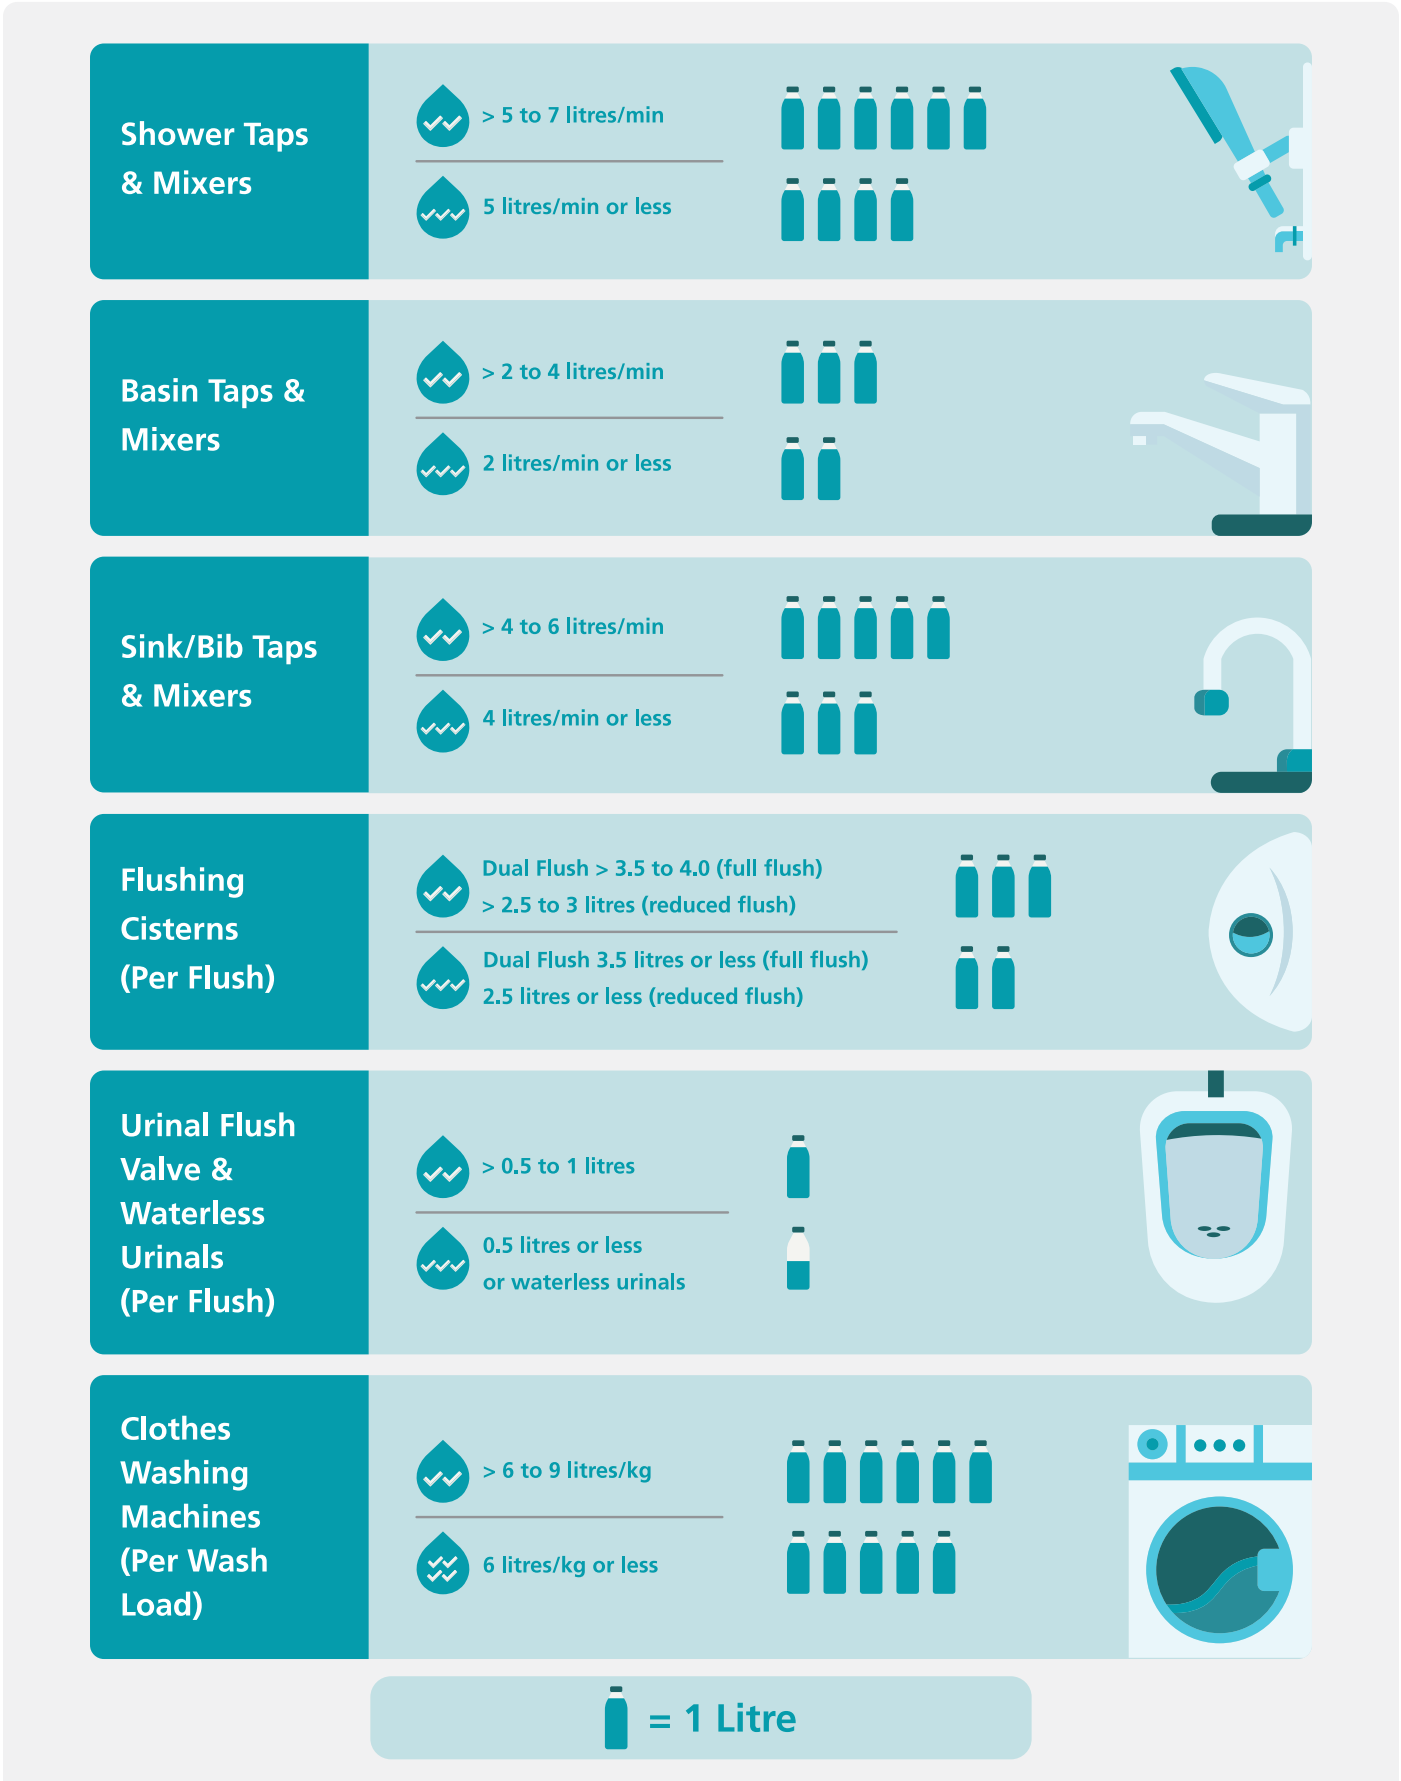

| | | |
|---|---|---|
| **WC flush valves** | > 3.5 to 4.0 litres<br>3.5 litres or less |  |
| **Dishwashers for household use (Per Place Setting)** | > 1.2 to 1.5 litres<br>> 0.9 to 1.2 litres<br>> 0.6 to 0.9 litres<br>0.6 litres or less |  |
| **Washer Extractor (Per Kg - Front Load, Top Load** | ≤ 8 litres/kg |  |
| **Commercial Dishwasher (Per Rack - Undercounter , Hood)** | ≤ 2.4 litres/rack | 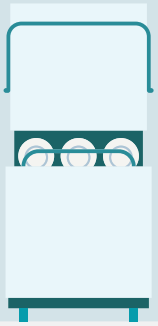 |
| **High Pressure Washer (Per Min - For general cleaning purposes)** | ≤ 11 litres/min |  |

### 1.2.3 Mandatory Water Efficiency Management Practices (WEMP)

The requirements of WEMP, under Part IVA of the Public Utilities (Water Supply) Regulations, came into effect from January 2015.

Under the WEMP, it is mandatory for large water users with net water consumption of at least 60,000 m³ in the previous year (i.e. qualifying consumers) to:

1. Submit a notification to PUB by 31 March (for specified consumers*) or 30 April (for non-specified consumers) for their different sites meeting this water consumption threshold.

2. Install private water meters at key water usage areas within their premises by 30 June to track and monitor water usage.

3. Submit their annual water efficiency plan to PUB by 30 June for at least three consecutive years.

4. Appoint at least one Water Efficiency Manager by 30 June.

** Specified consumers – Consumers who hold one or more water accounts with PUB for water supplied to the site and the volume of water used under these account(s) in the preceding calendar year is at least 60,000 m³.*



## 1.3 Facilitation measures

Programmes have been put in place to support companies in their efforts to improve water efficiency. These include incentivising companies, building capabilities of building owners and developers, and raising awareness of water efficiency practices.

### Raise Awareness

PUB organises activities, seminars, forums and events regularly to share information on best practices. Online resources and publications are also available to help companies understand what common issues exist, and take steps to improve water efficiency.

### Build Capabilities

Training programmes such as the Water Efficiency Manager Course (WEMC) and publications such as PUB's series of Best Practice Guides are available to help equip companies with the knowledge and skills to support their water efficiency improvement efforts.

### Encourage Adoption

Incentives such as the Water Efficiency Fund are available to encourage businesses to make pro-water efficiency choices in their operations or even the design of new facilities. Recognition such as the Watermark and Water Efficiency Awards, are given to companies that have implemented excellent water management practices and demonstrated tangible results in improving water efficiency.

02

# Best Water Efficiency Practices

This chapter is a guide on how to implement water efficiency projects and operate a building that is equipped to use water efficiently. Buildings should adopt the 3R strategy – Reduce, Replace and Reuse/ Recycle – in managing water usage. These will be detailed later on in this chapter.

## 2.1 Building owners' guide to accounting for water use

Before implementing water efficiency measures/ projects for building premises, one should first understand how much water is being used at different areas, and identify where these areas are. In other words, water usage in buildings should be properly accounted for prior to implementation of measures.

Accounting for water usage can be done through private metering and regular monitoring of water consumption.

Doing so enables you to have a better understanding of water usage patterns, and helps you detect abnormalities in water consumption coming from leaks and inefficiencies.

Knowing where, when, and how water is being used in your development can help you to formulate measures that improve your water efficiency. Quick identification of leaks, for example, ensures that they can be fixed early, therefore preventing further water wastage.

### 2.1.1 Installing private water meters

Private meters should be installed at pipes serving different water usage areas in order to help you better understand and analyse water usage patterns. These meters allow you to detect abnormalities in water consumption. Starting from 1 January 2015, buildings with net water consumption of at least 60,000 $m^3$ in the previous year are required to install private water meters at various water usage areas within their premises to track and monitor water consumption levels.



Key water usage areas vary by building type — the examples below highlight some common ones to help you identify where to focus your water management efforts.




### 2.1.2 Water consumption monitoring practices

There are two common means of recording private meter readings:

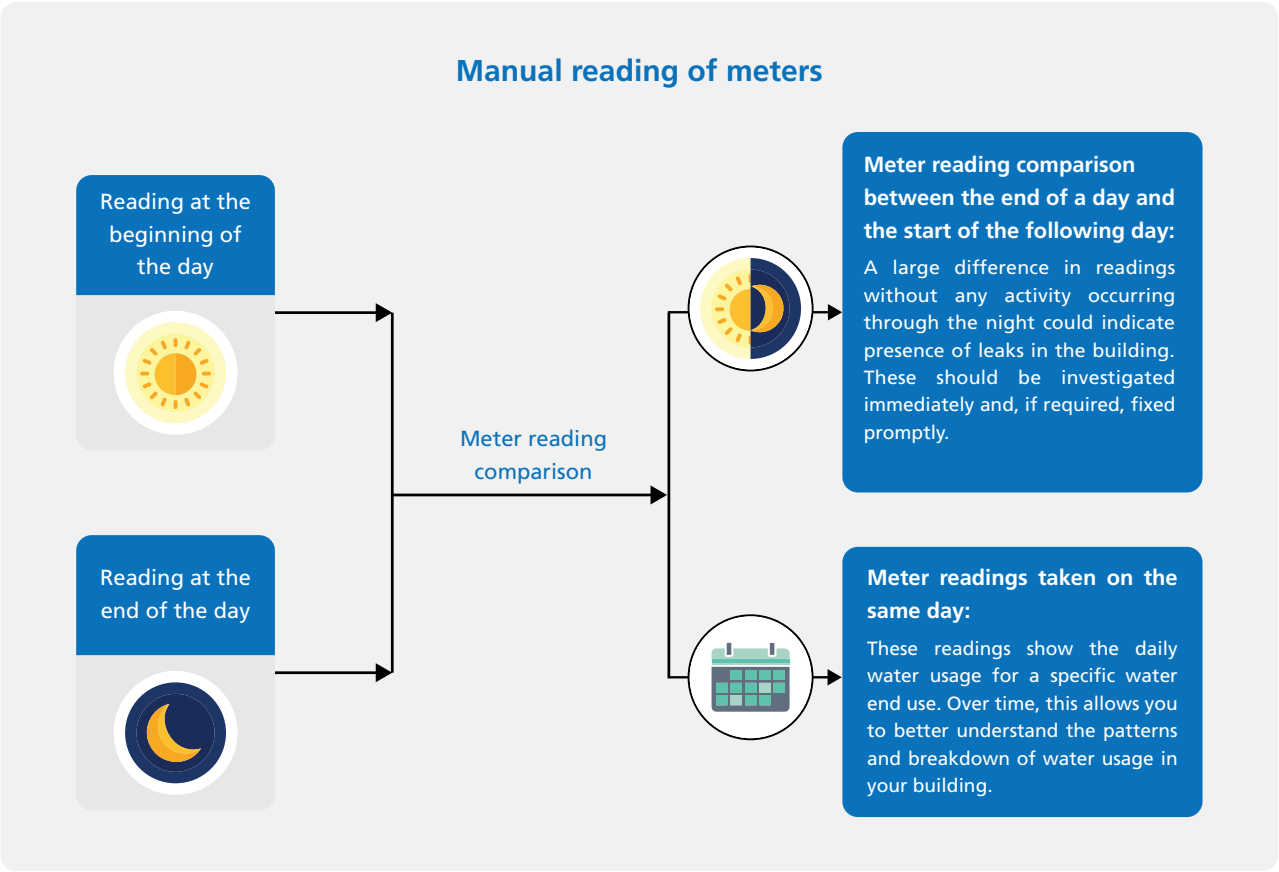

## How to read your meters:

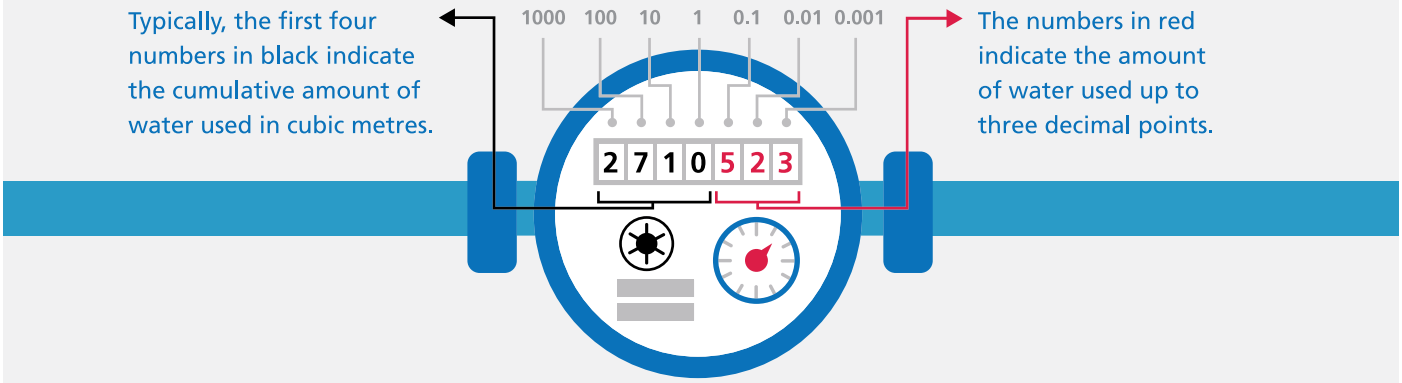


*To find out how much water is being used during a certain period, simply calculate the difference between the reading taken at the start and at the end of the period.*

## Other types of meter dials:

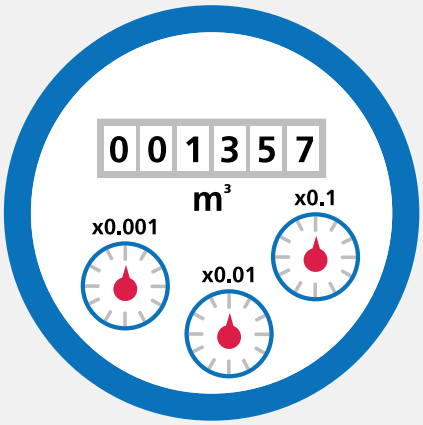


**A**

Meter A reads 1,357 m³

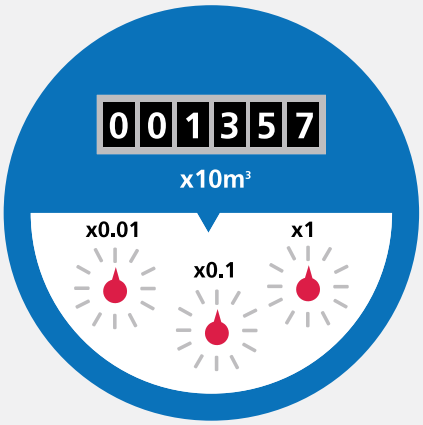


**B**

Meter B reads 13,570 m³

## Remote reading of meters

Data loggers are connected to the meters

Meter readings are then transmitted automatically at regular intervals via cellular network or a dedicated wiring system

Water consumption information can be accessed through the Building Management System (BMS) or through specified web-based applications from any computer

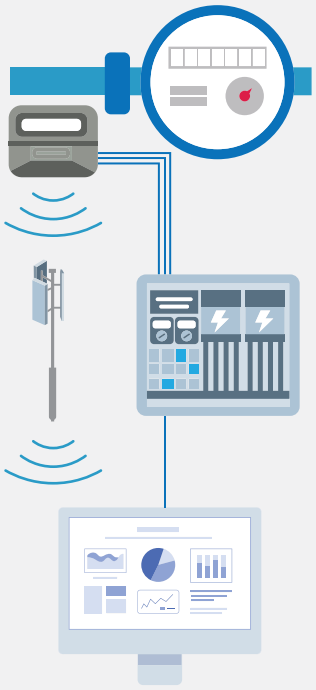

Helps you save on manpower costs as staff are no longer required to physically read each meter

Increases chances of leak detection

Provides real-time information on water usage activity of the premises

Enables greater understanding of how water usage at certain areas correlate with other factors such as temperature, rainfall etc. Building managers could make use of such information to develop relevant water efficiency measures.

### 2.1.3 Charting and analysing water consumption

It is essential to maintain a regular (daily, weekly, monthly) effort to chart water consumption at different consumption areas. This will provide first-hand information on abnormalities in water usage. Sudden high consumption patterns could indicate leakages within the building. Prompt action should be taken, if necessary, to fix leaks so as to minimise water wastage.

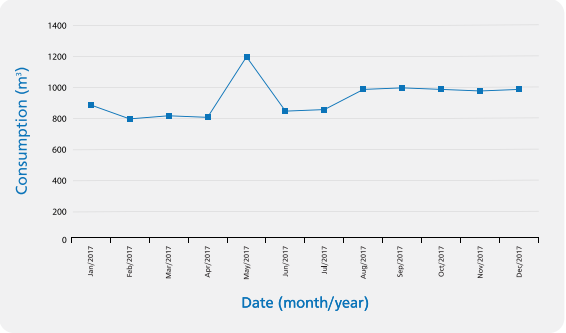


*Example of a water consumption chart with a sudden peak, indicating a probable leak*

Remote meter reading service providers offer web-based platforms, which allow users to generate water consumption charts for analysis at the click of a button. These platforms may also include notification features such as leakage and high consumption alerts etc.

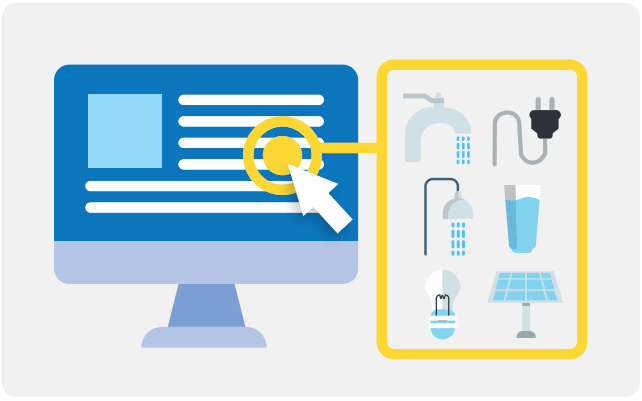

*Building managers can have a centralised and holistic view of the energy and water consumption within their premises.*

Examples of water consumption charts:

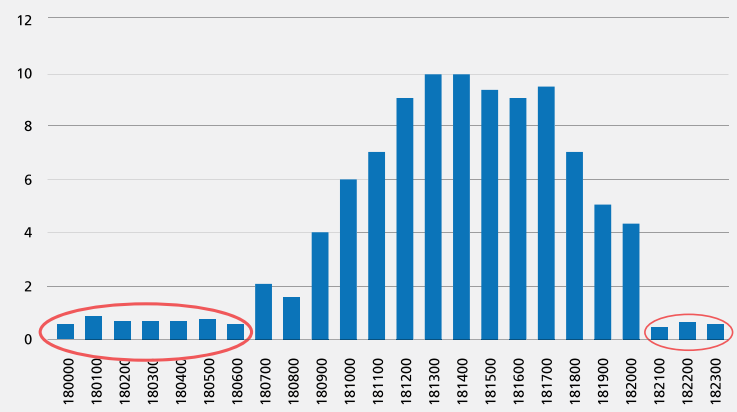


Minimum night flow is present, as shown by the increase in water usage levels being captured by the meters overnight. All activities should have ceased and thus no water should have been consumed. This could be useful in identifying potential leakage and evaluating water loss in the water network within a given premises.

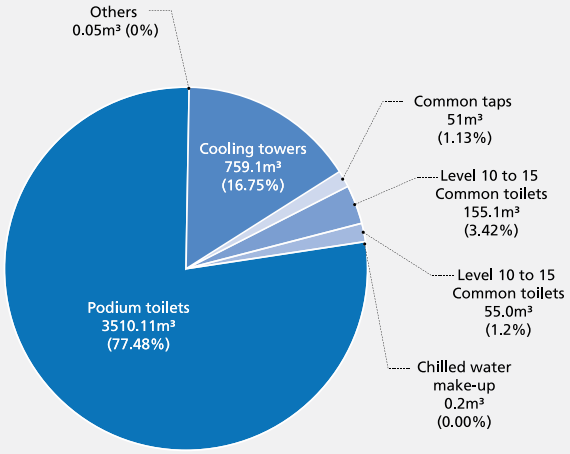


Pie chart generated from the portal, depicting the consumption breakdown at various water end use areas. The pattern of water usage within the building can thus be easily understood.

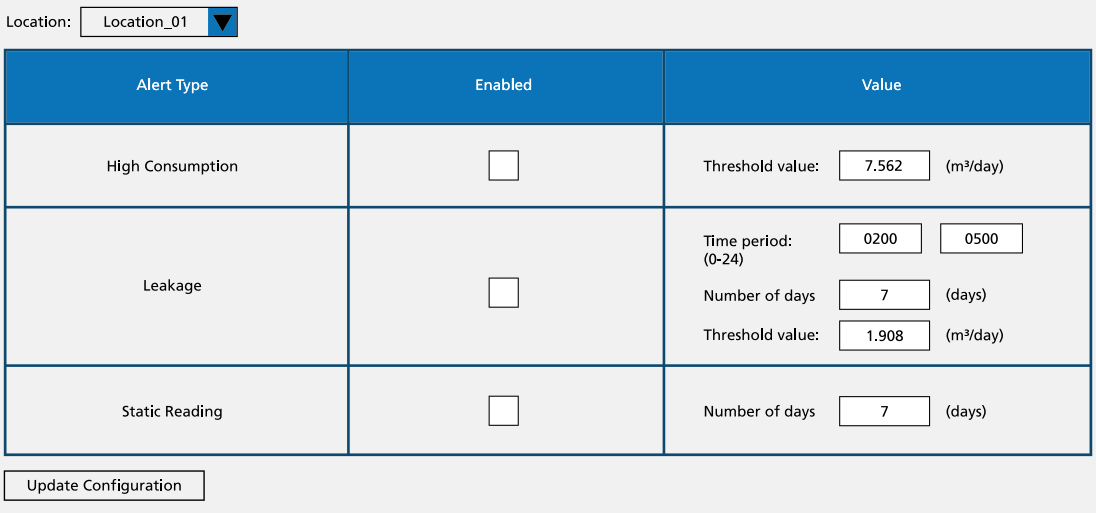


Alerts may be triggered by the system whenever there is a high consumption level, static reading or suspected leakage.

## 2.2 Identify and repair leaks

Water leakage is a common problem that may start off small, and almost indiscernible, yet may increase and gradually worsen over time. Leakages in water service installations can lead to wastage of water, damage to properties, loss of revenue, etc. Leaks, if detected, have to be repaired promptly.

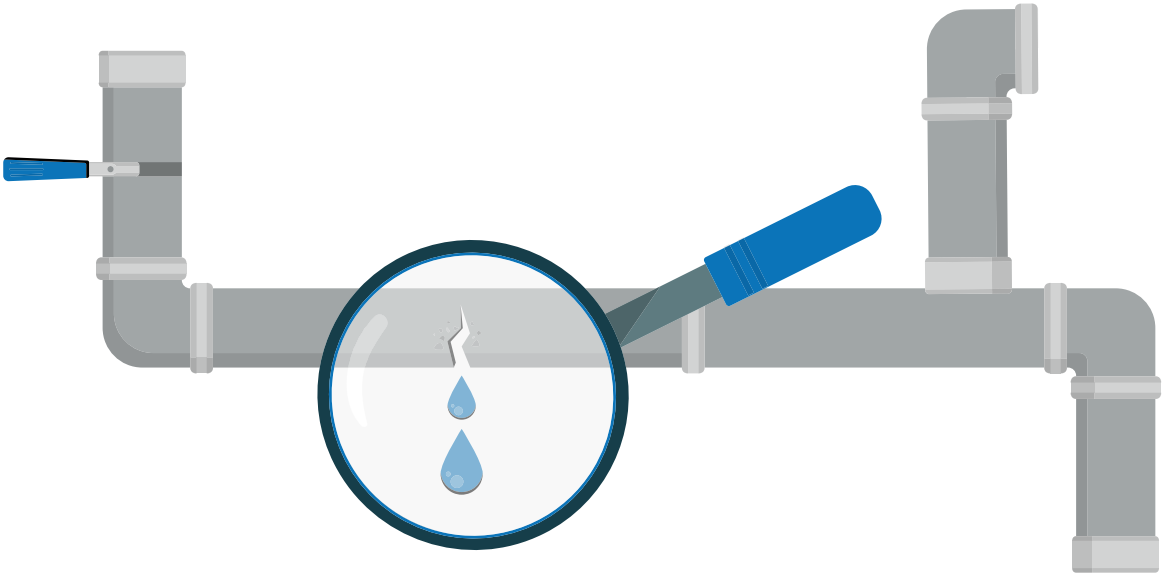

### 2.2.1 Regular leak test

A regular leak test helps in early detection of leaks in the water system. This simple test can be done in the following steps:

1. During the off-peak period where water consumption is low/ negligible, ensure that:

   **i. All fittings are closed**

   **ii. All water tanks are isolated and fully filled**

2. Observe the water meter to check whether the dial is moving. Movement of the dial shows that there is a leak somewhere in the system. Further investigation is required to locate the leak.

The higher the test frequency, the earlier you can identify leaks.

### 2.2.2 Signs of a leak

**i. A drop in water pressure**

**ii. Sightings of a damp wall or ground**

**iii. Rapid and unaccounted increase in water use**

It is strongly recommended that the facility manager or the water management committee keeps a copy of the as-built drawings of the water reticulation system. This would facilitate any future maintenance or repair of the water reticulation system and detection of leaks on the premises.

### 2.2.3 Fault-reporting system

It is a good practice for building management to implement a fault-reporting system to minimise wastage of precious water lost due to leaks, faulty water fittings, etc.

Building owners should maintain an established and clear channel of communication (i.e. phone call, email, text message) so tenants can send their fault reports to the relevant building maintenance personnel promptly.

Reports received should be ranked in terms of their severity and urgency, and cases with high potential to result in continued water loss should be prioritised.

Tracking and monitoring the status of these reports, to be done by senior building managers, is necessary to ensure that all cases reported are being attended to, followed up on and resolved within the timeframe specified by building owners.

It is paramount for building owners to continually remind building users, including cleaners or cleaning contractors, to look out for and report such cases to the building managers effectively and promptly.



*A user reporting a leaking tap to the building maintenance officer*



*An integrated fault and building management system*



## 2.3 Adopt a low-pressure water system

Adopting a low-pressure water system can help to reduce excessive water flow in a building, reduce incidence of leaks, and extend the lifespan of plumbing fixtures. This can be done by installing intermediate tank(s) and pressure-reducing valves at suitable levels of the water reticulation system within the building.

### 2.3.1 Pressure reducing valve (PRV)

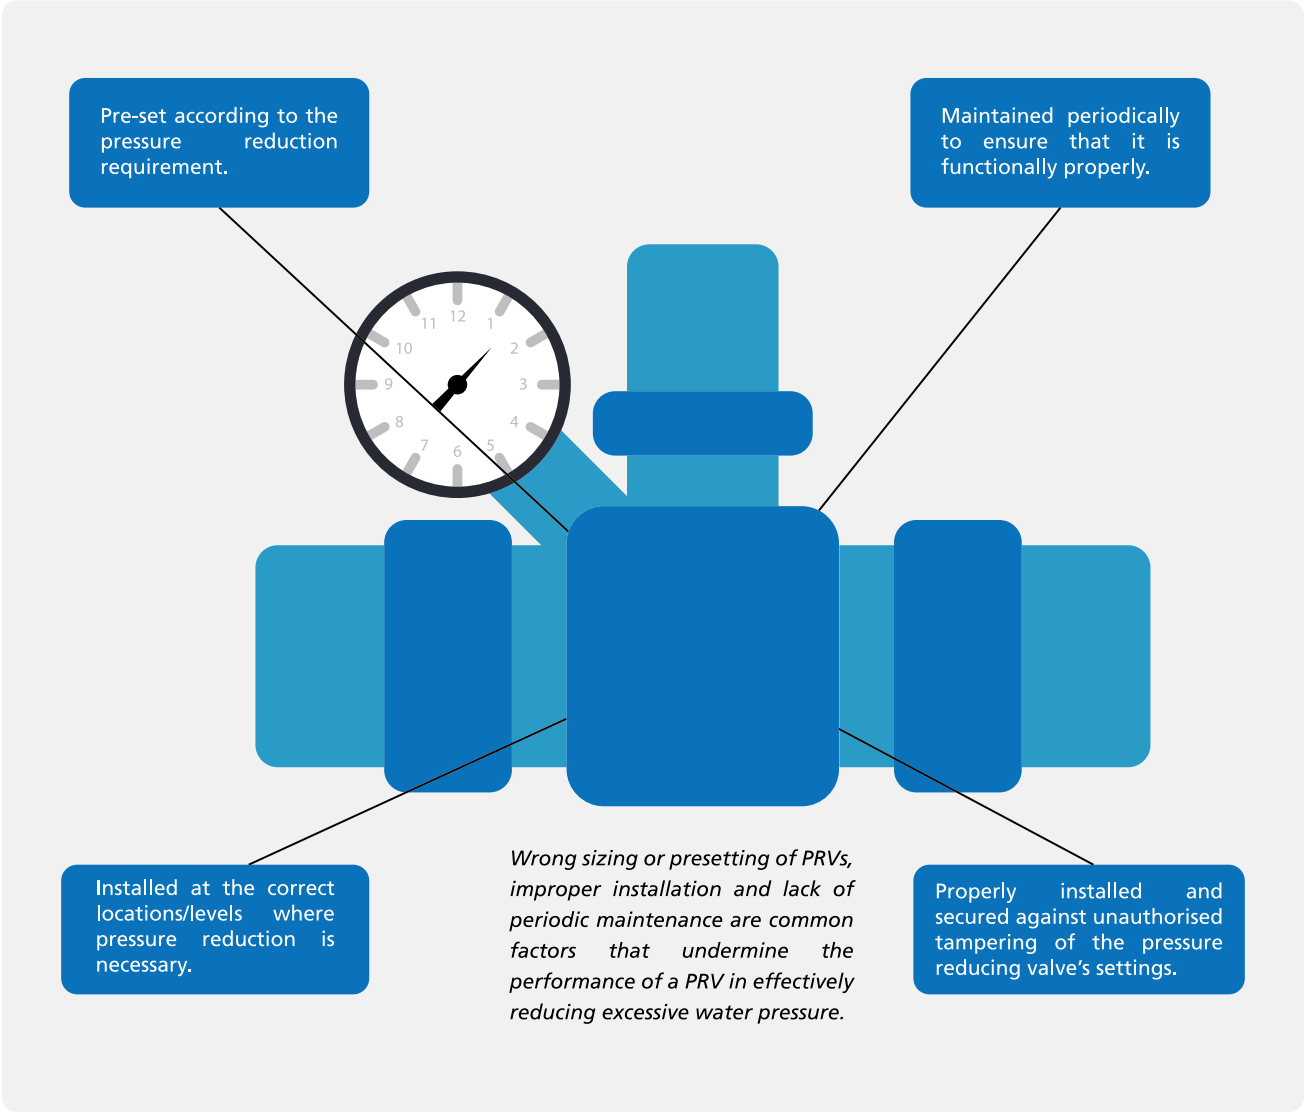

### 2.3.2 PRV installation configuration

Whenever a PRV is installed, a bypass arrangement should be incorporated with a second PRV as this will serve to isolate any defective PRVs.

A pressure indicator should be provided for pressure monitoring, and the associated pipes and fittings shall be able to withstand the maximum pressure that may arise upon the failure of the main PRV.

PRVs should be installed at locations where the water fittings downstream of the distributing pipe would not be subjected to pressure head exceeding 35 metres.

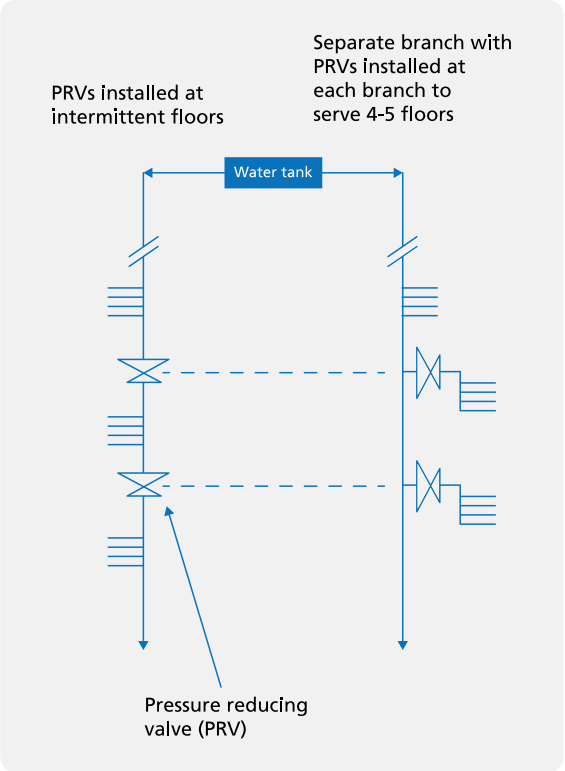


*Possible locations for installation of PRVs*

### 2.3.3 Intermediate tank

In high-rise buildings, water is typically pumped into storage tanks located on upper floors so that water to the rest of the building is supplied by gravity. This may cause excessive water pressure on the lower floors. Pressure reduction can be achieved by installing intermediate tanks at suitable levels in high-rise buildings. These intermediate tanks installed at levels lower than the high floor water tanks will serve water fittings at designated floors in a tall building.

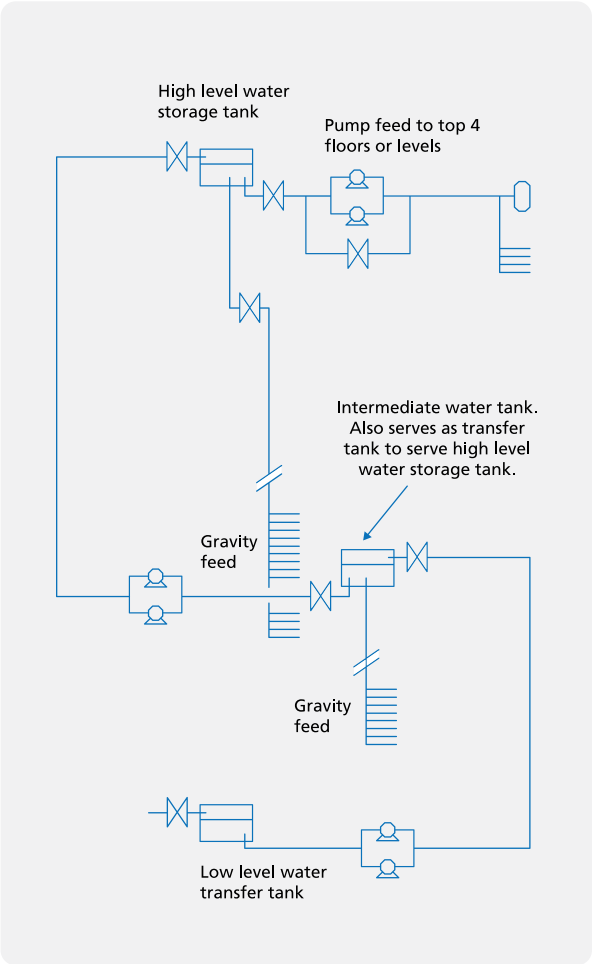


*Intermediate tanks in high-rise buildings*

## 2.4 Use water-efficient fittings/appliances/equipment

Building owners shall use WELS fittings labelled 2-tick and above to reduce water consumption and reap water bill savings. The table below shows the projected water savings from water efficiency labelled products.

WELS Fittings

| | Flow Rates Requirements | Potential Savings |
|---|---|---|
| Shower Taps & Mixers  | > 5 to 7 litres/min | 25% (compared to 1-tick) |
| | 5 litres/min or less | 38% (compared to 1-tick) |
| Basin Taps & Mixers  | > 2 to 4 litres/min | 40% (compared to 1-tick) |
| | 2 litres/min or less | 60% (compared to 1-tick) |
| Sink/Bib Taps & Mixers  | > 4 to 6 litres/min | 29% (compared to 1-tick) |
| | 4 litres/min or less | 43% (compared to 1-tick) |
| Flushing Cisterns (Per Flush)  | Dual Flush > 3.5 to 4.0 (full flush) > 2.5 to 3 litres (reduced flush) | 12% (compared to 1-tick) |
| | Dual Flush 3.5 litres or less (full flush) 2.5 litres or less (reduced flush) | 18% (compared to 1-tick) |
| Urinal Flush Valve & Waterless Urinals (Per Flush)  | > 0.5 to 1 litres | 40% (compared to 1-tick) |
| | 0.5 litres or less or waterless urinals | 60% (compared to 1-tick) |
| | **Wash Volume Requirements** | **Potential Savings** |
| Clothes Washing Machines (Per Wash Load)  | > 6 to 9 litres/kg | 29% (compared to 2-tick) |
| | 6 litres/kg or less | 43% (compared to 2-tick) |

= 1 Litre

WELS Fittings

| | Flow Rates Requirements | Potential Savings |
|---|---|---|
| Water-Closet Flush Valves  | > 3.5 to 4.0 litres | 11% (compared to 1-tick) |
| | 3.5 litres or less | 22% (compared to 1-tick) |

| | Wash Volume Requirements | Potential Savings |
|---|---|---|
| Dishwashers (for house-hold use)  | > 0.9 to 1.2 litres | 22% (compared to 1-tick) |
| | > 0.6 to 0.9 litres | 44% (compared to 1-tick) |
| | 0.6 or less litres | 56% (compared to 1-tick) |
| Washer Extractor (Per Kg - Front Load, Top Load)  | ≤ 8 litres/kg | 4% to 6% |
| Commercial Dishwasher (Per Rack - Undercounter, Hood)  | ≤ 2.4 litres/rack | 4% to 6% |
| High Pressure Washer (Per Min - For general cleaning purposes)  | ≤ 11 litres/min | 4% to 6% |

## 2.5 Water conservation in cooling system

### 2.5.1 Design a cooling system

The following factors are crucial in optimising or eliminating water consumption that should be taken into consideration when designing a cooling system:

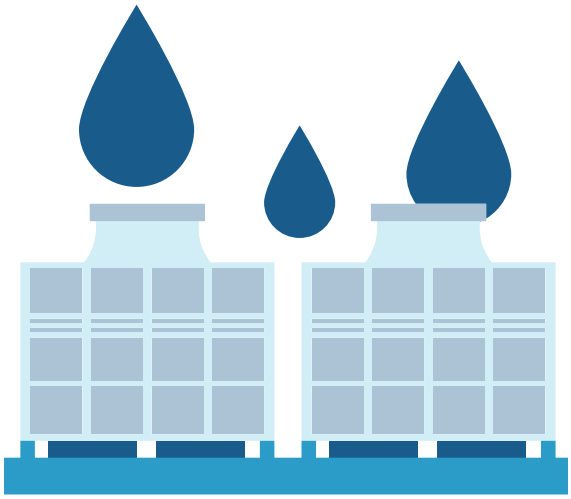

- **Minimise cooling loads**
- **Right sizing of cooling systems**
- **Choice of heat rejection systems**
- **Integration of smart devices**

### Minimise cooling loads

Generally, building cooling systems are designed based on a specific cooling load. Minimising cooling loads requires a co-ordinated approach by the design engineer, service personnel and building operators. Transmission, solar radiation, heat infiltration and office equipment are some heat sources that need to be examined to minimise cooling loads. Below are some of the practices/methods to reduce water and energy consumption.

a) Reduce the lighting load in buildings by incorporating occupancy sensors as well as making use of natural daylight. Hence, less heat will be produced.

b) Ensure adequate insulation on cooling system ducts to minimise unnecessary heat gain.

### Right sizing of cooling systems

It is important to have a detailed assessment on the required cooling load to ensure accurate sizing of equipment within a cooling system. Oversizing an air-conditioning system may lead to unnecessary increase in energy consumption and also potentially wear out your system more rapidly due to the frequent starts and stops. It's also recommended to adopt a system with variable or multiple speed features, which can adjust the blower/motor/pump speed based on the actual cooling load.

### Choice of heat rejection systems

The best time to consider alternative heat rejection systems is during the design of new systems or the retrofitting of existing chillers or cooling towers. There are various alternative heat rejection systems available to reject heat to the environment which can eliminate or dramatically reduce water consumption such as air-cooled/refrigerant-cooled systems.

### Integration of smart devices

Adoption of smart solutions is a key enabler for water-efficient management. Integration of smart devices such as remote metering and sensors into your building's HVAC system where real-time water consumption or temperature data are transmitted to SCADA, operators can be informed of anomalies with the alerts on irregular usage patterns, allowing them to take mitigation actions more quickly and hence minimizing water losses.



## 2.5.2 Water efficiency opportunities in cooling towers

Based on 2025 consumption data, cooling tower make-up is one of the largest water usage areas, which accounts for 19% of total water consumption of large water users in Building sectors. The following are some of the water efficiency best practices that companies should consider adopting to optimise the water usage of cooling towers:

a) Use of alternative sources of water
b) Water-efficient design
c) Proper operation and maintenance

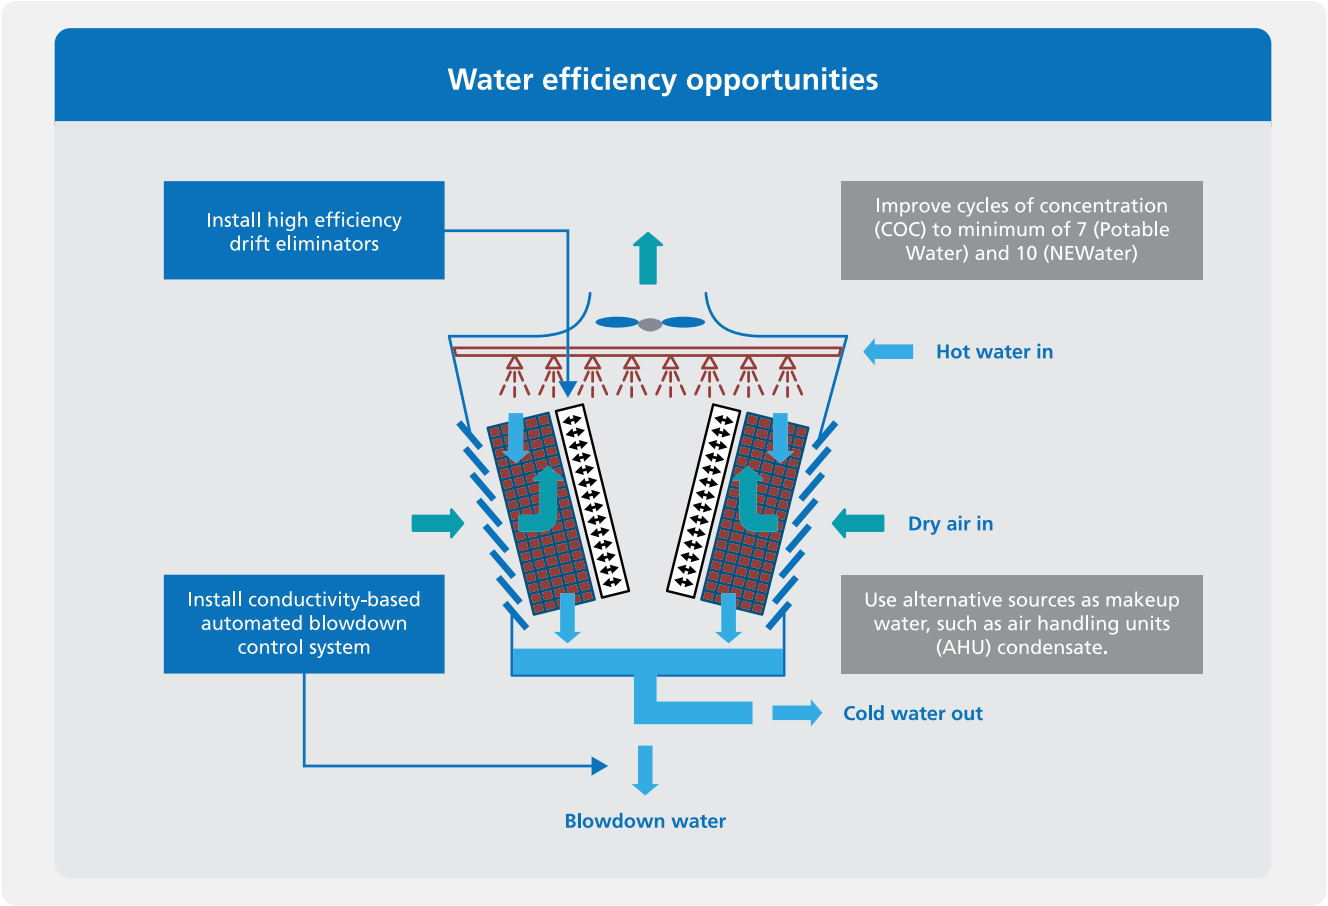

## Use of alternative sources of water for cooling towers

The use of alternative water sources as make-up water for cooling tower is highly recommended to reduce usage of potable water/NEWater. Some of the common alternative sources include:

a) AHU condensate: As condensate water is relatively lower in conductivity and hardness, it will allow the cooling tower to run at higher cycles of concentration (COC), thus reducing blowdown from the cooling tower.

b) Treated effluent: Reuse treated effluent from other sources as make-up water, provided the quality of the treated water meets the requirements of the cooling tower system.

c) Rainwater: Install a rainwater harvesting system and channel the collected rainwater to cooling tower make-up tank.



## Water-efficient design

A water-efficient cooling tower should adopt the following design criteria:

a) Install water meters on make-up and blowdown lines to monitor water consumption. Under Part IVA of the Public Utilities (Water Supply) Regulations, it is mandatory for premises with net water consumption of at least 60,000 m³ in the previous year to install private water meters at cooling tower make-up water line.

b) Install high efficiency drift eliminators - have an enclosure of the area above the cooling tower pond. This will reduce the effects of windage that cause the drift to escape through the sides. It should not be transparent or translucent as sunlight can promote the growth of algae, giving rise to the reproduction of legionella bacteria.



*Drift eliminator*

c) Install side-stream water filters. Suspended solids tend to clog spray nozzles and erode piping. This can increase blowdown rates or result in chemical by-products. By installing side-stream water filters, suspended solids can be removed to maintain cleaner cooling water within the system.

d) Install variable speed drive fans which match fan speed to actual cooling load. The fans controlled by the cooling water inlet temperature can reduce water and energy costs. By varying the airflow through the cooling towers, a maximum total chiller plant efficiency is achieved based on building load and ambient wet bulb temperature variation. As the fans slow down to meet load requirements, the fan input power required will be substantially reduced.

e) Install automated chemical dosing systems to control chemical feed based on make-up water flow or real-time chemical concentration monitoring. These systems minimise chemical use while optimising control against scale, corrosion, and biological growth.

f) Install conductivity meter to automatically control blowdown. Conductivity of cooling water will be measured continuously and bleed valve will only open when conductivity set point is exceeded.

g) Install anti-splash louvres or splash mats.



*Louvres*

h) Adopt a simple and practical design. Dead legs, loops and bends should be avoided and redundant pipework removed.

i) Easy access to all parts of the system for inspection, sampling, cleaning and disinfection.

j) Make use of construction materials that are corrosion resistant or less susceptible to corrosion (e.g. fibreglass, stainless steel). Materials used should not support the growth and proliferation of micro-organisms.

k) A drain with a drain-down valve should be located at the lowest point of the pond so that the entire system can be conveniently and completely drained.

l) Building owners/Cooling towers operators should also consult cooling water specialists for water-efficient solutions that are suitable/tailored for their cooling system.

## Proper operation and maintenance

It is important to have a basic understanding of the water distribution system in order to properly operate and maintain a cooling tower in a water efficient manner. The water balance of a tower involves all of the water inputs and outputs associated with the operation of the system. Water outputs include controlled losses such as evaporation, bleed, and drift and pump gland leakage and uncontrollable losses including leaks, splash out, overflows and windage. All of these losses are replaced by make-up water. Water efficiency of a cooling tower can be optimised by adopting the following approaches.

## Water consumption reduction

### Reduce uncontrolled losses



#### To prevent overflow

- Ensure the float valve on the makeup line can close properly to prevent uncontrolled inflow
- Ensure the overflow pipe is installed at the correct level and is not leaking
- Ensure that there is no overflow during normal operation
- Ensure that tower water distribution piping is not oversized or too long
- Ensure that the operating water levels in multiple tower/cold water basins are equal
- Replace ball float valves with solenoid valves that are controlled by electronic level sensors



#### To reduce water splashing

- Install anti-splash louvres on the tower air intakes
- Ensure anti-splash louvres are installed correctly and are not damaged
- Install a splash deck above the cold water basin
- Ensure the water supply pressure is within manufacturers' limits
- Ensure that the fan speed and air flow rates are within manufacturers' limits



#### To minimise drift losses

- Install and ensure proper placement of drift eliminators to prevent water droplets and mist from escaping
- Ensure the air flow rates are within manufacturers' limits
- Protect the tower from excessive ambient winds



#### To arrest leakage

- Conduct regular inspections to monitor whether there is any leakage at the cooling tower, especially at pipe connections and joints
- Pump gland leakage can be reduced by regular pump maintenance and replacing glands with mechanical seals

## Water consumption reduction

### Reduce controlled losses

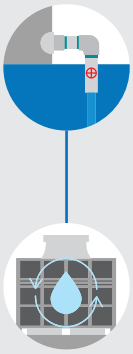

#### To improve the control of blowdown system

- Install conductivity based automated blowdown control system
- Perform routine maintenance and calibration of conductivity probes

#### To increase cycles of concentration (COC)

- Operators should consult service providers to explore possibilities to optimise COC in order to reduce blowdown to achieve substantial water savings. It is recommended to operate cooling towers at a minimum COC of 7 (Potable Water as makeup) or 10 (NEWater as makeup)

The magnitude of the water savings achievable diminishes with increasing COC, as shown in this table:

| | | New COC | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 15 | 20 |
| Initial COC | 2.0 | 25% | 33% | 38% | 40% | 42% | 43% | 44% | 45% | 46% | 47% |
| | 3.0 | - | 11% | 17% | 20% | 22% | 24% | 25% | 26% | 29% | 30% |
| | 4.0 | - | - | 6% | 10% | 13% | 14% | 16% | 17% | 20% | 21% |
| | 5.0 | - | - | - | 4% | 7% | 9% | 10% | 11% | 14% | 16% |
| | 6.0 | - | - | - | - | 3% | 5% | 6% | 7% | 11% | 12% |
| | 7.0 | - | - | - | - | - | - | - | 2% | 4% | 5% |

## Cooling water quality management

Cooling water should be maintained with a proper water treatment regime to prevent or adequately inhibit corrosion, scaling formation and microbial fouling in the system.

### Bio-fouling control

Rapid growth of micro-organisms within the recirculation water will lead to the formation of microbial slimes. The sticky slime layers trap particles/foulants and eventually lead to microbial fouling within the system. Other attributing factors for microbial growth include:

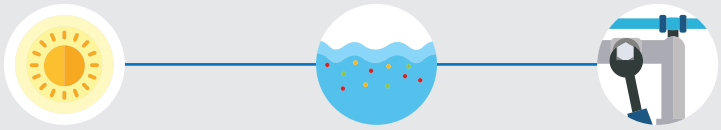

Presence of sunlight

High concentration of nutrients in cooling water

Process leak within the cooling system

Growth of micro-organisms within the cooling tower can result in the following operational setbacks:

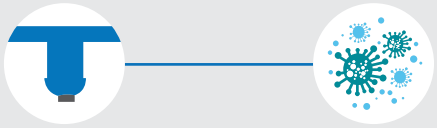

Plugged nozzles that hinder heat transfer

Presence of biofilm, causing deterioration of water quality, drop in flow rate as well as lower heat transfer efficiency

Therefore, it is important to perform necessary disinfection to control proliferation of micro-organisms in the system. Below are some commonly used treatment methods and preventive measures:

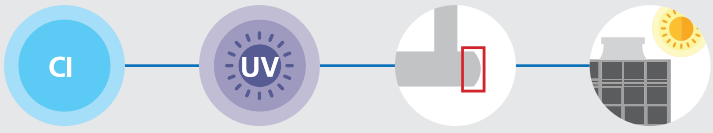


Chlorination

Ultraviolet disinfection

Elimination of deadends

Minimising exposure of basins/ distribution deck to direct sunlight

*For the control of legionella bacteria, operators shall comply with Part III of the "Code of Practice for the Control of Legionella Bacteria in Cooling Towers". A copy of the guideline is available at https://www.nea.gov.sg/*

## Cooling water quality management

### Deposit and scale control

Accumulation of scale deposits in cooling system diminishes not only heat transfer efficiency but also capacity of water distribution system. Scaling are formed when solubility of scale-forming compounds such as calcium carbonate is exceeded in the water. Some of the factors that may lead to formation of scales are:

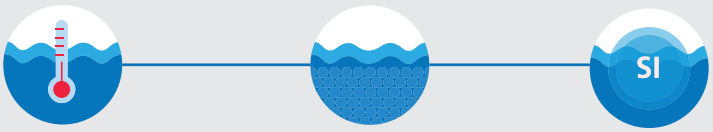


High water surface temperature (some compounds have inverse solubility above 60°C)

High water hardness (above 400 ppm $CaCO_3$)

Unacceptable level of silica (above 120 ppm)

Operational control is crucial to minimise formation of scales and deposits within the cooling system. Effective methods to inhibit scaling are indicated below:

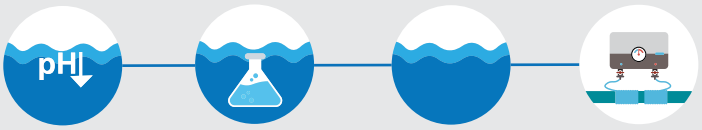


*Addition of acid

Dosing of chemical additives

Operating at subsaturation conditions

Installing an electromagnetic descaler

## Cooling water quality management

### Corrosion control

Corrosion in the cooling system will result in structural strength weakening of metal compounds and eventually lead to equipment failure. Apart from that, formation of deposits caused by corrosion may potentially plug water passage within the cooling system.

Factors affecting corrosion include:

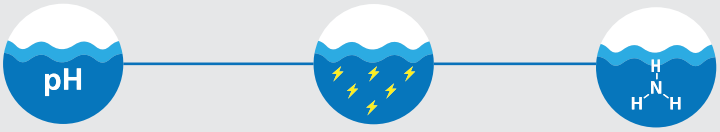


| pH level of circulation water | Higher water conductivity | High ammonia concentration |
|---|---|---|
| (galvanised steel is susceptible to corrosion with pH levels below 6.5 or above 9) | (the upper limit varies for different system metallurgy) | (corrosive to copper alloys as low as 0.3 ppm) |

Corrosion monitoring shall be in place to ensure that corrosion control measures adopted are effective and any abnormal conditions are instantly detected. Methods of corrosion control are described as follows:



| Dosing of corrosion inhibitors | Selection of non-corrosive construction materials | Application of protective coating |
|---|---|---|

### Temporary shutdown of cooling towers

If certain cooling tower units are required to be shut down for more than five days, operators shall conduct sampling tests (bacteria counts, biocide levels) at least once a week to ensure the water quality is within control limits. Alternatively, water within the unit(s) shall be completely drained off and dried with blowers. Makeup water and blowdown valves shall be fully shut as well.

Standby cooling tower units that are filled with water shall be put into operation on a rotational basis to avoid a unit from being left idle for an extensive period of time. Ideally, this should take place at least once a week. Regular water sampling shall also be performed to ensure that cooling water is maintained at good conditions.

For more details, please refer to **Technical Reference for Water Conservation in Cooling Towers** published by PUB.

### 2.5.3 Reducing Cooling Tower Water Consumption Through Treatment Technologies

Cooling tower water consumption can be reduced by increasing the cycles of concentration (COC) or using alternative sources of make-up water, such as treated cooling tower blowdown.

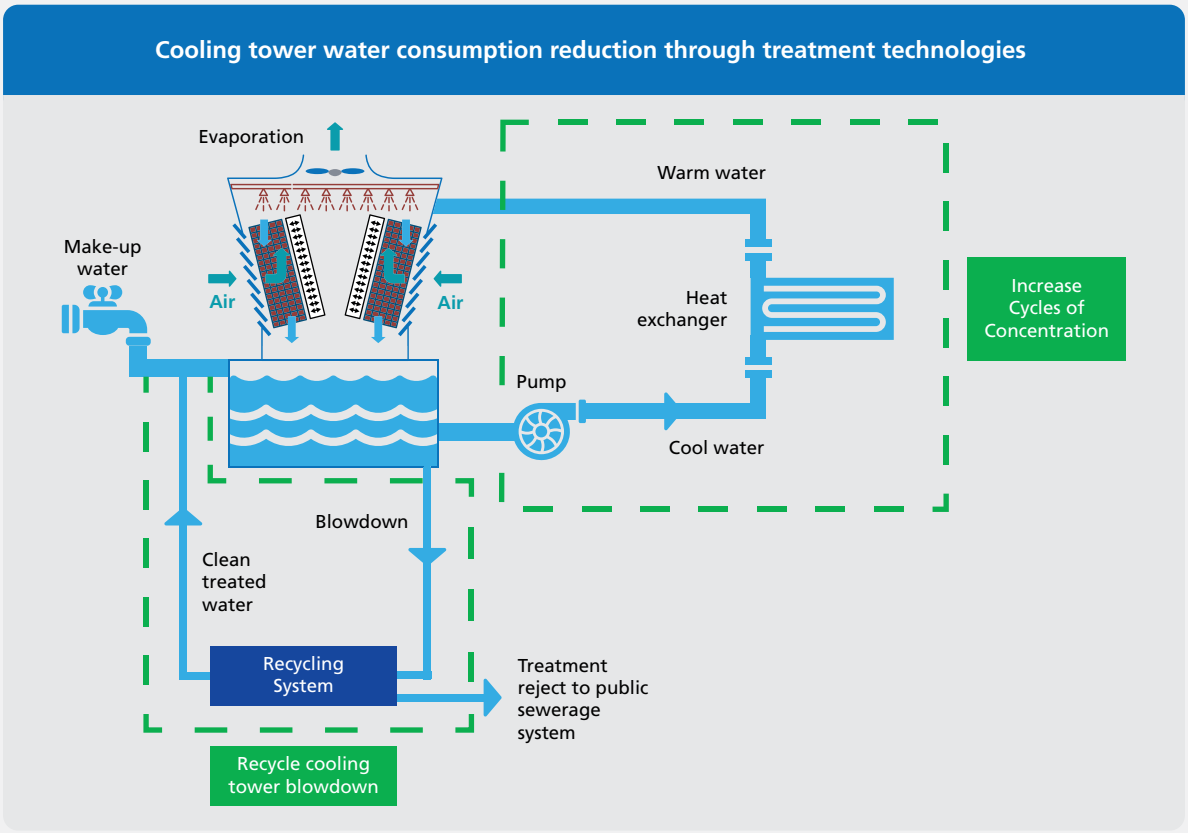


### Increasing COC to Reduce Blowdown Volume and Make-Up Water Consumption

COC is the ratio of dissolved solids concentration in the circulating (or blowdown) water to that in the make-up water. Cooling towers should be operated at a minimum COC of 7 for potable water make-up, or 10 for NEWater make-up.

Increasing COC beyond the minimum allows cooling water to be recirculated for more cycles before it is discharged as blowdown. **This reduces both blowdown volume and fresh make-up water consumption.**

COC can be increased through treatment technologies that improve cooling water quality, such as side-stream filtration, chemical dosing or electrochemical treatment. Another approach is conductivity-based automated blowdown control, which opens the bleed valve only when the conductivity set point is exceeded, rather than on a fixed timer or manually. Conductivity sensors should be cleaned monthly and re-calibrated at least every six months.

## Side-Stream Filtration

Suspended solids such as dust, silt, corrosion products, biological debris, and precipitated minerals can clog spray nozzles, erode piping, and increase blowdown rates. Side-stream filtration continuously diverts a portion of the recirculating water through a filtration system, maintaining cleaner cooling water and supporting higher, more stable COC operation.

However, side-stream filtration primarily removes suspended solids rather than dissolved salts such as chloride, sulfate and calcium. Therefore, the achievable COC will still depend on water chemistry, scaling and corrosion limits, and the overall water-treatment programme.

## Chemical Dosing

Chemical treatment can support higher COC by controlling scaling, corrosion, pH, and biological growth, using a combination of **scale inhibitors, acid dosing, corrosion inhibitors, and biocides** as required.

The appropriate chemicals and dosing rates depend on make-up water quality, target COC, operating conditions, and equipment materials, and should be determined through a water analysis.

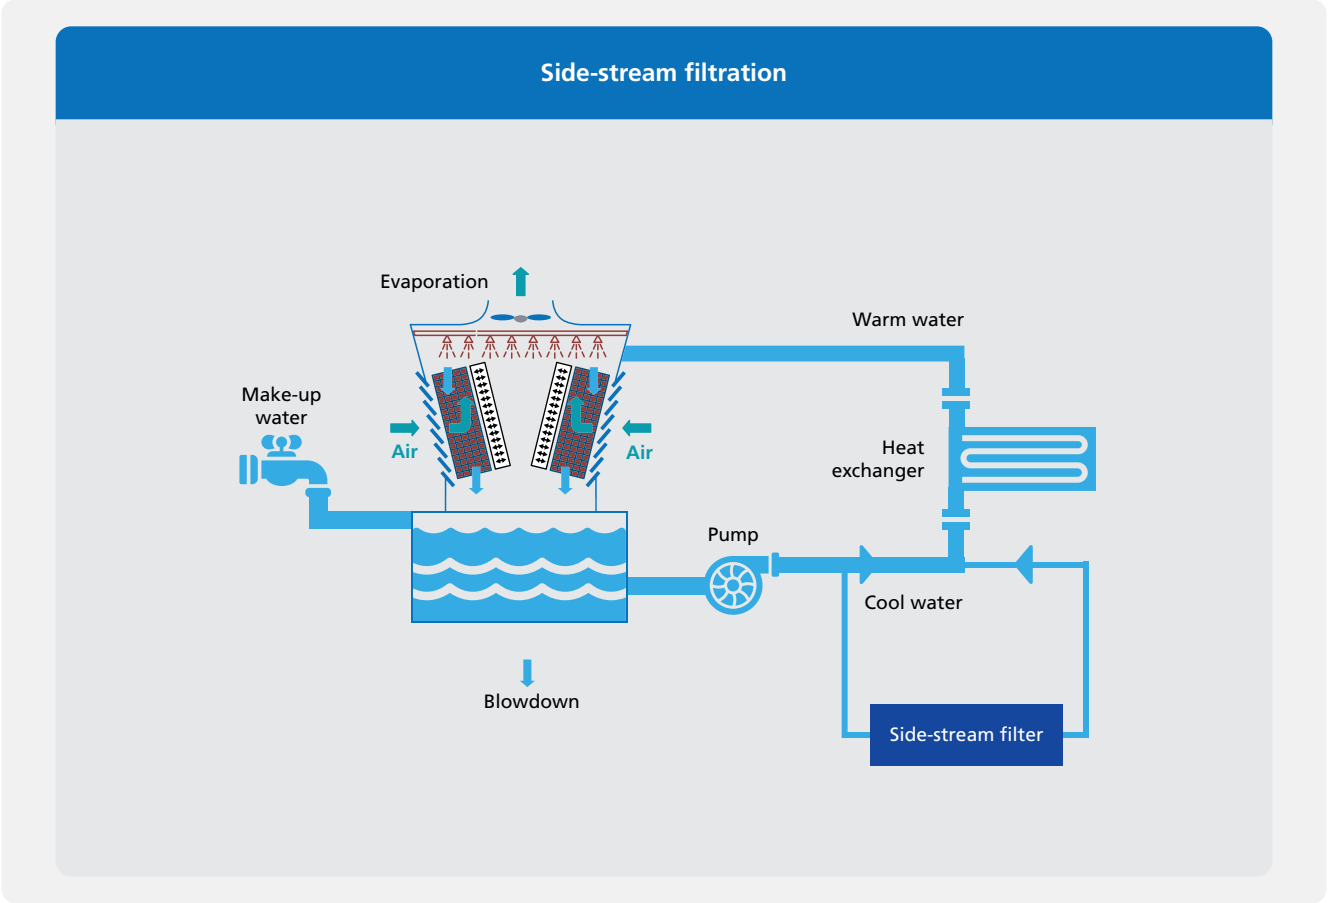

## Electrochemical Treatment

Electrochemical treatment provides an alternative approach to conventional chemical treatment. The system applies an electrical current through electrodes, encouraging scale-forming minerals such as calcium carbonate to precipitate within the treatment unit rather than on cooling tower components, heat exchangers and pipework. The accumulated deposits are then periodically removed.

By controlling scale-forming constituents, electrochemical treatment can enable higher COC operation while helping to maintain heat-transfer efficiency and water flow. Depending on the technology and water chemistry, it may also contribute to microbiological control.

Compared with conventional chemical dosing, electrochemical treatment generally reduces the need for chemical storage, handling and dosing infrastructure, while generating less sludge and waste. However, its higher upfront capital costs, ongoing energy consumption and periodic electrode maintenance should be considered in the total cost of ownership, alongside potential savings in water and chemical use.

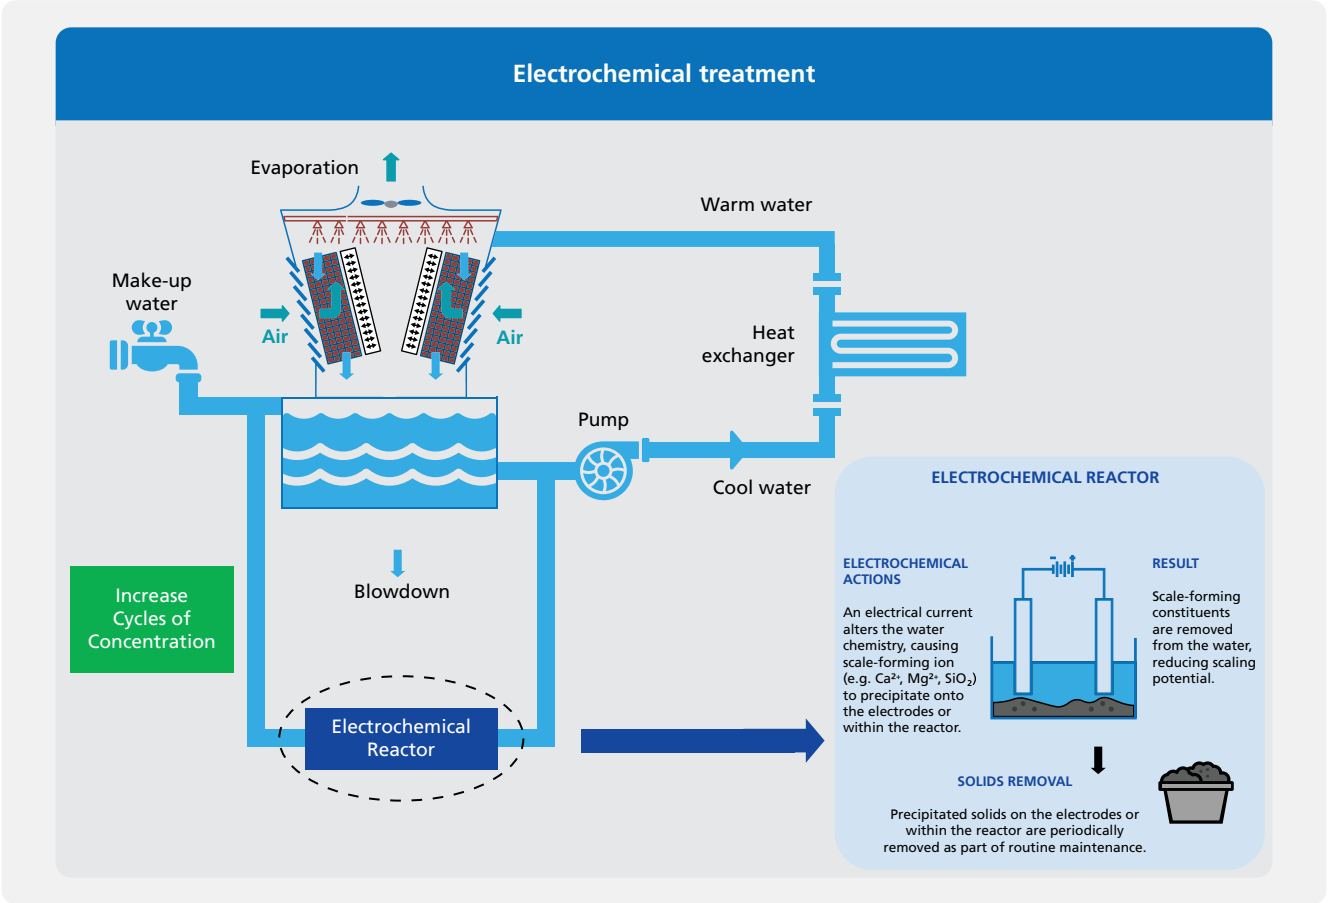

## Cooling Tower Blowdown Water Recovery

Water demand can also be reduced by using alternative make-up water sources. One option is to treat and reuse cooling tower blowdown, which is discharged to control the accumulation of dissolved solids and other contaminants in the circulating water. Reusing blowdown water can reduce both demand for external water supplies and the volume of wastewater discharged.

Depending on blowdown water quality and intended reuse, treatment may include **media or membrane filtration, such as ultrafiltration (UF), and reverse osmosis (RO).** Filtration removes suspended solids, softening reduces hardness that can contribute to scaling, and RO removes dissolved salts where required. A combination of these processes may be needed to achieve the water quality required for reuse as make-up water.

The appropriate treatment system and achievable recovery rate depend on factors such as blowdown water quality, make-up water quality requirements, treatment performance, reject-stream management, space availability and lifecycle cost. A qualified water treatment provider should be engaged to assess site-specific conditions and recommend a suitable recycling system. Plant owners should also assess the volume of reclaimable water to determine whether the reclaim system is cost-effective to implement.

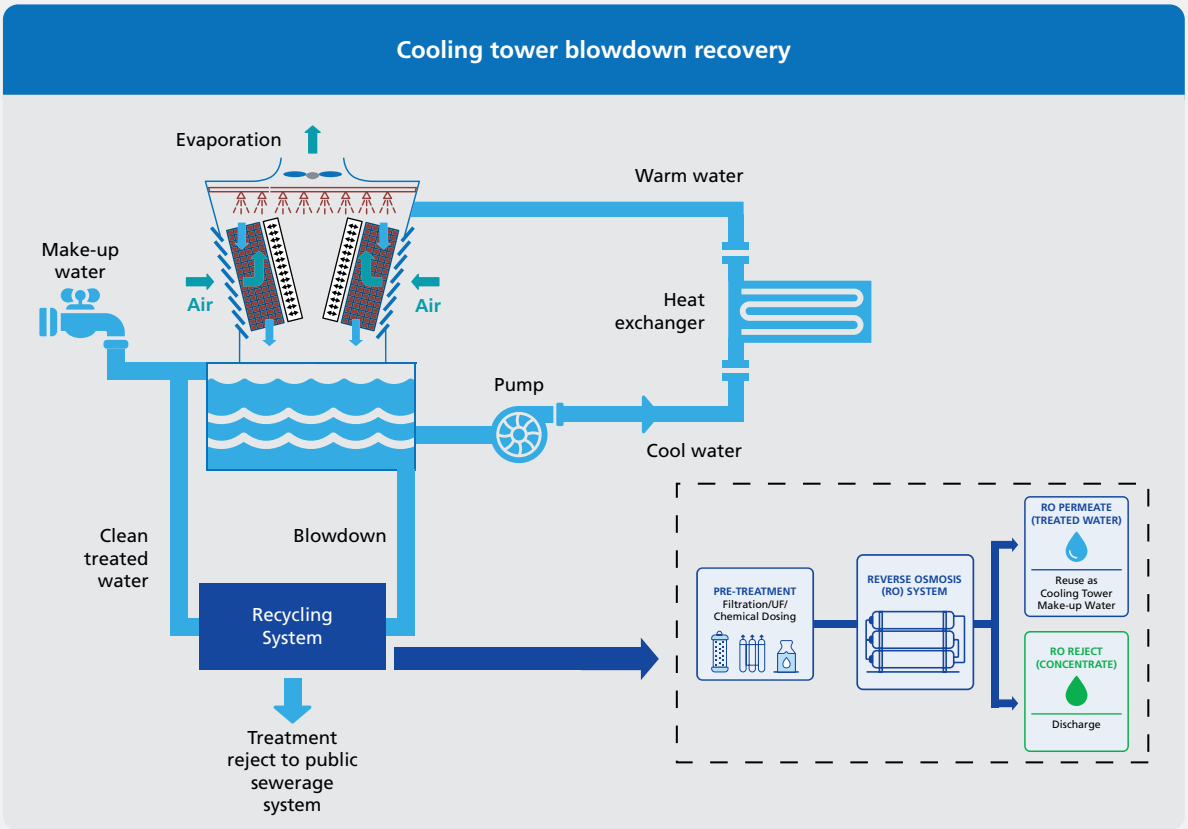

## 2.6 Adopt water-efficient landscape designs & irrigation systems

Water efficiency is the ability to use the least possible amount of water while allowing the landscape to flourish. There are many water efficiency methods in landscaping, spanning areas like landscape design, usage of technologies and irrigation practices.

### 2.6.1 Landscape design

The right landscape design is the building block of any good water conservation plan. It can be achieved through smart planning of the types of plants and soil used and hydro-zones allocation.

#### Use of water-efficient, drought-resistant plants

These plants generally require little irrigation. A list of drought-resistant plants which can be used for landscapes and rooftop gardens can be found at NParks Flora & Fauna website: https://www.nparks.gov.sg/florafaunaweb/

#### Limit turf area

Most turf grass requires high water consumption and continual upkeep.

#### Select or group plants (hydro-zone)

Hydro-zoning is the practice of clustering together plants with similar water requirements in an effort to conserve water. Irrigation amounts vary, depending on the types and species of plants. High water usage areas include lawns, and sites of ornamental and new plants. Medium water usage areas include shrubs or ground covers. Low water usage areas include ground rooted trees.

If plants of different water requirements share a zone, water will be wasted on plants that do not require much irrigation. In addition to saving water, hydro-zoning will also enable a more efficient allocation of resources, such as on-going maintenance and fertilisation.

Once hydro-zoning has been planned, a zoned irrigation system can be designed to match the water requirements of the different zones.

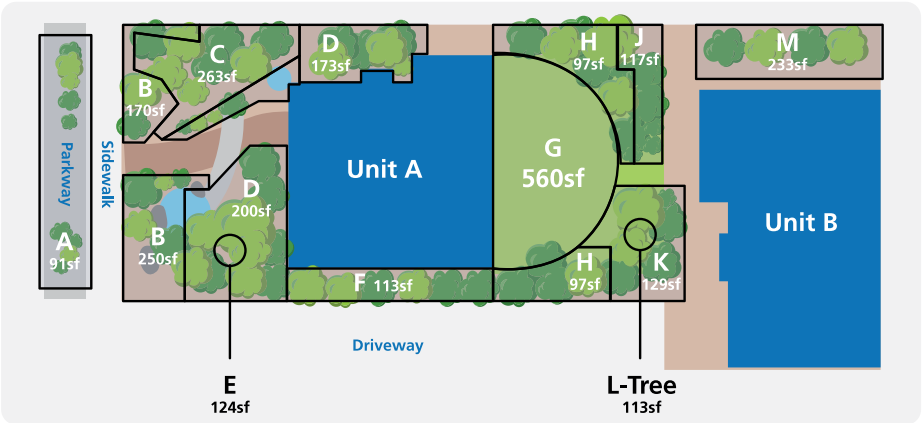


*Examples of hydro-zones*

### Soil selection

Choosing the right type of soil mixtures would enable maximum retention of water and nutrients in the soil for plant uptake. Understanding the depth and type of soil enables users to determine the frequency and quantity of water required for irrigation.

Water-retaining gels or granules can also be used to maximise water retention in soil and reduce the frequency of irrigation. However, using these may lead to water accumulation in local spots.

Commercial products in liquid form can be applied to an entire irrigation area to prevent water accumulation. Such products help to save water in two ways. They reduce water loss through surface runoff during irrigation with their quick absorption ability and, secondly, they reduce the frequency of irrigation with their moisture-retaining capabilities.

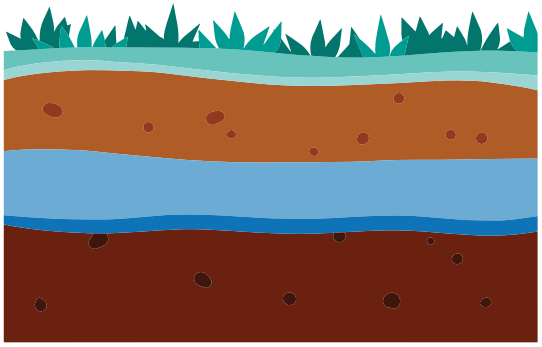

## 2.6.2 Understanding water use in the landscape

Understanding water usage is the first step in improving water efficiency in the landscape. Gradually reduce the amount/frequency of irrigation to observe how a decrease in water affects the landscape and make adjustments as needed. Monitor the water consumption for irrigation through the following measures to arrive at the optimal amount of water required by the plants.

### Monitoring water consumption for irrigation

This can be done either by using private water meters to compile simple data records or installing data logging equipment to monitor the water consumption for irrigation. Compiling comprehensive data records enables users to monitor water consumption for irrigation from time to time and assess if practices lead to better water efficiency.

### Private water meters

Private water meter readings with proper daily/weekly/monthly records enable users to have a better estimate of the water consumption for irrigation. The following is an example of an irrigation meter record that monitors water consumption:

| Irrigation meter at B1 | | | |
|---|---|---|---|
| (Month) | NEWater top up | Rainwater | AHU condensate |
| 1 | 0 | 3 | 5 |
| 2 | 1 | 2 | 6 |
| 3 | 3 | 0 | 6 |
| ... | | | |
| 31 | 0 | 4 | 6 |

*Example of irrigation meter records*

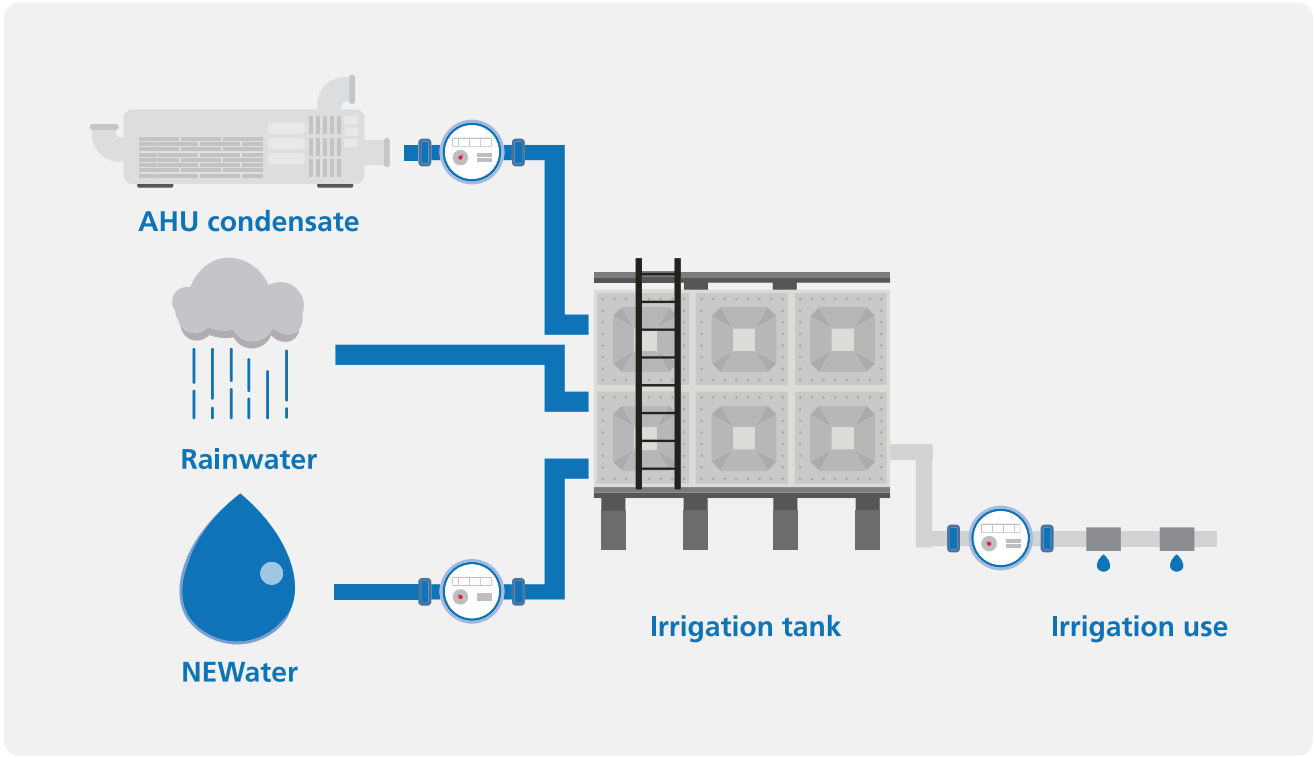


*Example of private water meters being used to monitor water usage for irrigation*

### Data logging equipment

Data logging equipment such as remote metering systems enable users to have constant consumption feedback through a centralised system and empowers users to closely monitor their water consumption for irrigation.

### Manual data collection

Areas with many tap points render the use of private water meters or automated data logging equipment infeasible. A simple way to estimate the irrigation consumption on your premises is to determine the tap flow rates at the various zones used and the duration of irrigation activity for each zone. An estimate of water usage for irrigation activity can be calculated using the formula below:

**Water usage for irrigation ($m^3$) = (M1 * F1) + (M2 * F2) + (M3 * F3) + (M4 * F4) + ...**

| | Zone 1 | Zone 2 | Zone 3 | Zone 4 |
|---|---|---|---|---|
| Tap flow rate ($m^3$/min) | F1 | F2 | F3 | F4 |
| Time (start) | | | | |
| Time (End) | | | | |
| Duration (min) | M1 | M2 | M3 | M4 |

## 2.6.3 Water-efficient irrigation practices

Complementing the technologies available, good irrigation practices would enable users to be more water-efficient. Irrigation should be done in the early mornings or late evenings when the evaporation-transpiration rate of the plants is low. This will ensure that most of the water will reach the plant roots and not be lost due to evaporation or wind. Either a manual or an automated irrigation system could be adopted to distribute the water required by the plants.

### Manual irrigation

Manual irrigation can be done using a bucket and pail or through a water hose. If a water hose is used for manual irrigation, the hose shall be fitted with a flow control device.

Irrigation practices such as not irrigating for the next two days if it had rained the day before, and monitoring the weather forecast to determine irrigation activities are also best practices that help to conserve water.

### Automated irrigation system

An automated irrigation system is a powerful way to monitor and supervise irrigation practices for landscapes in many types of developments. Systems and proprietary products designed by professionals are helpful in formulating the best irrigation system for a particular landscape with the aim of conserving water. During the design stage for automated irrigation system, one of the important considerations is to ensure that water is distributed uniformly at desired depth to prevent water wastage.

Constant checks and monitoring of the irrigation system need to be conducted to ensure that the settings are efficient. For instance, during rainy season, the irrigation frequency can be lowered, while during the drought season, irrigation frequency can be increased.

A manual shut-off valve should be provided as close as practicable to the point of connection to the water supply, to minimise water loss in the event of an emergency or during routine maintenance. Pipes and appurtenances should be designed to be durable. Regular checks on pipes and appurtenances are crucial in order to rectify leaks and clogged emitters to ensure water efficiency.

### Drip irrigation system

Drip irrigation is the frequent, slow application of water to the specific root zone area of the flora through small flexible pipes and flow control devices (emitters). It provides a constant level of sub-surface moisture to the root ball of the plant for optimum growth or maintenance. Since water is applied directly to the roots, evaporation and runoff are minimised.

## Root-watering system

A root-watering system allows water to be delivered through tubes that have been pegged into the ground surrounding the roots of trees. In this case, water is directed near to the source of intake. The system is submerged, as opposed to the drip irrigation system.

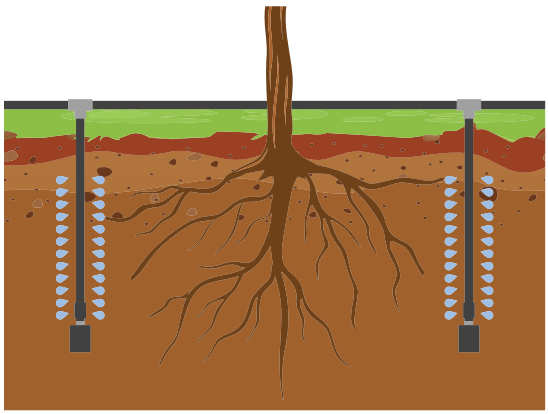

## Rain sensors

Automatic controllers should be used to turn off the irrigation system and control the water flow through the various zones according to a pre-set schedule. Rain sensors should be incorporated to automatically turn off irrigation systems during rainy days.

When the rain sensor activates due to sufficient rainfall, the selected irrigation system will remain inactive until the hygroscopic discs inside the sensor have dried out. This dry out rate will be about the same as the soil drying rate and re-activated once the disc is dry again. The dry out rate can be set to different levels. After the rain sensor dries out, the controller will resume its normal watering schedule.

The rain sensor should be mounted as close to the controller as possible, away from the irrigation system, is exposed to unobstructed rainfall, and with similar sun exposure as the landscape being watered. Ideal locations are in the pitched edges of rooftops and fences.

## Soil moisture sensors

Installing a soil moisture sensor will prevent the controller from activating the watering system if the soil is sufficiently moist. It determines the soil moisture content by measuring the impedance of the soil between the two sensor pads. As the soil gets wetter, the impedance of the soil reduces. The sensor takes measurements of the landscape's soil moisture at regular intervals. Using a pre-set moisture level as a benchmark prevents the watering system from operating until the soil has become drier than the pre-set moisture level.

## Water retention and drainage tray

A water retention and drainage tray system is a lightweight, cost effective array of trays that store appropriate amounts of water for the subsequent needs of the flora. This slows down the drainage of water after rain or watering. The water will be absorbed later as needed. This promotes the growth of healthier plants and reduces irrigation frequencies.

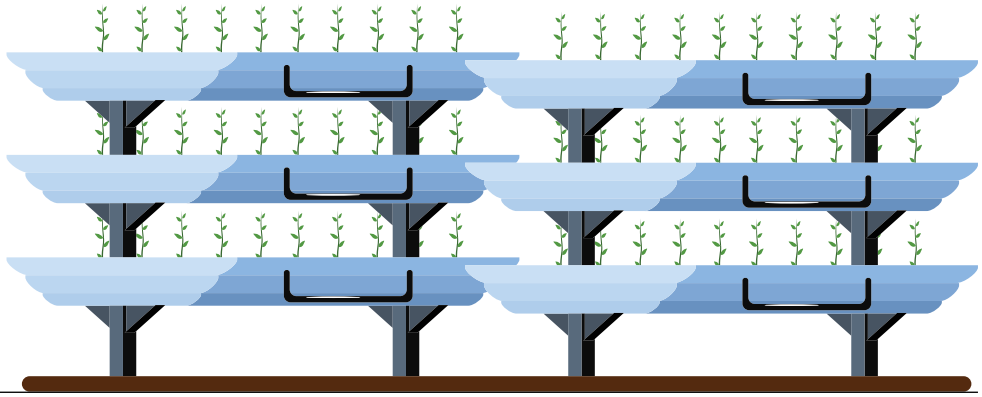

## 2.7 Adopt water-efficient general washing practices

General washing of a building can be practised using pails, mops, cleaning scrubber machines, high-pressure jets and water brooms. Good general washing practices include:

Using more water-efficient cleaning equipment such as cleaning scrubber machines and mops, in place of hoses, wherever possible.

Re-evaluating the schedule for general washing and cleaning:

• A high frequency cleaning regime for high use areas such as entrances, exits and walkways will prevent the build-up of dirt and grime, thus eliminating the extra effort needed to remove ingrained dirt. This should involve regular sweeping and spot mopping i.e. cleaning activities that require little use of water.

• In areas of low use, evaluate if the frequency of general washing can be reduced.

• Assess the cleaning requirements of areas before proceeding to ensure that cleaning occurs on a need-to basis. For example, it may not be necessary to wash windows if it has just rained.

Using non-potable sources of water such as recycled water (e.g. rainwater, AHU condensate) for general washing.

When using a hose for washing or watering plants, ensure that it is fitted with a control device to regulate the water flow.

Installing drains close to areas where more cleaning is required in order to minimise the need to use a hose as a broom.

Checking and adjusting nozzle spray patterns for hoses in order to optimise application of sprays.

Floor mats may be used to minimise the spreading of dirt throughout the building.

Ensure that cleaning staff are supervised and educated on water saving practices.



## 2.8 Use alternative water sources for non-potable water usage areas

To reduce the use of potable water for non-potable purposes, it is essential that we explore the use of alternative water sources for non-potable uses such as cooling tower use, irrigation, toilet flushing, general washing, etc. Some examples of alternative water sources include harvested rainwater, collection of AHU condensate and greywater. Substituting potable water with alternative water sources helps to meet the demand of precious quality water and economise use of the water around us.

NEWater is presently supplied to commercial and industrial premises for cooling towers, suitable process uses, general washing and irrigation. All new non-domestic (both commercial and industrial) development proposals, including existing non-domestic premises with cooling towers and/or processes undergoing addition/alteration (A&A) works are required to provide a dedicated NEWater pipe system during planning and construction/A&A works to incorporate NEWater for such usage when it becomes available in future.

### 2.8.1 Rainwater harvesting

Rainwater harvesting is one of the alternative sources of water that can be used in commercial buildings and operation-based premises. It is a process of collecting, filtering, storing and using rainwater for non-potable purposes.

In Singapore, collected rainwater should be used strictly for non-potable uses such as toilet-flushing, cooling tower make-up, landscape irrigation, general washing (excluding washing of hands/face, showering, bathing and brushing of teeth as these activities may lead to accidental ingestion of the non-potable water) and other various purposes. To prevent the unwitting use of harvested rainwater for potable purposes, it is always a good practice to display clearly a "non-potable use only/not for drinking" sign at the point of use.

#### Essentials of a rainwater harvesting system

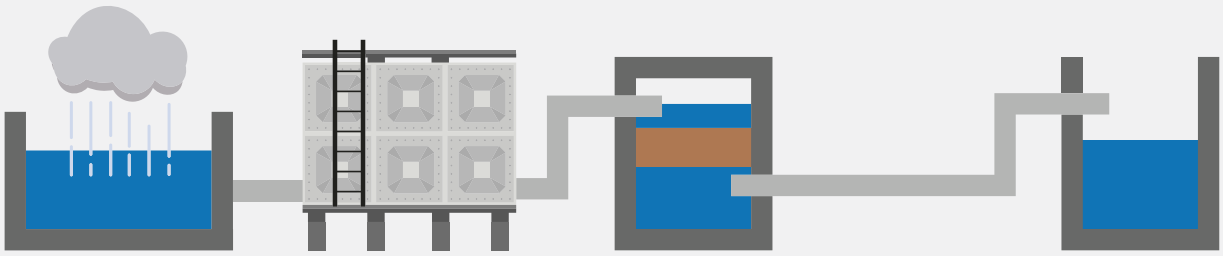

A **collection system** at the catchment area (usually the roof top)

A **storage tank** with pumps to pump the water from the storage tank to the water usage area(s). Depending on the location of the collection and storage tank, a pump may be required.

**Filters**

**Water pipes** direct the rain water from the collection point to the storage location and to the water usage area(s).

**Reuse area**

## Considerations before implementing a rainwater harvesting system

**Available space**: In existing building set-ups, space is the primary concern for implementing such a system. Detailed planning and careful consideration are often required to ensure that the storage tank and the water usage areas are located close to each other to avoid unnecessary pipe works and the use of pumps, which result in energy wastage. Possible locations for storing such a system include basement car parks and landscape areas.

**Regulations**: Prior to installation of the rainwater collection system, the owner or developer is required to appoint an appropriate qualified person (who is a Professional Engineer in Mechanical for a pumped system, or a Professional Engineer in Civil for a gravity flow system) to submit an application for the rainwater collection system to PUB's Building Plan Unit (BPU) for approval and supervision of the installation in accordance with Section 31 of the Sewerage and Drainage Act.

**Health and safety:** Rainwater tanks provide a breeding place for disease-carrying mosquitoes. To avoid creating a mosquito breeding habitat, measures should be in place to ensure tank inlets and overflows are properly screened to exclude mosquitoes.

**Maintenance:** Proper operation and maintenance of rainwater harvesting systems help to protect water quality and ensure that the system is running efficiently. Regular inspections such as cleaning of catchment areas, gutters, pipes, filters and tanks reduce the likelihood of contamination and blockage. Managing agents should check with system vendors on proper maintenance techniques, train the site staff on proper system maintenance, and include them in the daily routine checks.

**Responsible manufacturing:** Materials/substances used for the manufacturing or construction of rainwater harvesting tank should be non-hazardous to human health and well-being. Operators may refer to Singapore green building products which address responsible procurement holistically.

## Utilising storm water detention tank for rainwater harvesting systems

Detention tanks collect and store storm water runoff during a storm event, then release it at controlled rates to the downstream drainage system, thereby attenuating peak discharge rates from the site. With such systems in place, the drainage system as a whole can cater for higher intensity storms brought about by increasing uncertainties due to climate change. Detention tanks may be located above ground on buildings, on ground levels and even underground. The figure below shows an example of an on-site detention tank system.

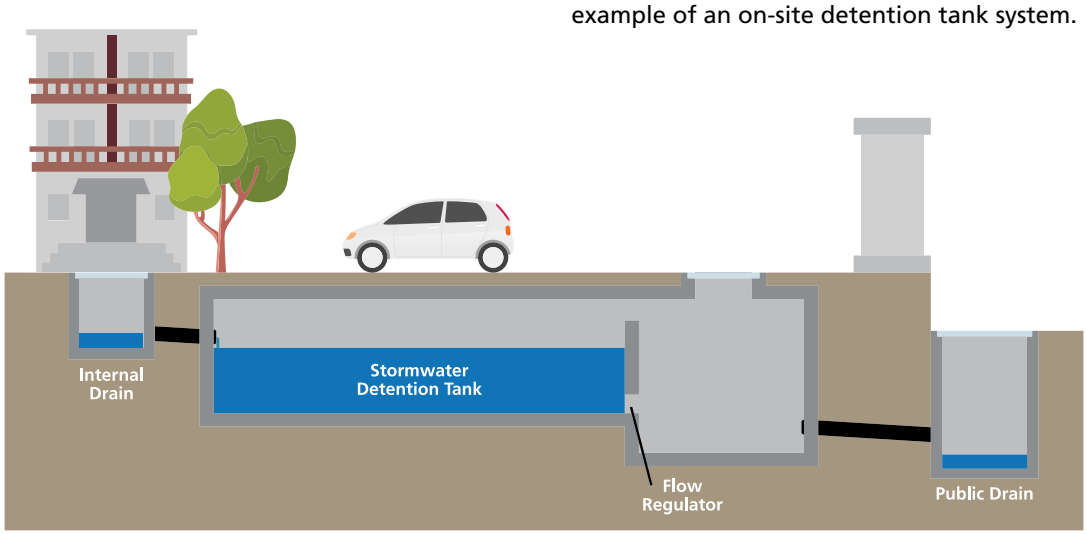

The volume of the detention tank is then emptied within 4 hours after a storm event. The maximum allowable peak runoff to be discharged to public drains and the required detention volume are stipulated in the Technical Guide for On-site Storm water Detention Tank Systems which is published on PUB's website.

It is critical that the detention tank serves its intended function, which is to empty its contents within the stipulated 4 hours after a storm event, and not over a longer period of time, so as to cater for sufficient space in the tank for the next rain event. Notwithstanding, it is still possible for the Professional Engineer to design the rainwater harvesting tank system to discharge the harvested rainwater (within the rainwater harvesting chamber) over 24 hours according to required usage. An example of how the rainwater harvesting tank could be designed without compromising the function of the detention tank is shown below. Based on HDB's existing concept, surface runoff flows into the rainwater harvesting tank and excess runoff overflows into the detention tank which will be emptied within 4 hours after a storm event.

### 2.8.2 Air-conditioning condensate reuse

The typical air-conditioning system in a commercial building consists of air-handling units (AHUs) that circulate air to indoor spaces to maintain comfort as part of a heating, ventilating, and air-conditioning (HVAC) system. Fan coil units (FCUs) are smaller modular versions of AHUs. A make-up air unit (MAU) is a type of air handler that conditions only non-recirculated air, i.e. fresh outside air.

Air returning from the indoor space tends to be mixed with fresh outside air to maintain a healthy environment. As the mixture of air passes through the AHU, it goes through a cooling coil where its temperature drops. Humidity from both outside and return air is removed as condensate. Condensate is generally collected in internal cooling coil drain pans before they are discharged by gravity to the drain pipes on the outside. They can then be collected and reused at various points-of-use in a building.

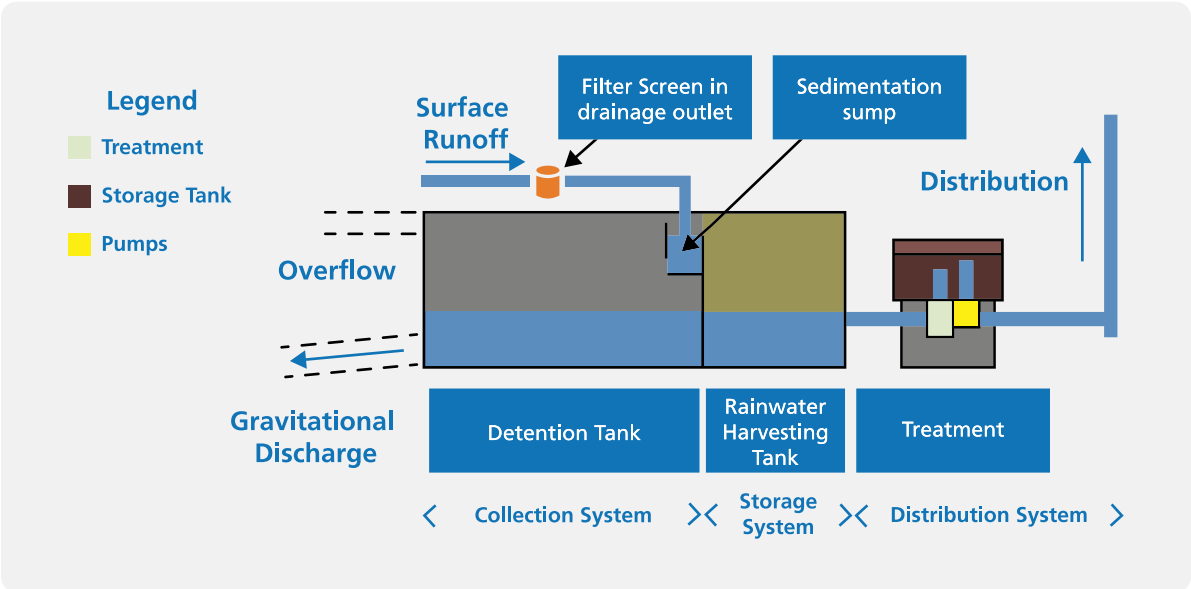


*Patented system of HDB, with Singapore patent no. 10201507989U*
*Please refer to Guidance Note for Rainwater Harvesting System:*
*https://www.pub.gov.sg/-/media/BPD/Guidance-Notes-for-RHS_OCT-2025.pdf*

### Typical condensate recovery and reuse system

Condensate can typically be reused for non-potable areas such as for cooling tower make-up, irrigation, water features, process cooling water and even for toilet flushing. This will help to reduce the demand for potable water or NEWater, which will in turn reduce utility cost. Condensate reused for cooling tower make-up is recommended as condensate water is generally cold with low dissolved mineral content.

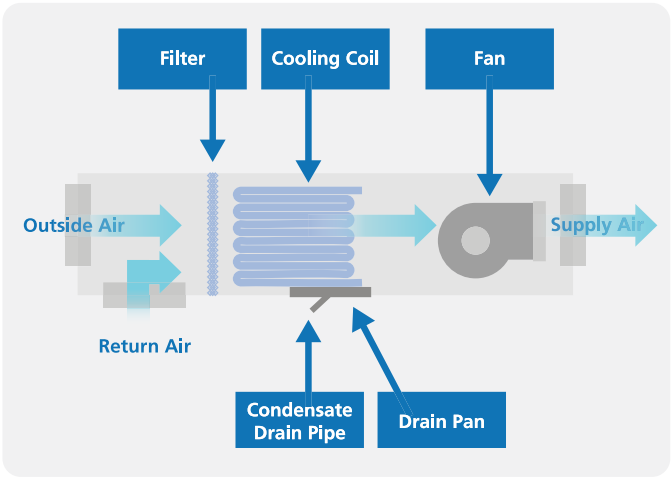


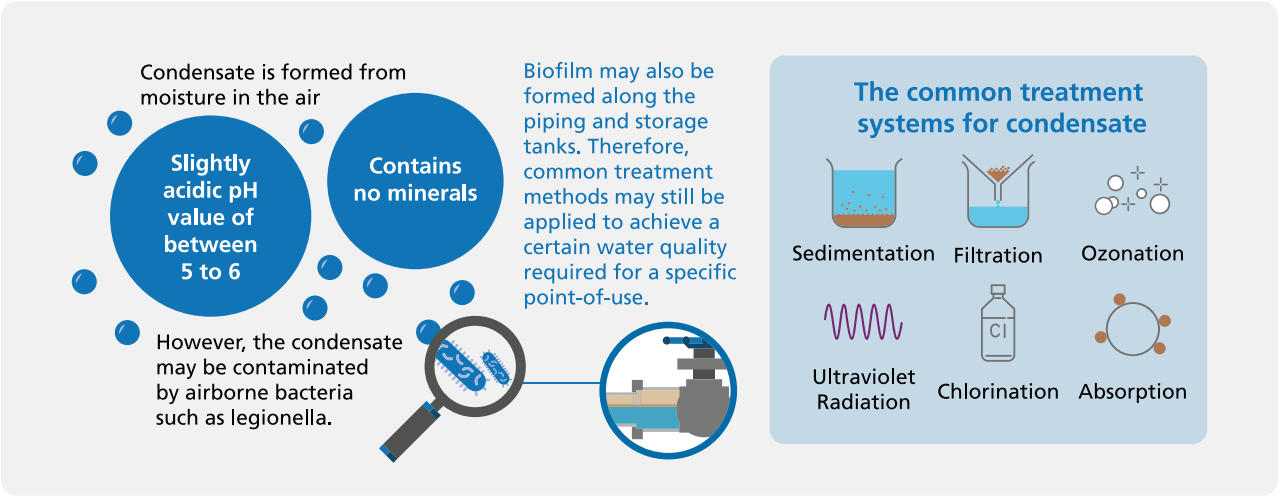


A typical condensate recovery and reuse system consists of drain pipes, pumping lines, a condensate water collection tank and pumps. Depending on condensate water quality and stipulated requirements, appropriate simple treatment systems can also be included.

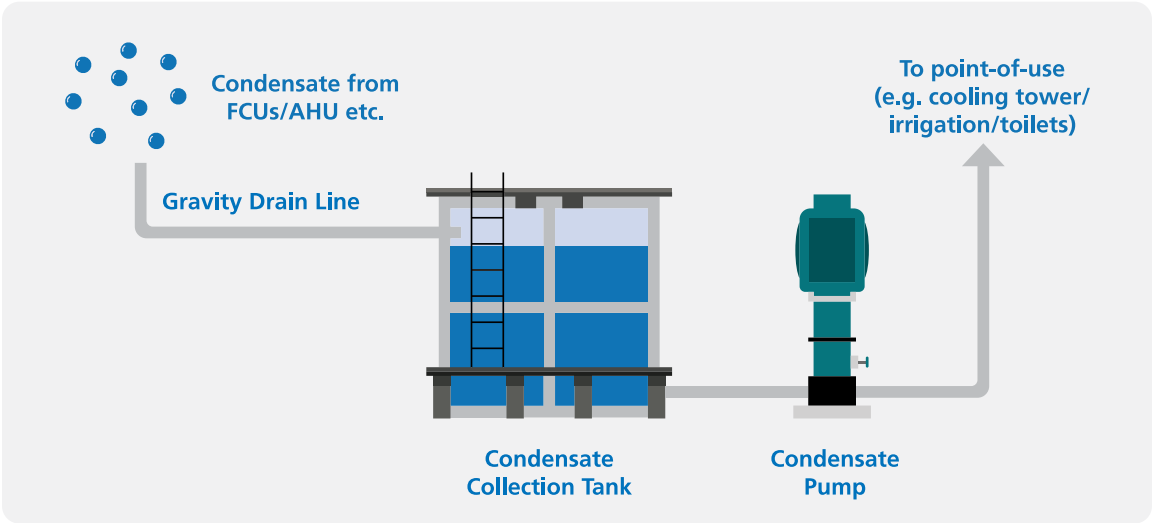

### Factors affecting amount of condensate collection

There are several factors affecting the amount of condensate that can be recovered. These include:

**Amount of fresh air exchange**
As fresh air is more humid than return air, more condensate can be generated by AHUs with larger fresh air exchange proportion.

**Heat load of the building**
Heat load will be affected by the number of occupants and nature of activity. For example, more condensate is expected for AHUs serving restaurants, high human density areas, open spaces and shower areas etc.



**Tonnage of AHU**

**Operating hours and AHU operating capacity**

### Location and ease of condensate collection

It will be easier to recover condensate from AHUs/FCUs located in the same stack where condensate can be collected via the same condensate drain pipe. On the contrary, it will not be cost effective to collect condensate from AHUs/FCUs that are scattered across the building.

In general, retail buildings, hotels and hospitals are able to achieve high rates of condensate collection due to the higher heat load and higher fresh air exchange requirement.

## Best practice guidelines on optimisation of condensate recovery and reuse

Good design guidelines for condensate recovery and reuse system are:

**Minimised equipment (piping/pumping) cost**

It is recommended that the AHUs/FCUs be located along the same vertical stack so that condensate generated can be collected easily via a vertical drain pipe. Alternatively, AHUs/FCUs can be cluster-located in large AHU rooms. These arrangements will help in reducing piping cost.

Points-of-reuse should be centrally located as much as possible to reduce piping cost.

As much as possible, points-of-reuse should not be located too high up the building to minimise pumping and piping cost. For example, cooling towers located at an intermediate plaza would be a better choice as compared to cooling towers located at the rooftop.

**Maximised condensate recovery**

As condensate collection is facilitated by gravity, the condensate water collection tank and associated pumps should be located in close proximity to each other and at the bottom of the vertical condensate collection drain pipe stack. This is to maximise the amount of condensate that can be collected and help to reduce piping cost.

FCU drain pipes should be connected to the same AHU vertical drain pipe so as to maximise condensate collection.

Regular maintenance of AHUs should be carried out to keep cooling coils clean and maintain heat-transfer efficiency.

Vent cowl can be provided at the vertical condensate drain stack to ensure smooth flow of condensate water.

**Reduced maintenance cost**

An optimally sized condensate collection tank should hold a maximum of 1-day storage capacity. This reduces the green footprint and minimises bacterial growth, hence lowering treatment costs.

A good pipe gradient of 1:20 to 1:60 should be adopted in drain pipes so as to avoid slime and bacteria growth.



*An example of AHU condensate reuse at Khoo Teck Puat Hospital*

*Khoo Teck Puat Hospital has implemented AHU condensate reuse for its cooling tower make-up since its opening in 2010. This measure has helped them to save approximately 1,900 m³ of water annually.*

### 2.8.3 Greywater recycling and reuse

Greywater refers to untreated used water which has not come into contact with toilet waste. It includes used water from showers, bathtubs, wash basins and clothes washing. It does not include used water from urinals, toilet water closets, kitchen sinks and dishwashers.

Greywater recycling refers to the use of treated greywater that has gone through treatment such as membrane filtration and disinfection, in compliance with the required water quality suitable for its specific use.

Treated greywater shall only be used for the following applications:

- Flushing of water closet (WC)/urinal
- General washing (excluding high-pressure jet washing and general washing at markets and food establishments)
- Irrigation (excluding irrigation sprinklers)
- Cooling tower make-up water

#### Design, treatment and disinfection

Greywater collection pipework shall be designed, sized and installed in accordance with the Code of Practice on Sewerage and Sanitary Works. Pipes and fittings of equal material, quality and construction for sanitary plumbing system shall be used. They should also be prominently labelled.

A greywater treatment system typically consists of biological and filtration (microfiltration/ ultrafiltration or other membrane filtration) steps as well as disinfection processes. A chlorine dosing facility shall also be provided at the treated greywater storage and supply tank for final disinfection to ensure that the supplied water is sterile with residual chlorine maintained throughout the storage period.

If treated greywater is to be reused at the WC flushing cisterns/urinals, a colouring dye dispenser device shall be provided to inject blue dye to the treated greywater so that users are aware that the water is non-potable. The blue colour also reduces the risk of cross-connections and the possibility of greywater being used for inappropriate purposes. A safe and environmental-friendly food-grade dye shall be used.

Raw/untreated greywater shall be stored temporarily in a tank for less than 24 hours. It is also recommended for storage of treated greywater to be limited to 24 hours. All storage tanks should be cleaned at least once annually. All storage tanks shall also be mosquito-proof in accordance with NEA's Guidelines on Mosquito prevention in domestic rainwater collection system for non-potable uses.

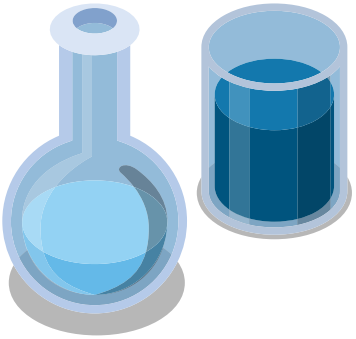

Back-up supply of PUB-supplied water (potable water/NEWater) shall be made available to the treated greywater supply tank to ensure that there will be no disruption of water supply to the water end use area in the event of power failure, overflow, equipment failure or maintenance shutdown. The back-up water supply shall be fitted with a backflow prevention mechanism capable of preventing backflow of non-potable treated greywater to the potable water or NEWater mains. Suitable overflow and bypass pipes shall also be fitted to all storage tanks to allow excess greywater to be discharged into the sewage.

### Water quality and sampling requirements

The treated greywater is required to meet the treated greywater quality requirements as per the table below.

The minimum sampling and monitoring regime for the treated greywater quality shall also be strictly adhered to.

| Parameters | Unit | Requirements for treated greywater quality for recycling | Applicable to |
|---|---|---|---|
| Odour | | Non offensive | Toilet flushing, general washing*, irrigation* and cooling tower makeup |
| Colour | Hazen Units | < 15 | |
| pH | | 6 - 9 | |
| Total Residue Chorine | mg/l | 0.5 - 2.0 | |
| Turbidity | NTU | < 2 | |
| $BOD_5$ | mg/l | < 5 | |
| Total Coliform | CFU/100ml | < 10 | |
| *E Coli* | CFU/100ml | N.D. | |
| Standard Plate Count/Heterotrophic Plate Count (SPC/HPC) | | < 500 CFU/ml | cooling tower makeup only |
| Total *Legionella* count | | Non-detectable when tested using the latest ISO 11731, BS6068-4.12, or equivalent method that is able to test total *Legionella* count at or below 1000 CFU/L | cooling tower makeup only |

*Requirements for treated greywater quality for recycling*

| Parameters | Toilet flushing, general washing, irrigation | Cooling Towers |
|---|---|---|
| Odour | Non offensive at all times | Non offensive at all times |
| Colour | Monthly | Monthly |
| pH | Monthly | Continuous online |
| Total Residue Chorine | Continuous online | Continuous online |
| Turbidity | Monthly | Continuous online |
| $BOD_5$ | Quarterly | Quarterly |
| Total Coliform | Monthly | Monthly |
| *E Coli* | Monthly | Monthly |
| SPC/HPC | N.A. | Monthly |
| Total *Legionella* count | N.A. | Quarterly |

*Minimum sampling regime and monitoring frequency for treated greywater*

Note:

(a) Necessary sampling points (minimally at the treated greywater tank outlet) shall be installed so that sampling can be carried out at the above-mentioned frequency.

(b) The testing of water samples shall be done by Singapore Accreditation Council (SAC)-SINGLAS accredited laboratories qualified to conduct general water quality testing.

For additional information, please refer to the following links:

(a) Guidance Notes for Treated Greywater Quality: https://www.pub.gov.sg/-/media/PUB/PDF/greywaterRequirements.pdf

(b) Technical Guide for Greywater Recycling System: https://www.pub.gov.sg/-/media/PUB/PDF/greywaterTech.pdf

## 2.9 Adopt water efficiency management systems (SS ISO 46001)

Achieving sound water efficiency performance requires organisational commitment to a systematic approach towards continual improvement of a water efficiency management system (WEMS).

The Singapore Standard SS ISO 46001: Water Efficiency Management System adopts a Plan-Do-Check-Act (PDCA) continual improvement framework, to enable organisations to assess and account for their water usage, and to identify, plan and implement measures to achieve water savings through the systematic management of water within the building.

SS ISO 46001 can be used by organisations of all types and sizes, to implement a water efficiency management policy and establish objectives, targets and action plans for their water usage. It can also be implemented independently or integrated with other management systems and standards.

**Plan-Do-Check-Act (PDCA) continual improvement framework**

- Set policy and objectives.
- Identify business activity indicators.
- Identify legal and other requirements for compliance.
- Conduct water usage review.
- Establish baseline water efficiency indices, targets and action plans.

- Implement the water efficiency management action plans.

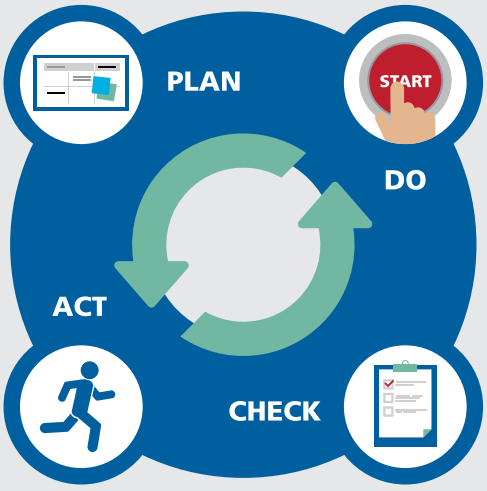


- Monitor and measure the key characteristics of operations that determine water efficiency against water management policy, objectives, legal and other requirements.
- Report the results.

- Take actions to continually improve water efficiency and the WEMS.

## 2.10 Water conservation efforts during dry weather

Singapore experiences dry spells in certain months of a year. A dry spell is defined as a period of at least 15 consecutive days where daily rainfall totals less than 1mm in many parts of the island. Reservoir stock levels are impacted during drier weather and times of lesser rainfall. In response, PUB usually ramps up the production of NEWater and desalinated water to maintain reservoir stock and to ensure our nation's water availability.

PUB urges communities and businesses to continue with their water conservation efforts, and encourage premises to embark on further measures during the dry spell to help stretch our nation's water resources.

Further measures can be taken. These include, but are not limited to, the following:



Check for leaks and stop them promptly

- Take water meter readings more regularly
- Check if the counter water meter is moving during off peak periods when there is no consumption



Stop or restrict vehicle washing



Stop unnecessary watering of plants & turf



Convert urinals to the waterless type by shutting water supply to urinals and using waterless products



Avoid new plantings



Postpone facade cleaning until after the dry weather and reduce frequency of floor washing



Stop the use of high-pressure jets and hoses for washing activities; use mops instead



Reduce the operating hours of water-cooled air conditioning systems (e.g. start up the air conditioning system 30 min later and shut down the air conditioning system 30 min earlier compared to usual practices)



- Stop running water features, fountains, water play areas and cascades
- Stop outdoor misting fans

# Case Studies

Case Study 1

## Office building case study

As one of Singapore's largest commercial developments outside the CBD, The Metropolis adopts a holistic approach to water efficiency through a combination of water recycling, smart technologies, and water-efficient infrastructure.

Rainwater harvested on-site is collected for landscape irrigation, and NEWater is used for top-up during the dry season instead of potable water. The irrigation system is equipped with rain sensors that automatically suspend irrigation during rainfall to avoid unnecessary water use.



*Ho Bee (One-North) Pte Ltd (The Metropolis)*

Condensate water from the air-conditioning systems is collected and recycled for non-potable use, with the recycled water metered and closely monitored. Together with the use of NEWater as make-up water for the cooling towers, these initiatives reduce the development's reliance on potable water.

Underpinning these efforts, smart water meters provide continuous monitoring of water consumption and facilitate timely detection of anomalies. The Metropolis is also a certified Water Efficient Building, further reflecting its broader commitment to responsible water use.

Case Study 2

## Office building case study



*Keppel Bay Tower*

Keppel Bay Tower, a Grade A commercial office building in Singapore owned by Keppel REIT, has implemented an advanced cooling tower water management system to improve water efficiency.

The system uses a patented electro-chemical process to minimise the build-up of scale-forming minerals and suspended solids within the cooling tower, allowing the building to operate at higher cycles of concentration. This reduces the frequency and volume of blowdown, lowers make-up water demand, and eliminates the need for routine chemical dosing.

The system was installed without any modifications to existing pipework or disruption to building operations. Following implementation, Keppel Bay Tower achieved an approximately 80% reduction in cooling tower blowdown, with annual water savings of around 7,000 m³. Legionella and bacterial counts have been maintained within NEA limits throughout, demonstrating that chemical-free water treatment can be adopted without compromising water quality or system reliability.

Case Study 3

## Retail mall case study

Water is managed with care and intention at Parkway Parade (MCST 1008) - managed by Lendlease Retail Pte. Ltd. Harvested rainwater is put to good use, serving both landscape irrigation and toilet flushing to reduce demand on PUB water supply. Consumption is kept in check through smart water metering, which provides visibility over usage patterns and supports ongoing efforts to improve efficiency.



*The Management Corporation Strata Title 1008 - Parkway Parade*

Parkway Parade's approach to water management is well-recognised, having achieved both the Water Efficient Building certification and ISO 46001 certification, it stands as a development that treats water not as a convenience, but as a resource worth protecting.

Case Study 4

## Hospital case study

As one of Singapore's public hospitals and part of the National University Health System (NUHS), Ng Teng Fong General Hospital (NTFGH) has implemented a reverse osmosis (RO) reject water harvesting initiative for its kidney dialysis unit. The existing RO system, used in the dialysis process, produces reject water that was previously discharged as wastewater. By channelling this clean reject water into an irrigation water tank, the hospital now repurposes it to irrigate its greenery — turning what was once waste into something useful. Approximately 25 $m^3$ of water are recovered daily, equivalent to about 9,000 $m^3$ of water savings annually. As one of the pioneering initiatives of its kind in Singapore's healthcare sector, this demonstrates strong potential for replication across hospitals and dialysis facilities, contributing towards more sustainable water management.



*Ng Teng Fong General Hospital (NTFGH)*

Case Study 5

## Hotel case study

Marina Bay Sands, one of Singapore's Integrated Resorts, has put in place several initiatives that reflect a serious commitment to water conservation. A condensate water recovery system captures condensate from the air-conditioning systems of its three hotel towers, redirecting it to supplement the water features and landscape irrigation. More than seven years on, the system has demonstrated sustained water savings of approximately 2,200 m³ per month. Harvested rainwater adds another layer to this effort, channelled for toilet flushing to reduce demand on PUB water supply. Keeping watch over it all is a smart metering system that monitors consumption across the development, flagging irregularities and enabling the management team to respond swiftly to leaks and anomalies.



*Condensate collection tank*



*Marina Bay Sands Pte. Ltd.*

Case Study 6

## School case study

Mee Toh School adopts a whole-school approach to water conservation, embedding sustainability across the Campus, Curriculum, Community and Culture. Guided by the school values of Care and Responsibility, students and staff share a collective commitment to safeguarding Singapore's scarce water resource through sustainable practices, authentic learning and community partnerships.




*Mee Toh School*

The school's Water Efficiency Management Team (WEMT) manages the campus by installing sensors at taps and water coolers to minimise water wastage, while conducting daily water meter checks and regular audits to ensure early detection of leaks and the efficient use of water. There is also a rainwater harvesting system that collects rainwater for cleaning, watering plants and supporting student projects, and this helps to reduce the reliance on potable water.

Water sustainability is embedded in the school's curriculum through Science and Social Studies and lived experiences such as water rationing exercises during the World Water Day to enable students to appreciate the value of water. Beyond the school, students extend their learning through the Friends of Water programme at Lorong Halus, gaining first-hand appreciation of Singapore's waterways and ecosystems. At Primary 5, students use the Design Thinking methodology in their Interdisciplinary Project Work and Values-in-Action, to investigate real-world water challenges, develop innovative prototypes and advocate for water conservation to their peers and preschoolers through the various community outreach platforms. The school also incorporates key messages in its communications to parents and families to engender community awareness and efforts to save water.

Leading the school's culture, student leaders known as the Environment Champions, organise World Water Day activities, lead water conservation pledges and develop innovative solutions, including devices that harness harvested rainwater to clean recyclables for recycling efforts. Through these sustained efforts, Mee Toh School hopes to nurture environmentally responsible citizens who recognise that every drop of water counts.

# 04 Water Saving Practices Checklist

| General operations | Yes | No | N.A |
|---|---|---|---|
| Record and monitor the bulk meter readings regularly (daily or weekly) to identify any abnormal increase in water consumption due to leakage. Alternatively, an automatic monitoring system (e.g. Building Management System) can be used. | | | |
| Install a private meter at different water use areas such as toilets/pantries, cooling towers, water features, irrigation sites, swimming pools and more. Record and monitor the readings regularly to monitor the performance of the system and identify possible leakage for prompt rectification. | | | |
| Conduct regular (daily or weekly) inspections of the water reticulation system and water fittings to identify leaks and repair them immediately. | | | |
| Conduct a water audit to identify ways to reduce, replace (use alternative water sources) or recycle water used within the premises. | | | |
| Management spearheads water conservation efforts. | | | |
| Form a committee/team to coordinate and oversee water conservation initiatives. Review them regularly. Appoint someone responsible for water efficiency and encourage them to liaise with PUB officers on matters pertaining to water conservation. | | | |
| Educate workers/employees on the need to conserve water through pre-work briefings, talks, discussions, publicity materials, etc. | | | |
| Engage all employees to come up with new water conservation ideas and reward them accordingly. | | | |

# 04 Water Saving Practices Checklist

| Toilets | Yes | No | N.A |
|---|---|---|---|
| Adopt 3-tick WELS labelled taps, showers, urinal flush valves, WC flush valves and dual flush low-capacity flushing cisterns (LCFCs). | | | |
| Adopt waterless urinals. | | | |
| Remove ball valves' handles to prevent any tampering of flow rates. | | | |
| Lock all common bib taps to avoid misuse. | | | |
| Display contact numbers for public to call should they come across any water leakage or faulty fittings or assign cleaners to individual toilets to take responsibility. | | | |

# 04 Water Saving Practices Checklist

| Cooling towers | Yes | No | N.A |
|---|---|---|---|
| Installation of an economy cycle system to reduce cooling loads when outside air conditions are favorable. | | | |
| Use of a hybrid type air-conditioning system which utilises natural ventilation via windows whenever outside air conditions are favorable. | | | |
| Use heat recovery systems to reduce cooling loads of cooling towers. The heat recovered can be used for applications such as heating of water for domestic purposes, i.e. producing hot water and heating of coils. | | | |
| Use alternative water sources as make-up water for cooling tower. | | | |
| Install water meters on make-up and blowdown lines to monitor water consumption. | | | |
| Install side-stream water filters. Suspended solids can be removed to maintain cleaner cooling water within the system. | | | |
| Install variable speed drive fans which can match fan speed to actual cooling load. | | | |
| Ensure the float valve on the make-up line can close properly to prevent uncontrolled inflow. | | | |

# 04 Water Saving Practices Checklist

| Cooling towers | Yes | No | N.A |
|---|---|---|---|
| Ensure the overflow pipe is installed at the correct level and is not leaking. | | | |
| Ensure that tower water distribution piping is not oversized or too long. | | | |
| Ensure that the operating water levels in multiple tower/cold water basins are equal. | | | |
| Replace ball float valves with solenoid valves that are controlled by electronic level sensors. | | | |
| Install anti-splash louvres on the tower air intakes and ensure they are installed correctly and are not damaged. | | | |
| Install a splash deck above the cold water basin. | | | |
| Ensure that the fan speed and air flow rates are within manufacturers' limits. | | | |
| Operate at COC of minimum 7 and 10 for cooling towers using potable water and NEWater respectively. | | | |

# 04 Water Saving Practices Checklist

| Cooling towers | Yes | No | N.A |
|---|---|---|---|
| Both volume and conductivity of make-up and blowdown water should be monitored, logged and charted. | | | |
| Clean the conductivity sensor on a monthly basis and re-calibrate it at least once every 6 months. | | | |
| Conduct regular inspections to monitor whether there is any leakage at the cooling tower, especially at pipe connections, pipe joints and pumps. | | | |
| Carry out routine maintenance work in a timely manner. | | | |
| Examine monthly routine maintenance reports provided by the respective maintenance contractors, identifying opportunities to minimise water usage and eliminate water wastage. | | | |
| Ensure follow-up actions are taken and documented in the maintenance reports. | | | |
| Require the water treatment contractors to commit to a pre-determined minimum level of water usage and make this a key performance indicator. | | | |

# 04 Water Saving Practices Checklist

| Irrigation | Yes | No | N.A |
|---|---|---|---|
| Irrigate or water plants only when necessary and do so in the early morning or late evening (i.e. between 6pm to 7am) to minimise evaporation loss. | | | |
| For newly installed landscape, plants should be grouped together into hydro-zones based on similar watering needs. A zoned irrigation system should be designed to match the water requirements of different zones. | | | |
| Water the plants with a watering can instead of a running hose. If a hose is used, a flow control device shall be attached to the hose. | | | |
| If an automated irrigation system is used, incorporate a rain sensor and soil moisture sensor that will automatically turn off during rainy days or when the soil is still moist. | | | |
| Adopt an efficient irrigation system by choosing the right nozzle design and technologies. | | | |

# 04 Water Saving Practices Checklist

| General washing | Yes | No | N.A |
|---|---|---|---|
| Use WELS-labelled water-efficient pressure washer or mops, instead of hoses, wherever possible. Open-end hose without a controlled device attached is prohibited. | | | |
| Review the schedule for general washing and cleaning frequently. For areas of low use, the frequency of general washing may be reduced. | | | |
| Use non-potable sources of water such as NEWater and recycled water (e.g. rainwater, AHU condensate) for general washing. | | | |
| Check and adjust nozzle spray patterns for hoses accordingly, in order to optimise application of spray. | | | |
| Floor mats may be used to minimise the spreading of dirt throughout the building. | | | |
| Ensure that cleaning staff are supervised and educated on water saving cleaning practices. | | | |

# 04 Water Saving Practices Checklist

| Recycling/replacing with an alternative source of water, wherever possible | Yes | No | N.A |
|---|---|---|---|
| Install an AHU condensate recovery system to meet non-potable water demand. | | | |
| Install a water recycling system (e.g. greywater) to reclaim water for reuse for non-potable purposes such as toilet flushing, irrigation and cooling tower make-up water. | | | |
| Harvest rainwater for other non-potable purposes. | | | |

# 04 Water Saving Practices Checklist

| Guestrooms | Yes | No | N.A |
|---|---|---|---|
| Install a private meter at the riser connected to the guestrooms to monitor water consumption. | | | |
| Install 3-tick WELS rated taps, showers and LCFCs. | | | |
| Check for overflow/leak in toilet cisterns. | | | |
| Do not use the toilet's water closet suite as a trash basket. | | | |
| Encourage guests to reuse the towels or linen whenever possible. | | | |

# 04 Water Saving Practices Checklist

| Laundry | Yes | No | N.A |
|---|---|---|---|
| Install a private meter to monitor water consumption. | | | |
| Use a 4-tick WELS rated washing machine. | | | |
| Operate washing machines only when fully loaded. | | | |
| Recycle the final rinse water for pre-wash in the next load. | | | |
| Turn off and isolate the steam supply to equipment when not in use. | | | |
| Carry out regular maintenance to ensure water valves and dump drains are free from leaks. | | | |

# 04 Water Saving Practices Checklist

| Swimming pool | Yes | No | N.A |
|---|---|---|---|
| Install private meter at make-up water inlet of swimming pool balancing tank to monitor and track water consumption for leak control management. | | | |
| Carry out manual cleaning/use a skimmer regularly to reduce filter load. | | | |
| Conduct regular leak tests such as bucket test and pressure test to determine the source of the leak. If a leak is detected, stop all water supply to the balancing tanks and engage contractor to repair the leak immediately. | | | |
| Lay pipe within a channel for ease of maintenance and leak detection. | | | |
| At the design phase, where possible, site the swimming pool at a suitable location which has minimal direct sunlight and lesser wind speed. Alternatively, use a pool cover to reduce evaporation loss. | | | |
| Adopt the appropriate backwash frequency as determined by pressure differential (head loss) with reference to the manufacturer's guidelines. | | | |
| Backwash duration should be determined by observing the sight glass for clarity instead of a fixed duration. | | | |

# 04 Water Saving Practices Checklist

| Swimming pool | Yes | No | N.A |
|---|---|---|---|
| All make-up water control valves should be designed with protective baffles such as wave chambers to prevent turbulence from affecting control valves, resulting in unnecessary topping up of water. Alternatively, swimming pool water to be recirculated back to the balancing tank should be channelled to the base of the tank. | | | |
| Use of pilot valves or solenoid valves at balancing tank to allow the settings of the different water levels to cater for the various buffer volume for capturing of rain water and bather displacement. | | | |

# 04 Water Saving Practices Checklist

| Kitchen/Cooking area/Pantry | Yes | No | N.A |
|---|---|---|---|
| Install a 3-tick WELS rated sink tap. | | | |
| Wash dishes with a low flow rinser or in a filled sink instead of under running taps. | | | |
| Soak utensils and dishes in a basin of water before cleaning for easy removal of food residues. | | | |
| Use pressure sprays to pre-rinse the dishes effectively and reduce water consumption. | | | |
| Use a suitable detergent and avoid excessive use of it. | | | |
| Turn off the dishwasher when not in use. Run dishwashers at full load. | | | |
| Recycle rinse water from dishwashers to wash away food residue on dishes. | | | |
| For manual dishwashing, have 3 compartment washing basins for soaking, washing and rinsing separately to reduce water use and enable easy recycling of rinse water. | | | |

# 04 Water Saving Practices Checklist

| Kitchen/Cooking area/Pantry | Yes | No | N.A |
|---|---|---|---|
| Do not defrost food or wash vegetables under running taps. Defrost in the refrigerator, or install an air pump to the defrosting sink, to speed up the defrosting process. | | | |
| Retrofit existing water-cooled wok stoves to air-cooled wok stoves. | | | |
| Install a private meter to monitor washing activities. | | | |

# SUPPORT AND RESOURCES

PUB provides funding and technical support as part of PUB's effort to encourage companies to explore ways to improve water efficiency.

For information on funding available from PUB including Water Efficiency Fund, please refer to PUB's website at https://www.pub.gov.sg/Public/WaterLoop/Water-Conservation/Water-Efficiency-Fund

PUB SINGAPORE'S NATIONAL WATER AGENCY

40 Scotts Road, #22-01
Environment Building, Singapore 228231

MAKE EVERY DROP COUNT