


150mm DIA. VENTILATING STACKS TO TERMINATE IN OPEN AIR. THE VENTILATING STACK SHALL BE OFFSET TO TERMINATE IN A LOCATION AWAY FROM PRIVATE PREMISES AND IT SHALL BE TERMINATED AT SUCH A HEIGHT AND LOCATION THAT WILL NOT CAUSE A SMELL NUISANCE OR HEALTH HAZARD TO THE OCCUPANTS. (SEE CLAUSE 3.2.3.4G):  
RECOMMENDED MINIMUM HEIGHT :

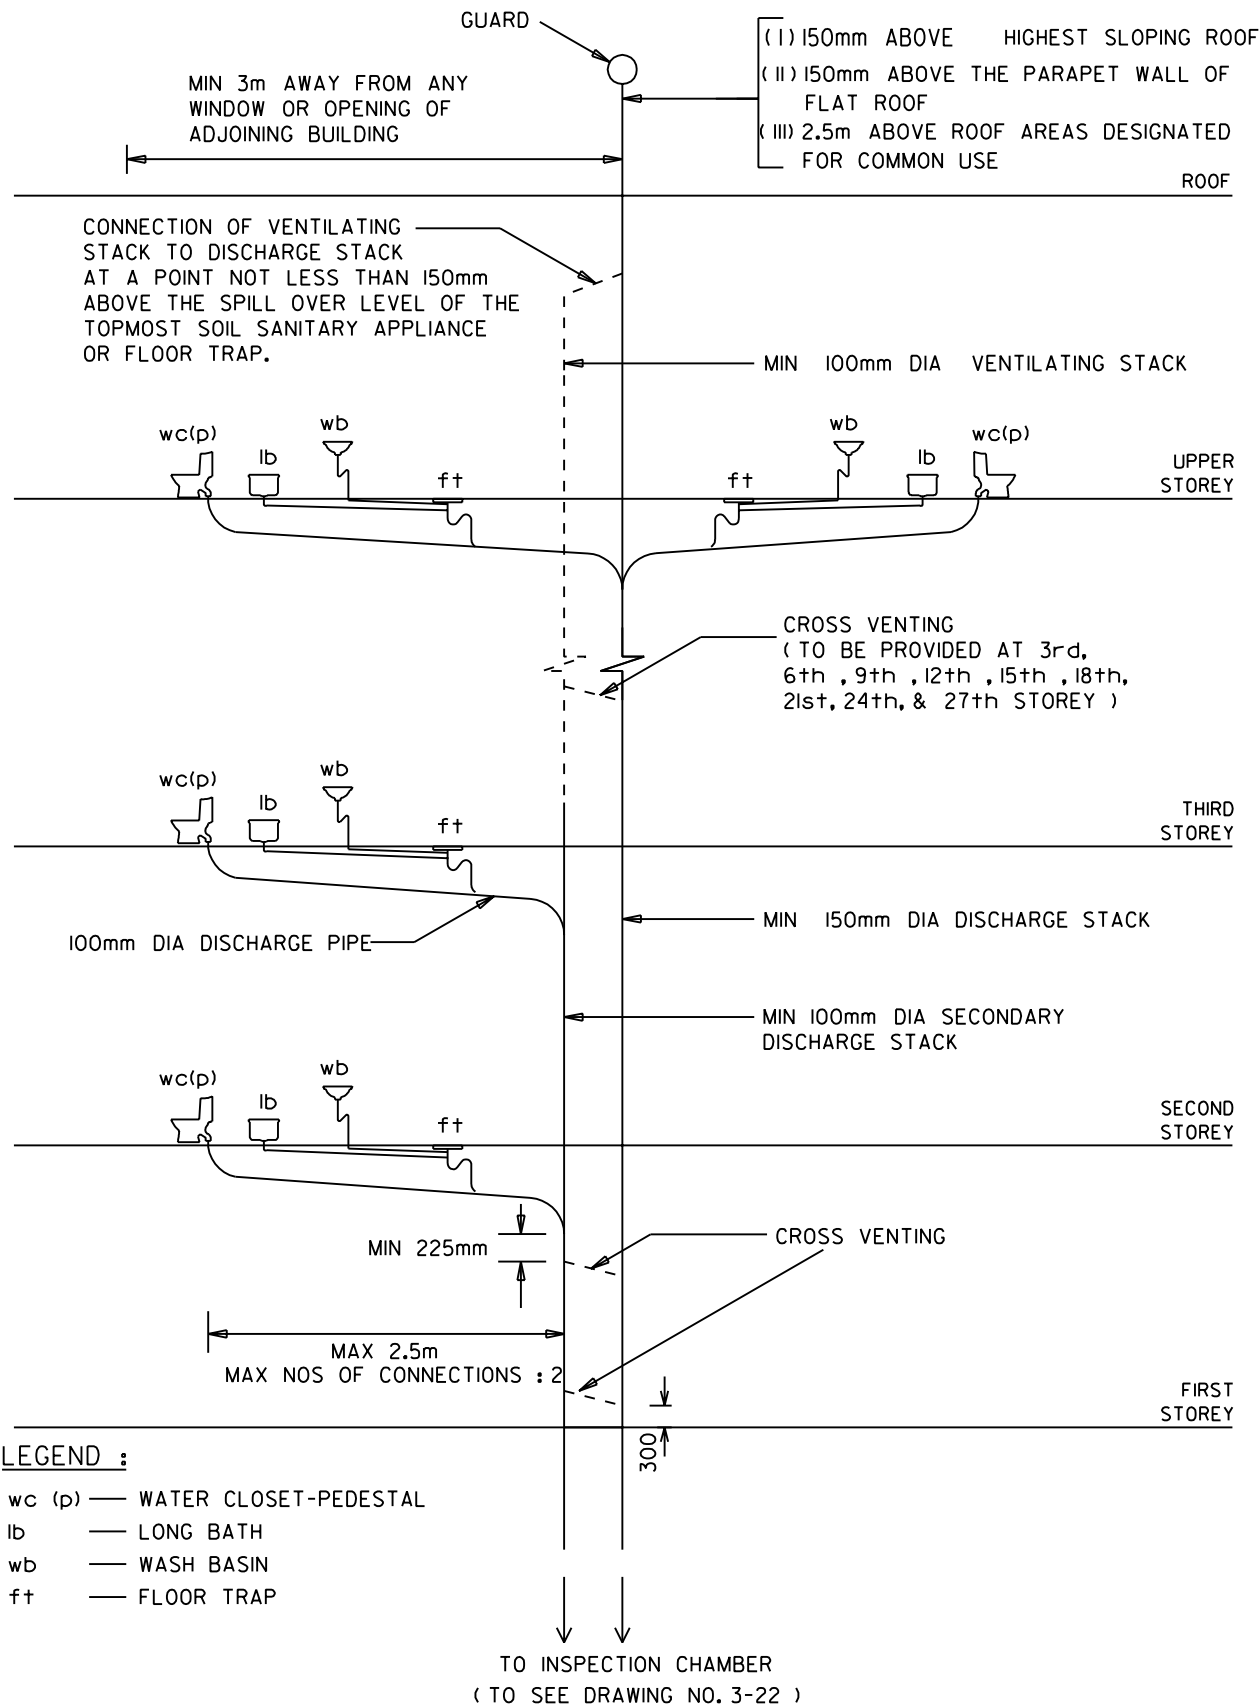

- LEGEND :**
- wc (p) — WATER CLOSET-PEDESTAL
  - lb — LONG BATH
  - wb — WASH BASIN
  - ft — FLOOR TRAP

VENTILATED STACK SYSTEM FOR BUILDINGS UP TO THIRTY STOREYS