


TUMBLING BAY CONNECTION

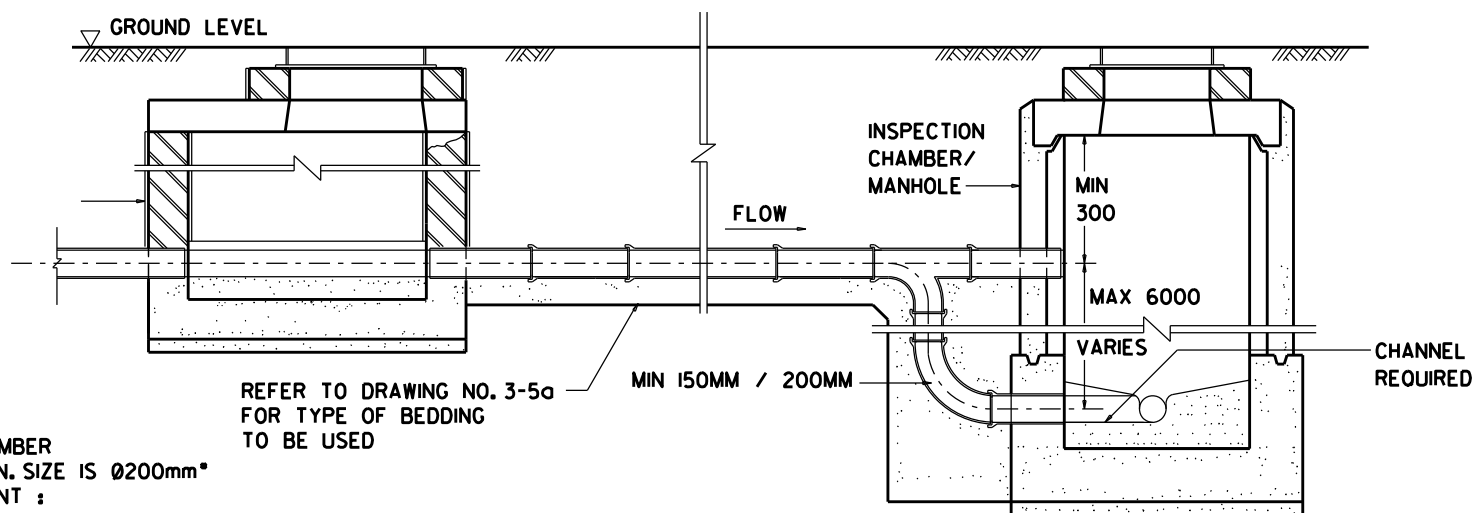

BACKDROP CONNECTION

**NOTES :**

1. NO uPVC PIPE IS TO BE USED FOR SEWER CONNECTION BETWEEN LAST INSPECTION CHAMBER AND MANHOLE AND MIN. SIZE IS Ø200mm\*
2. RECOMMENDED GRADIENT : SEE DRAWING NO. 3-1b

ALL DIMENSIONS ARE IN mm.

**BACKDROP AND TUMBLING BAY DETAILS**