



FIRST STOREY LEVEL
LAYOUT OF DRAINLINES FOR MARKET


- NOTES :**
- (1) FINISHED LEVEL OF INSPECTION CHAMBER AND GULLY SUMP TO BE LOWER THAN THE FLOOR LEVEL OF THE MARKET
 - (2) THE DISCHARGE PIPE FROM THE FLOOR SUMPS SHOULD BE CONNECTED TO A GULLY SUMP BEFORE THE INSPECTION CHAMBER.
 - (3) THE GRADIENT FOR DISCHARGE PIPE FOR FLOOR SUMP TO WASTE SUMP AND WASTE SUMP TO INSPECTION CHAMBER SHOULD BE BETWEEN 1: 70 TO 1: 90

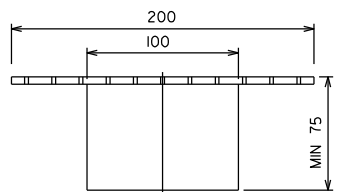

SCUPPER DRAIN (ELEVATION)

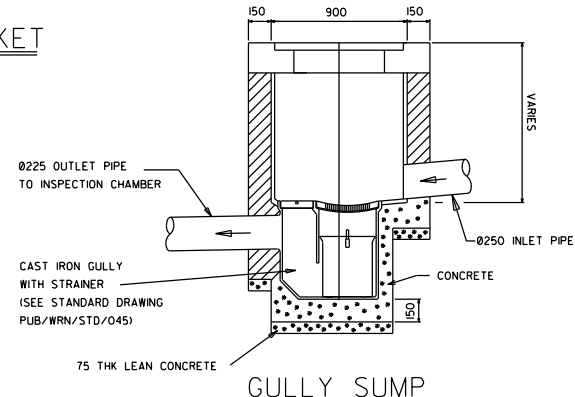

GULLY SUMP

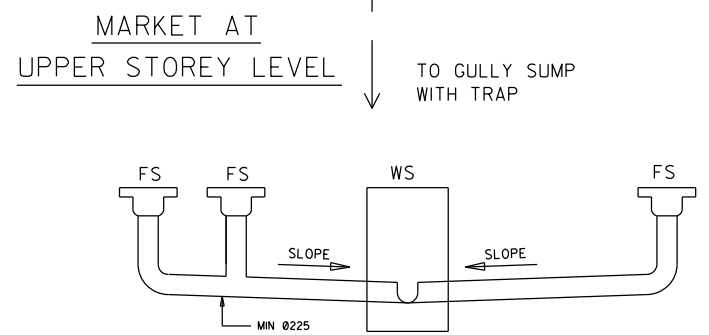

ELEVATION A - A

- LEGEND :**
- FS - FLOOR SUMP
 - IC - INSPECTION CHAMBER
 - WS - WASTE SUMP (600 X 600 INTERNAL)

ALL DIMENSIONS ARE IN MM

ISSUED : MAR 2000	SCALES
REVIEWED : JAN 2019	NOT TO SCALE

SANITARY PLUMBING AND DRAINAGE SYSTEM FOR MARKET