


TERMINATE ABOVE THE ROOF OR CONNECT TO A NEARBY VENTILATING STACK


MAY BE REDUCED TO 100mm DIA. TO SERVE ONLY AS A VENTILATORY STACK (NOT TAKING ANYMORE FLOW)

- NOTES :**
- (1) FINISHED LEVEL OF INSPECTION CHAMBER AND GULLY SUMP TO BE LOWER THAN THE FLOOR LEVEL OF THE MARKET
  - (2) THE DISCHARGE PIPE FROM THE FLOOR SUMPS SHOULD BE CONNECTED TO A GULLY SUMP BEFORE THE INSPECTION CHAMBER.
  - (3) THE GRADIENT FOR DISCHARGE PIPE FOR FLOOR SUMP TO WASTE SUMP AND WASTE SUMP TO INSPECTION CHAMBER SHOULD BE BETWEEN 1: 70 TO 1: 90

**LAYOUT OF DRAINLINES FOR MARKET**

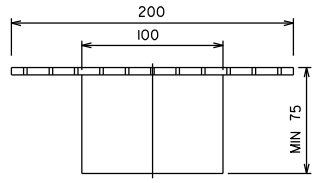


**SCUPPER DRAIN (ELEVATION)**

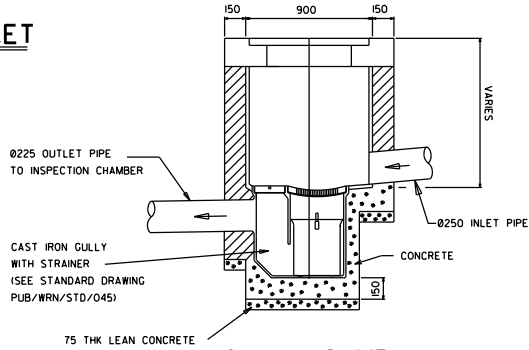

**GULLY SUMP**

**MARKET AT UPPER STOREY LEVEL**

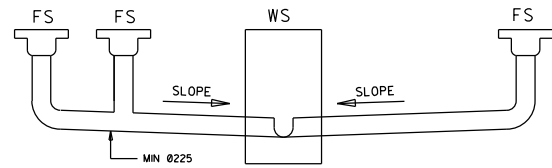

**ELEVATION A - A**

- LEGEND :**
- FS - FLOOR SUMP
  - IC - INSPECTION CHAMBER
  - WS - WASTE SUMP (600 X 600 INTERNAL)

ALL DIMENSIONS ARE IN MM

**SANITARY PLUMBING AND DRAINAGE SYSTEM FOR MARKET**