


100mm DIA. VENTILATING STACKS TO TERMINATE IN OPEN AIR.
 (REFER TO CLAUSE 4.3.6)
 RECOMMENDED MINIMUM HEIGHT :

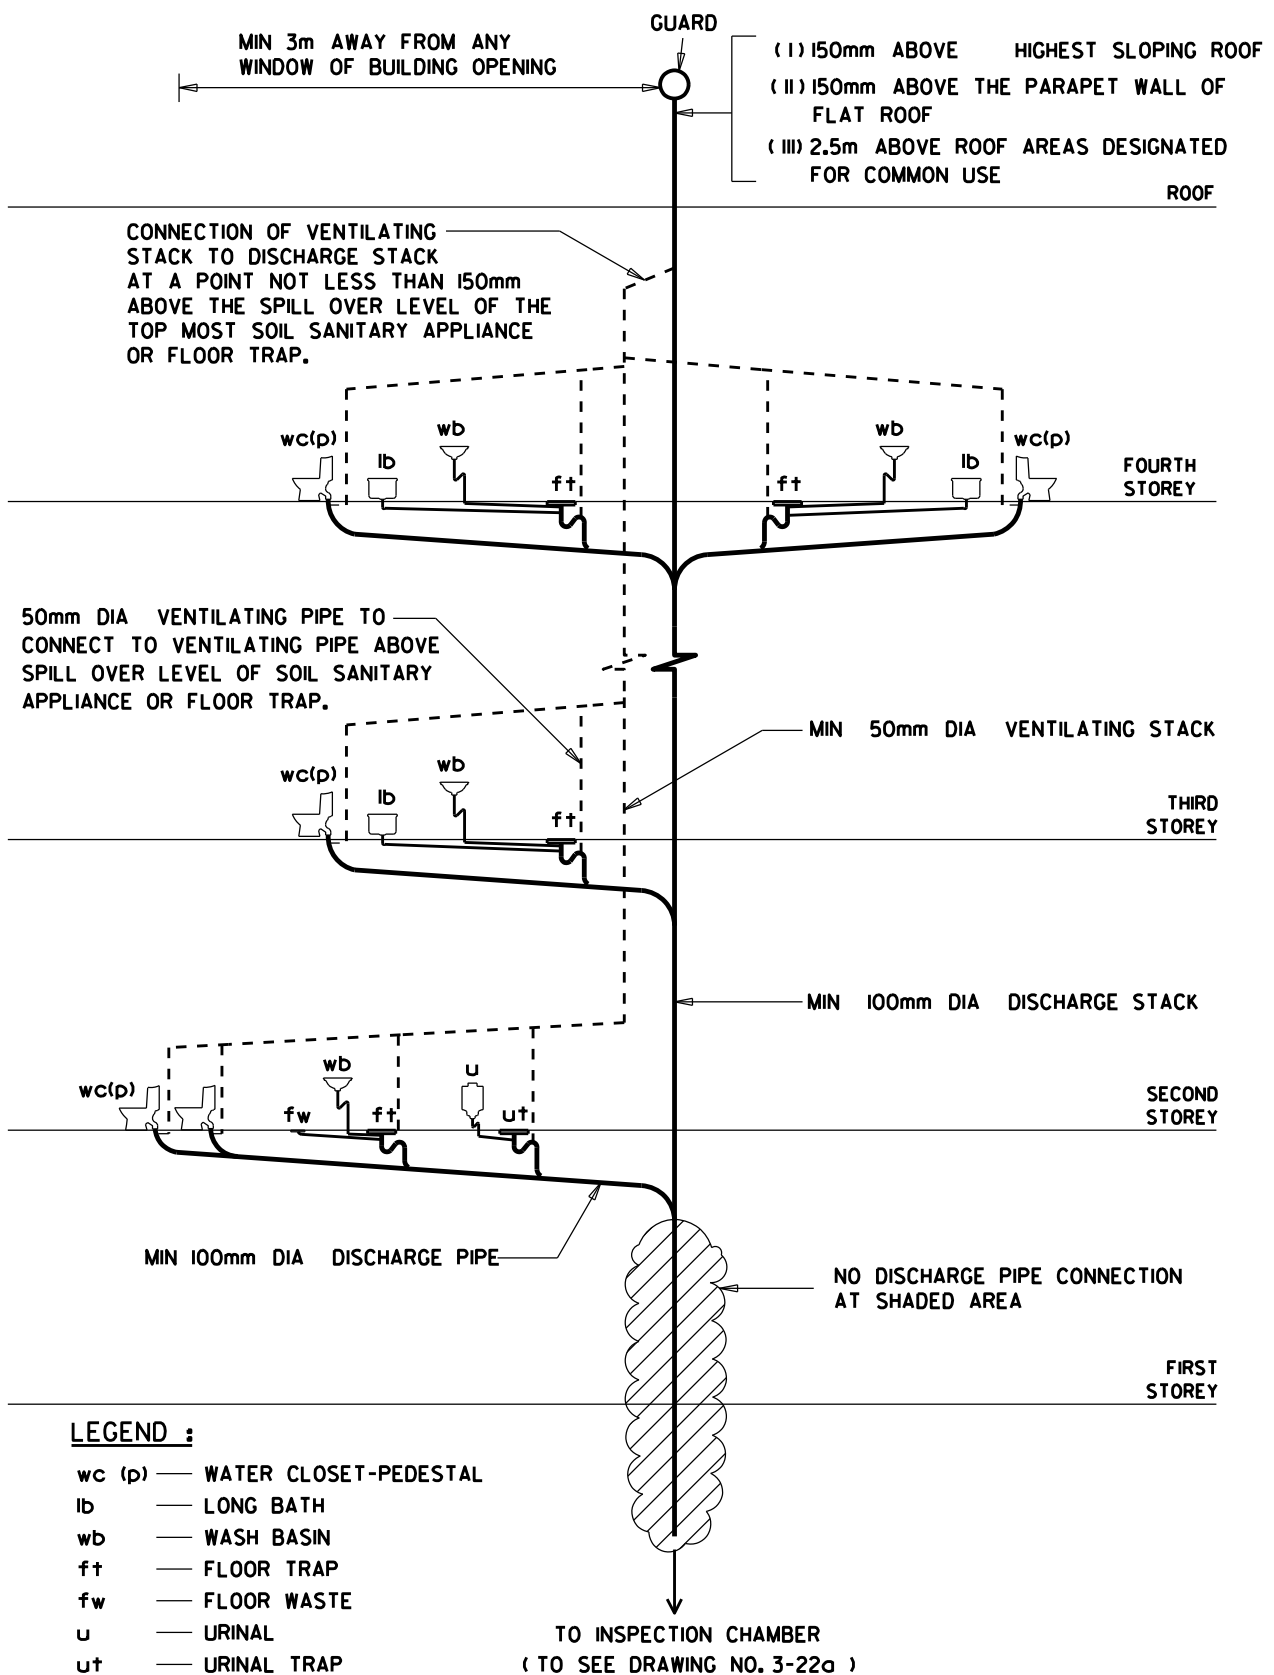

FULLY VENTILATED SYSTEM (WITH SINGLE STACK)
 FOR SINGLE LANDED HOUSING