


100mm DIA. VENTILATING STACKS TO TERMINATE IN OPEN AIR.  
(REFER TO CLAUSE 4.3.6)  
RECOMMENDED MINIMUM HEIGHT :

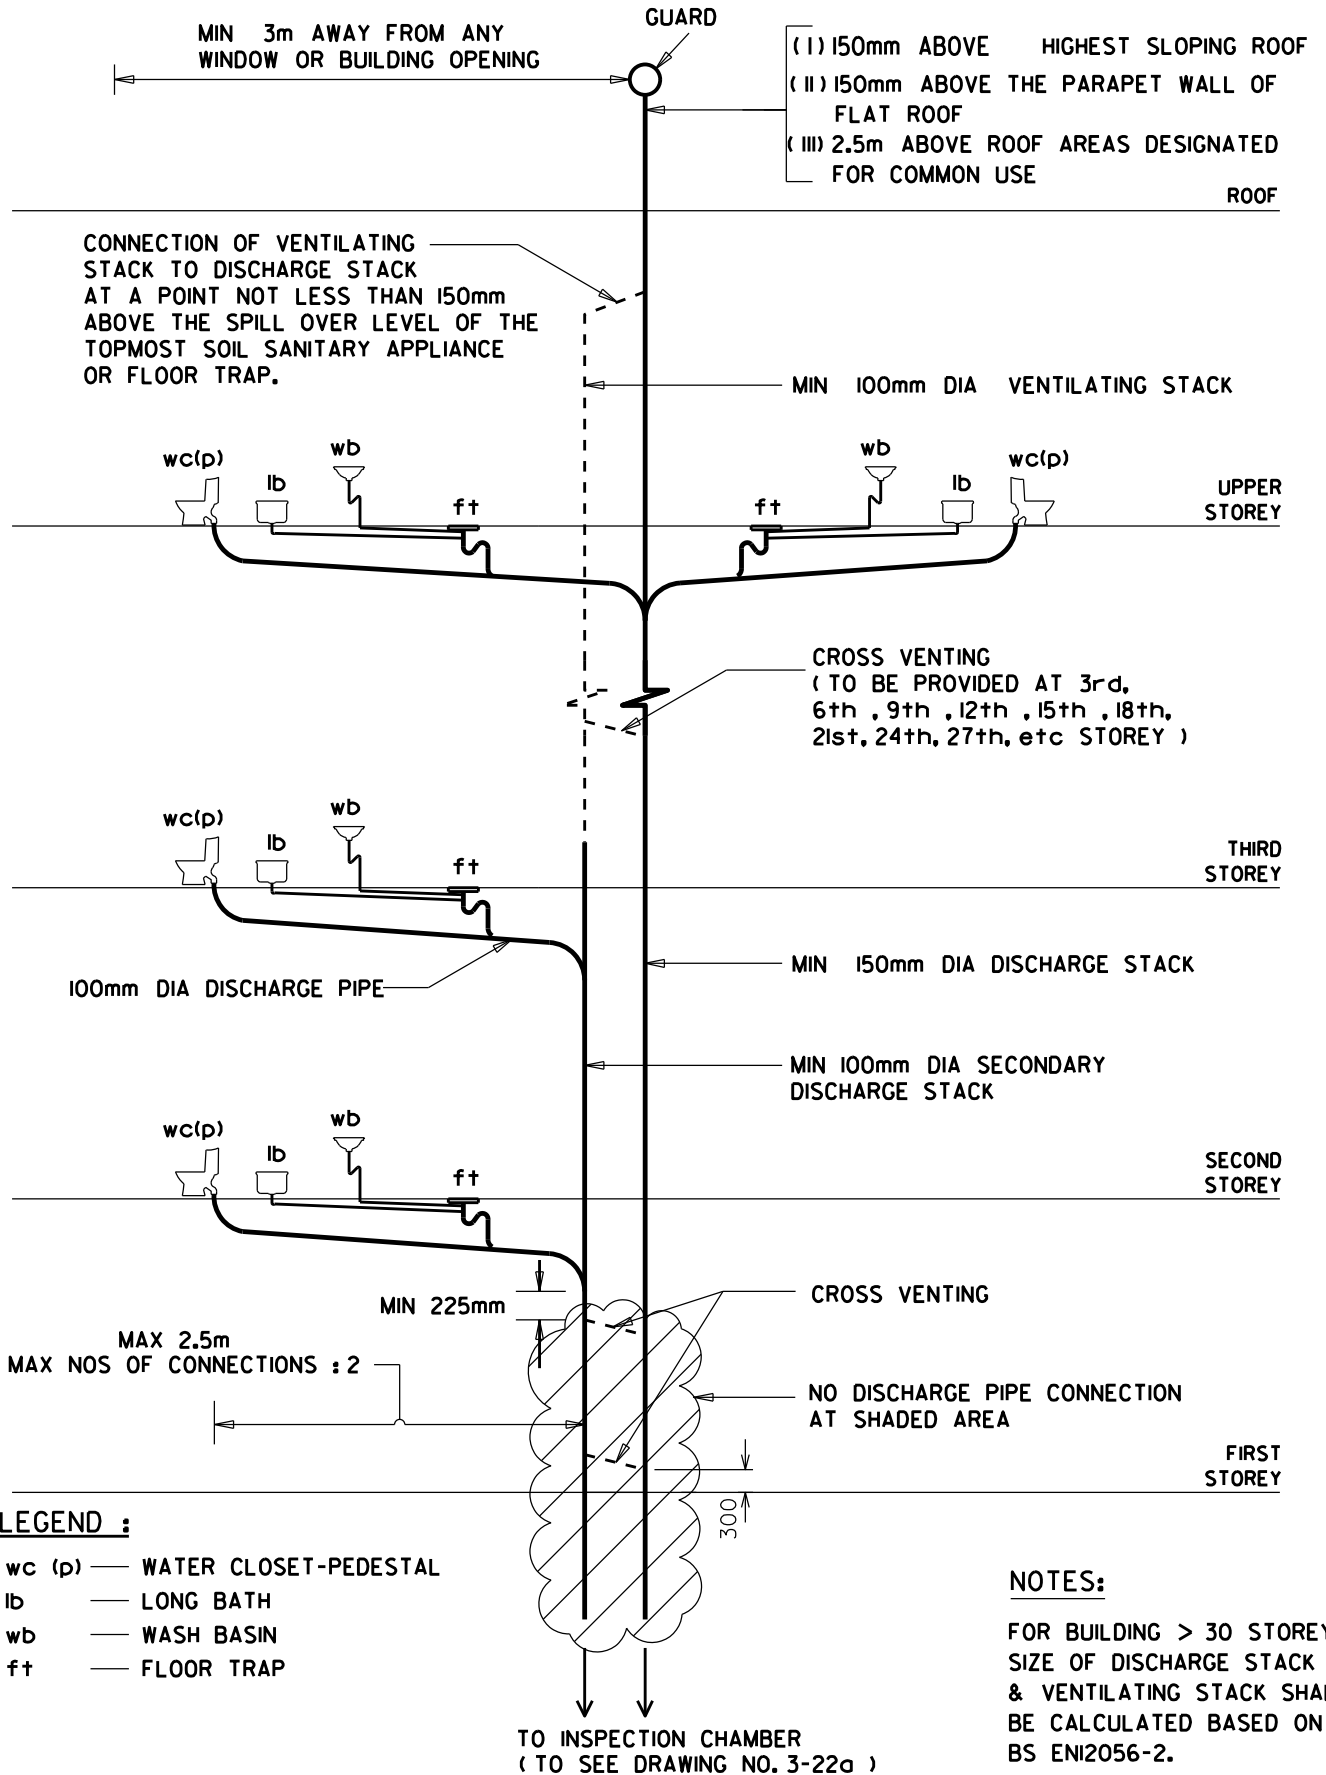

**LEGEND :**

- wc (p) — WATER CLOSET-PEDESTAL
- lb — LONG BATH
- wb — WASH BASIN
- ft — FLOOR TRAP

**NOTES:**

FOR BUILDING > 30 STOREY,  
SIZE OF DISCHARGE STACK  
& VENTILATING STACK SHALL  
BE CALCULATED BASED ON  
BS EN2056-2.

ISSUED : MAR 2000

SCALES

NOT  
TO  
SCALE

REVIEWED : JAN 2019

**VENTILATED STACK SYSTEM FOR ALL BUILDINGS**

**OPUB** SINGAPORE'S  
NATIONAL  
WATER AGENCY

WATER RECLAMATION (NETWORK) DEPARTMENT

DRAWING NO. 3-18c