



Alternative 1

(For new development)

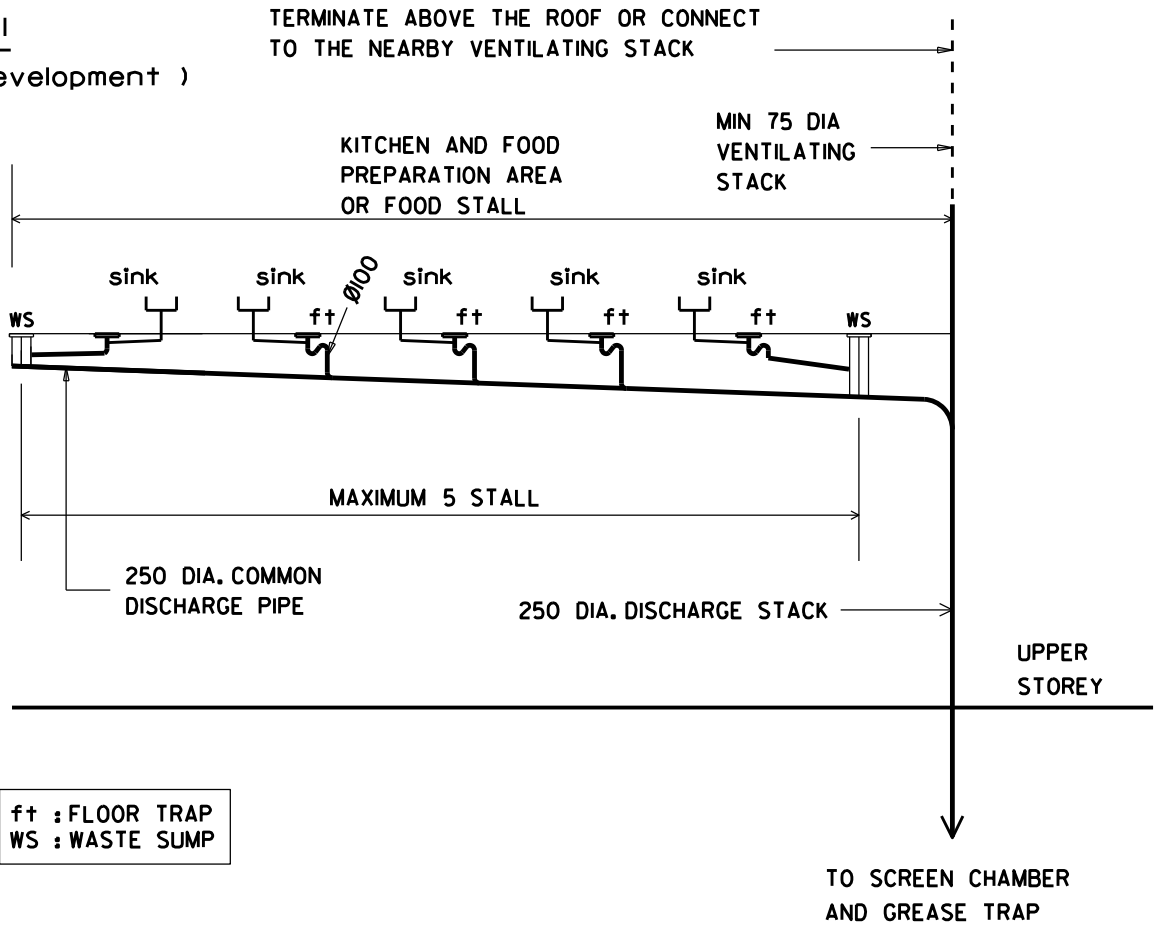

Alternative 2


(for A/A to existing food establishment)

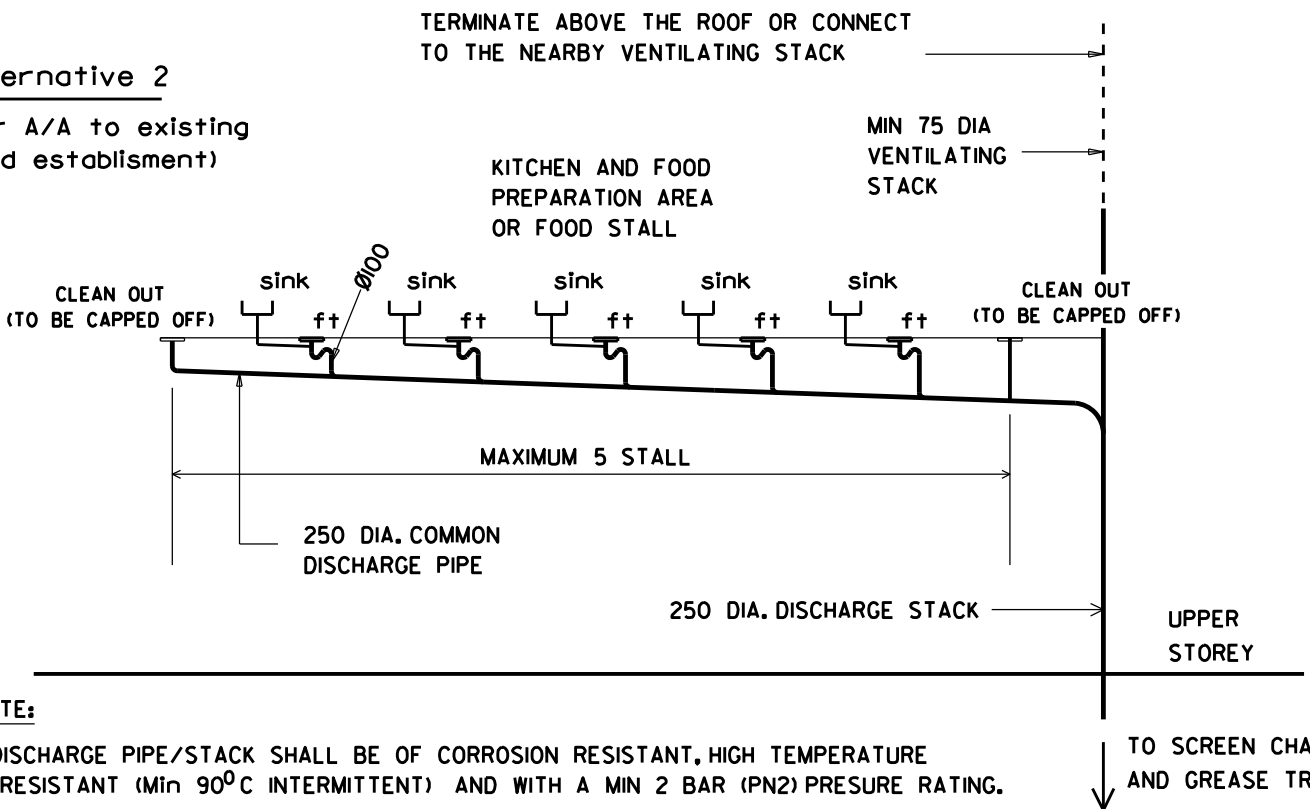

NOTE:

- 1) DISCHARGE PIPE/STACK SHALL BE OF CORROSION RESISTANT, HIGH TEMPERATURE RESISTANT (Min 90°C INTERMITTENT) AND WITH A MIN 2 BAR (PN2) PRESURE RATING.
- 2) FLOOR TRAP COVER SHALL BE SECURELY BOLTED OR SCREWED-DOWN TO THE FRAME.

ALL DIMENSIONS ARE IN mm.

ISSUED : JAN 2019	SCALES	SANITARY AND PLUMBING SYSTEM FOR FOOD ESTABLISHMENT (UPPER STOREY LEVEL)	 SINGAPORE'S NATIONAL WATER AGENCY WATER RECLAMATION (NETWORK) DEPARTMENT
REVIEWED : -	NOT TO SCALE		