NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
2. REFER TO THE GENERAL NOTES IN DRAWING NO. PUB/WSN/GN/001
3. THE MANHOLE COVER AND FRAMES SHALL BE GRADE A1 AND COMPLY WITH SS 30.
4. LABEL ON MANHOLE COVERS SHALL BE:
   PUB - PW FOR POTABLE WATER
   PUB - NW FOR NEWATER
5. MANHOLE COVERS FOR NEWATER PIPELINES SHALL BE PAINTED PURPLE (COLOUR CODE: 22-C-37).

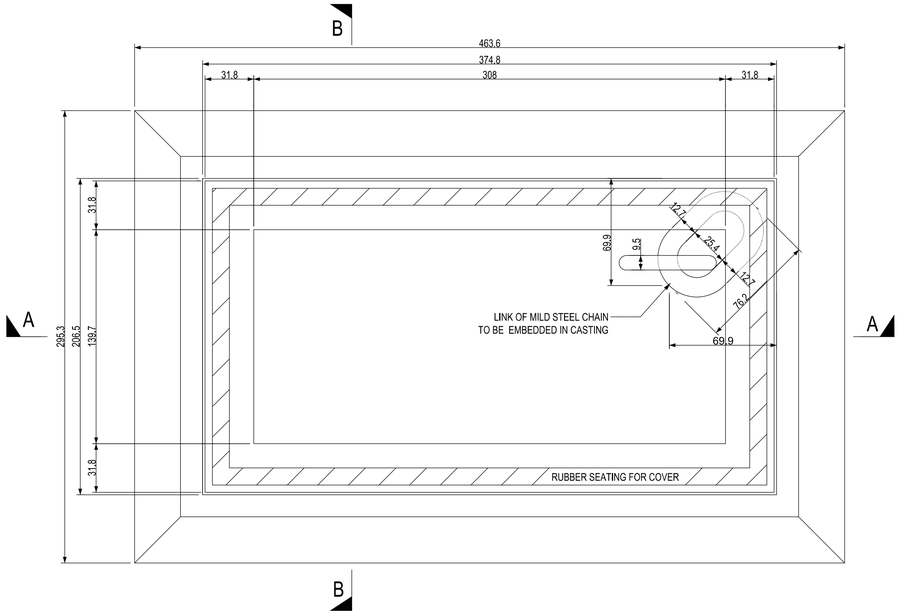

STANDARD RECTANGLE DUCTILE IRON (GRADE A1) MANHOLE FRAME AND COVER
(FOR SLUICE VALVE BEFORE HYDRANT)

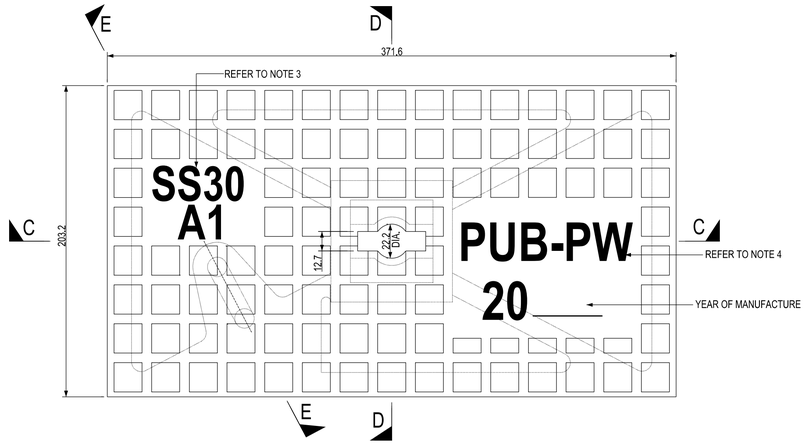

PLAN OF MANHOLE COVER

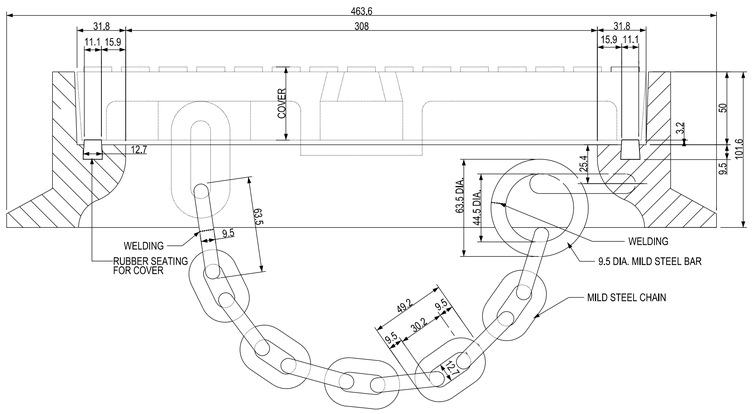

SECTION A-A

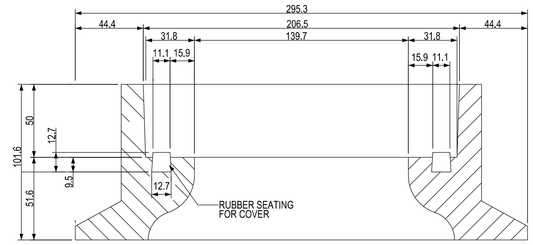

SECTION B-B

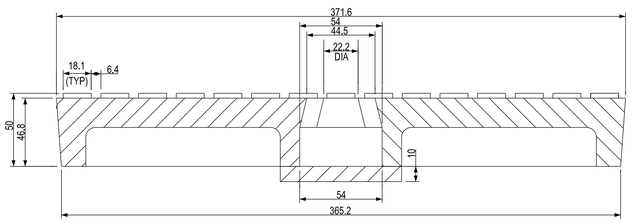

SECTION C-C

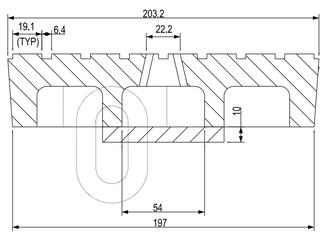

SECTION D-D

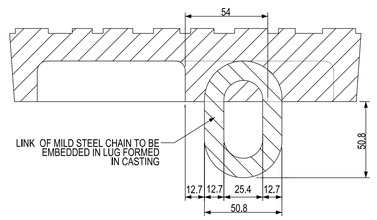

SECTION E-E

ISSUED : SEP 2020	SCALE	**STANDARD RECTANGLE DUCTILE IRON (GRADE A1) MANHOLE FRAME AND COVER (FOR SLUICE VALVE BEFORE HYDRANT)**	PUB SINGAPORE'S NATIONAL WATER AGENCY
LAST REVIEWED : SEP 2020	1 : 2		WATER SUPPLY(NETWORK) DEPARTMENT
			DRAWING NO. **PUB/WSN/STD/205**