



COATED - PANTONE 321
UNCOATED - PANTONE 320
PROCESS - 100c 50y 10k


COATED - PANTONE 2935
UNCOATED - PANTONE 3005
PROCESS - 100c 50m

COATED - PANTONE 2746
UNCOATED - PANTONE 072
PROCESS - 100c 90m




DETAILS OF LOGO

SIZE OF LETTERING	FONT TYPE	STYLE
CAUTION	ARIAL	BOLD
Ø PW PIPE	ARIAL	BOLD
3.50m	ARIAL	BOLD
CALL 1800 - CALL PUB (2255 782)	ARIAL	BOLD
BEFORE ANY WORKS	ARIAL	BOLD

- NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
 2. REFER TO THE GENERAL NOTES IN DRAWING NO. PUB/WSN/GN/001
 3. LABEL ON MARKERS SHALL BE: PW for POTABLE WATER NW for NEWATER
 4. STAINLESS STEEL PLATES AND BOLTS SHALL BE OF GRADE 316
 5. MARKERS SHALL BE INSTALLED AT ALL PUB CHAMBERS, HYDRANTS AND AT INTERVALS OF NOT MORE THAN 100m AS DIRECTED BY S.O. IF THERE ARE NO CHAMBERS, MARKERS SHALL BE INSTALLED CLOSE TO EXISTING LAMP POSTS.

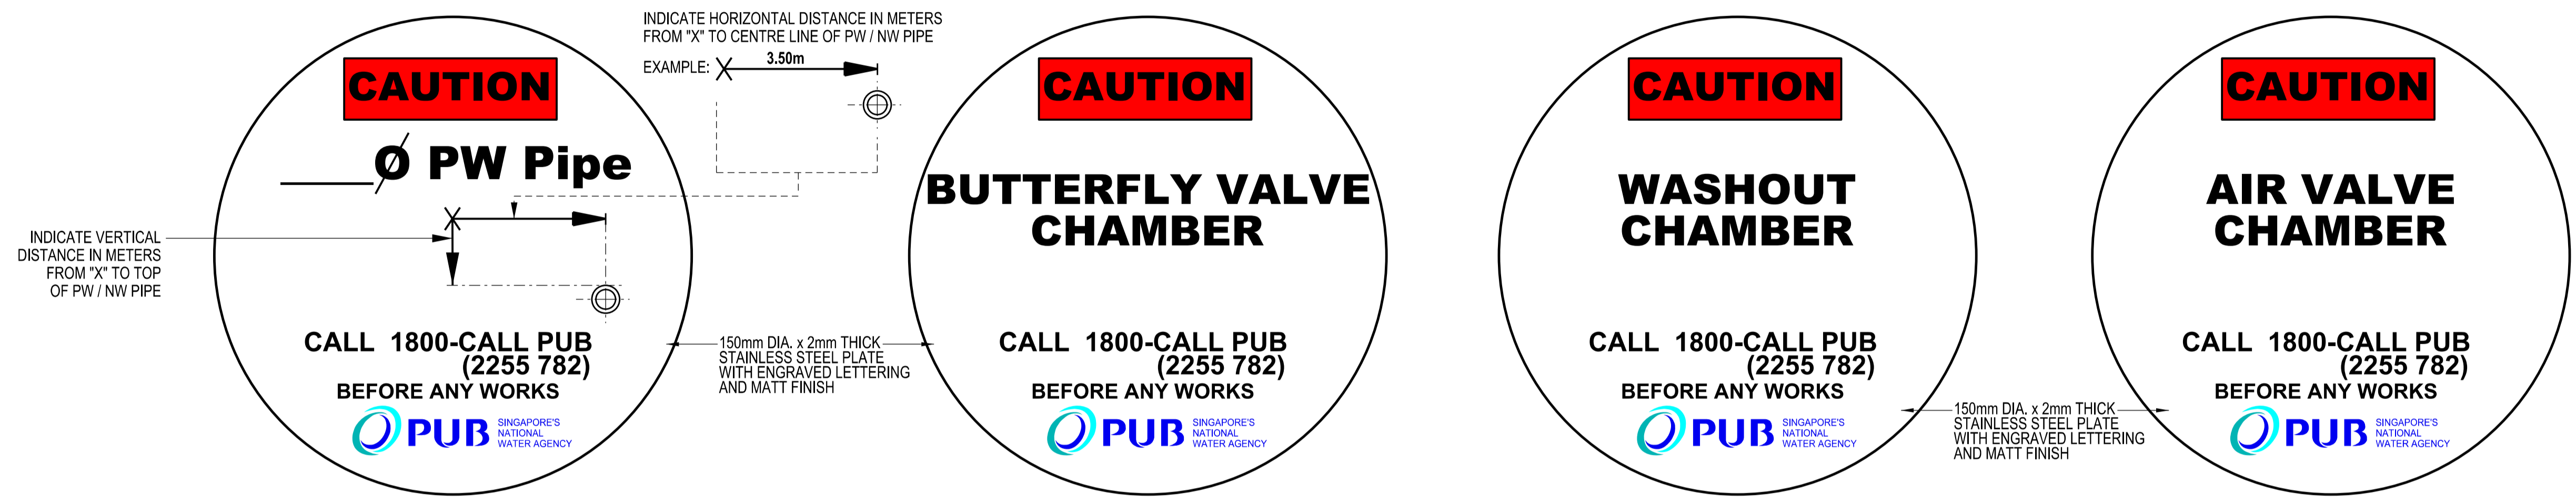

STAINLESS STEEL MARKER PLATE
SCALE 1:2.5

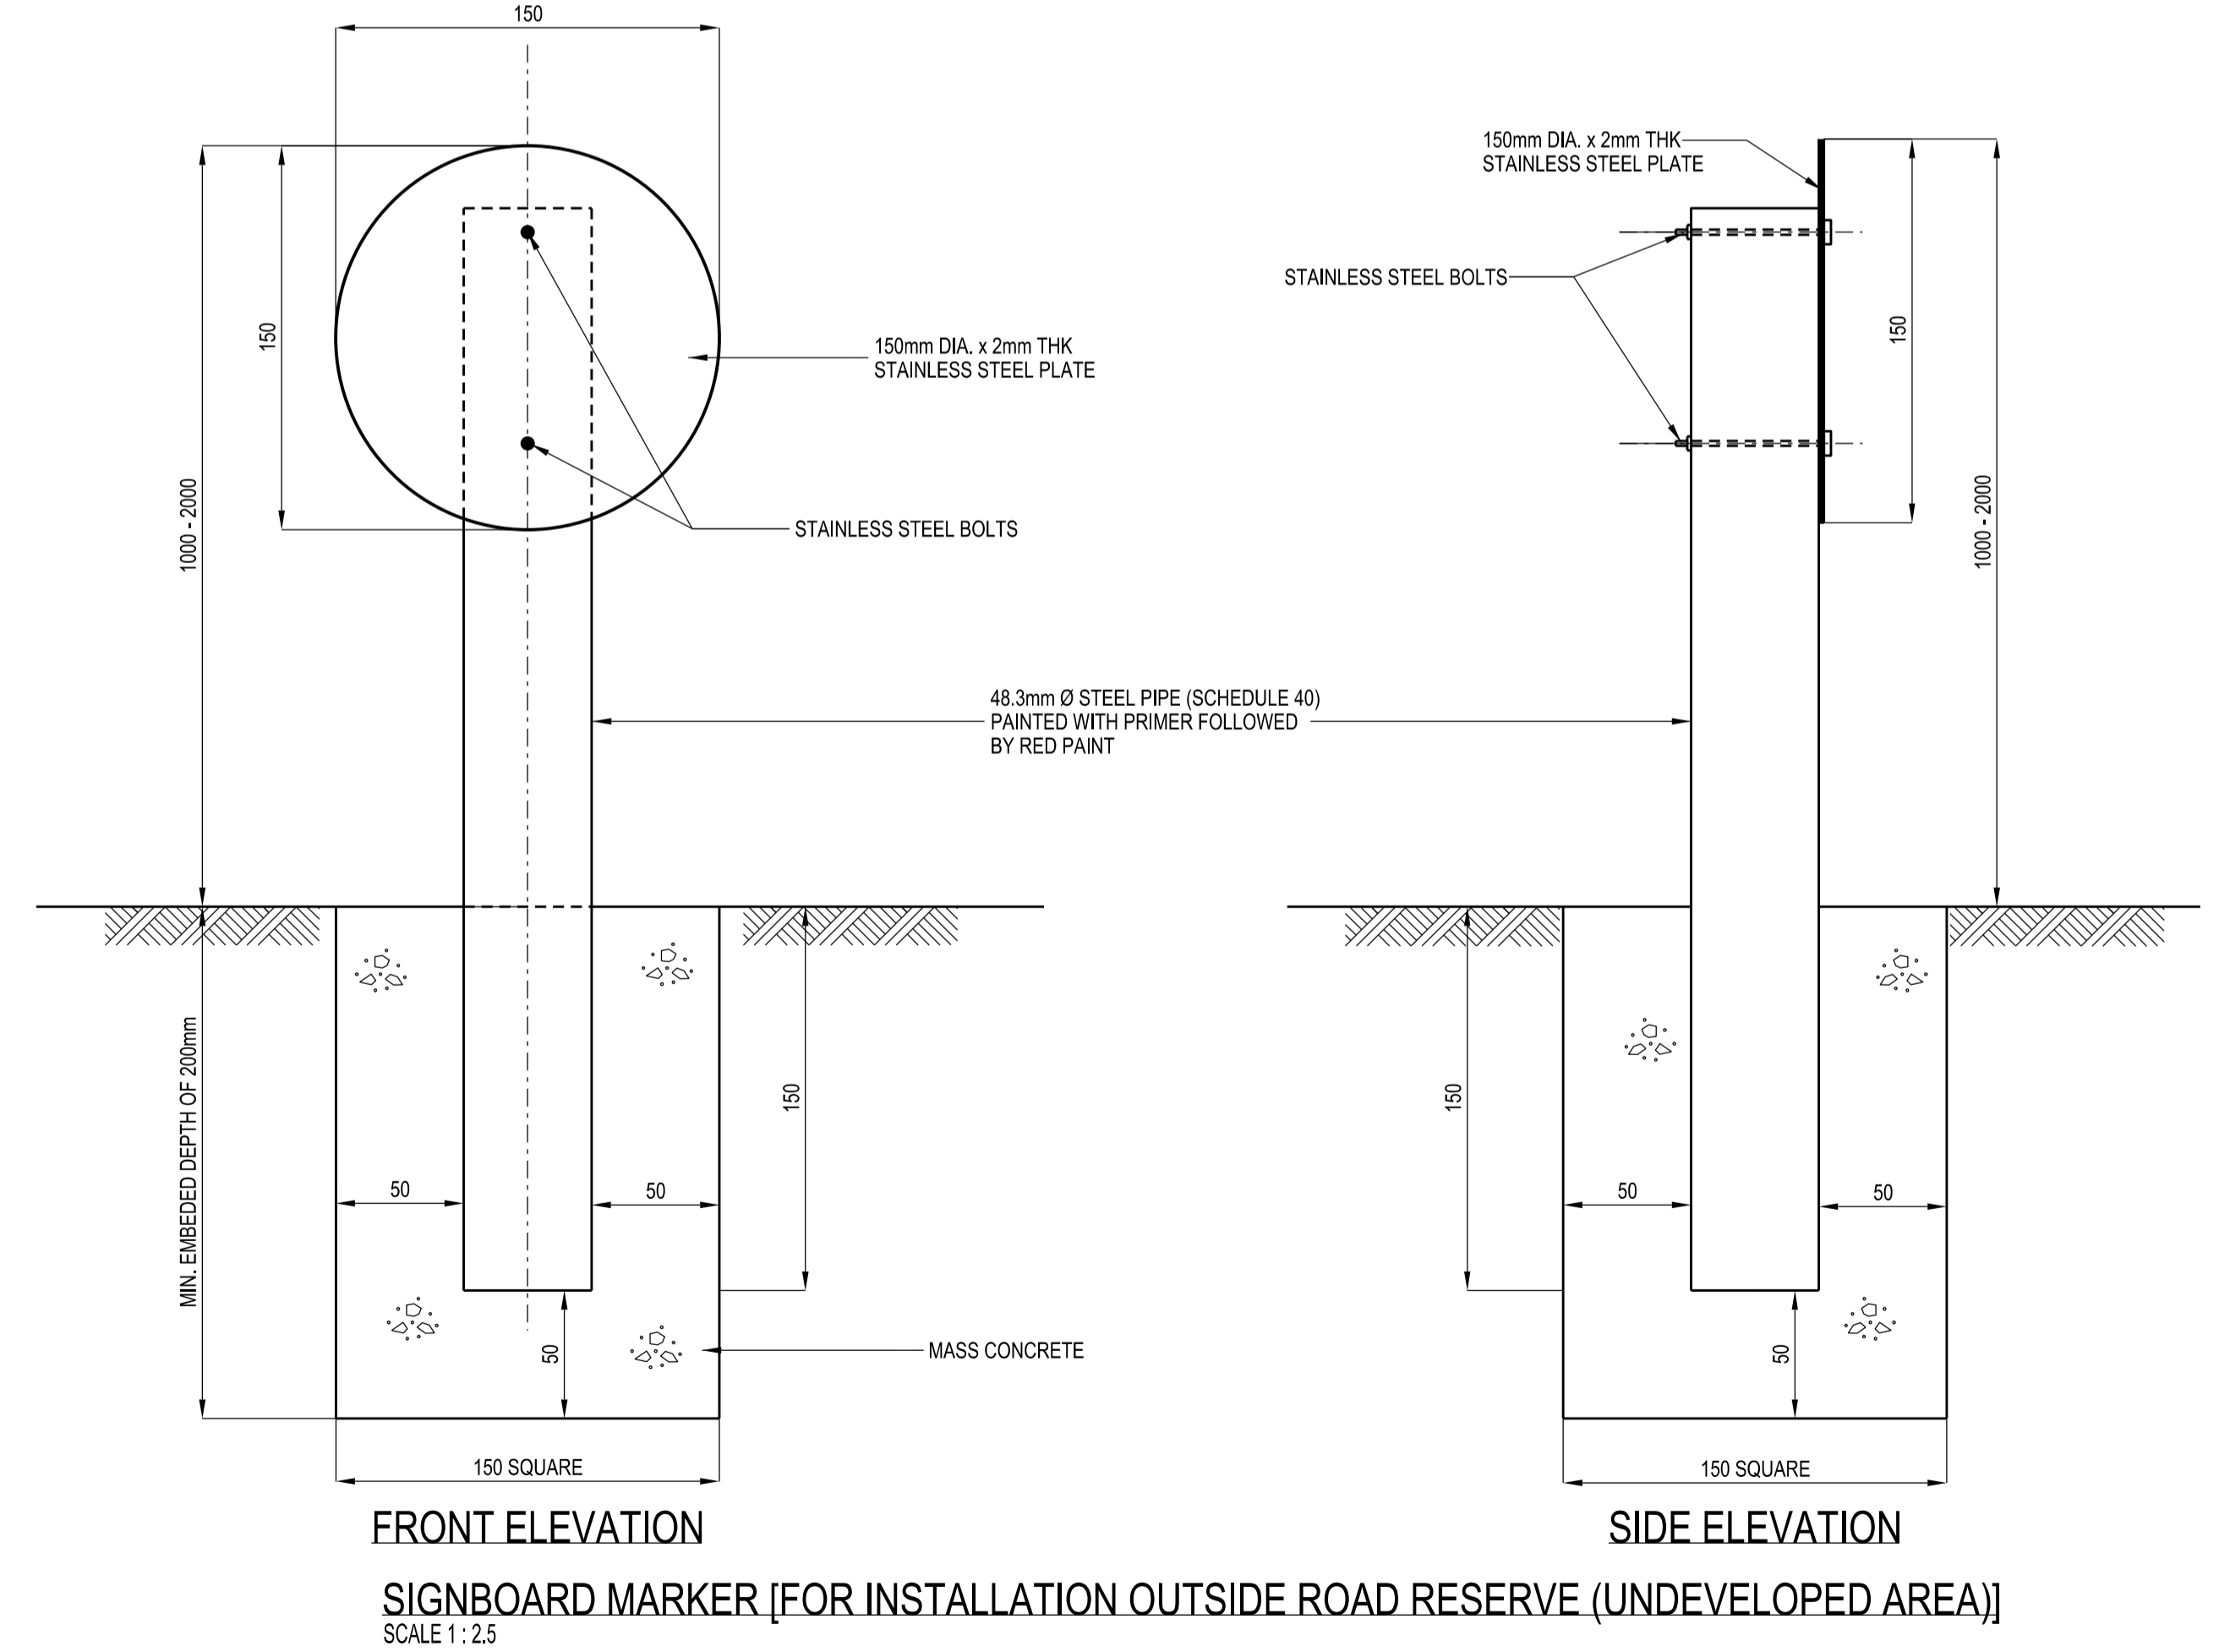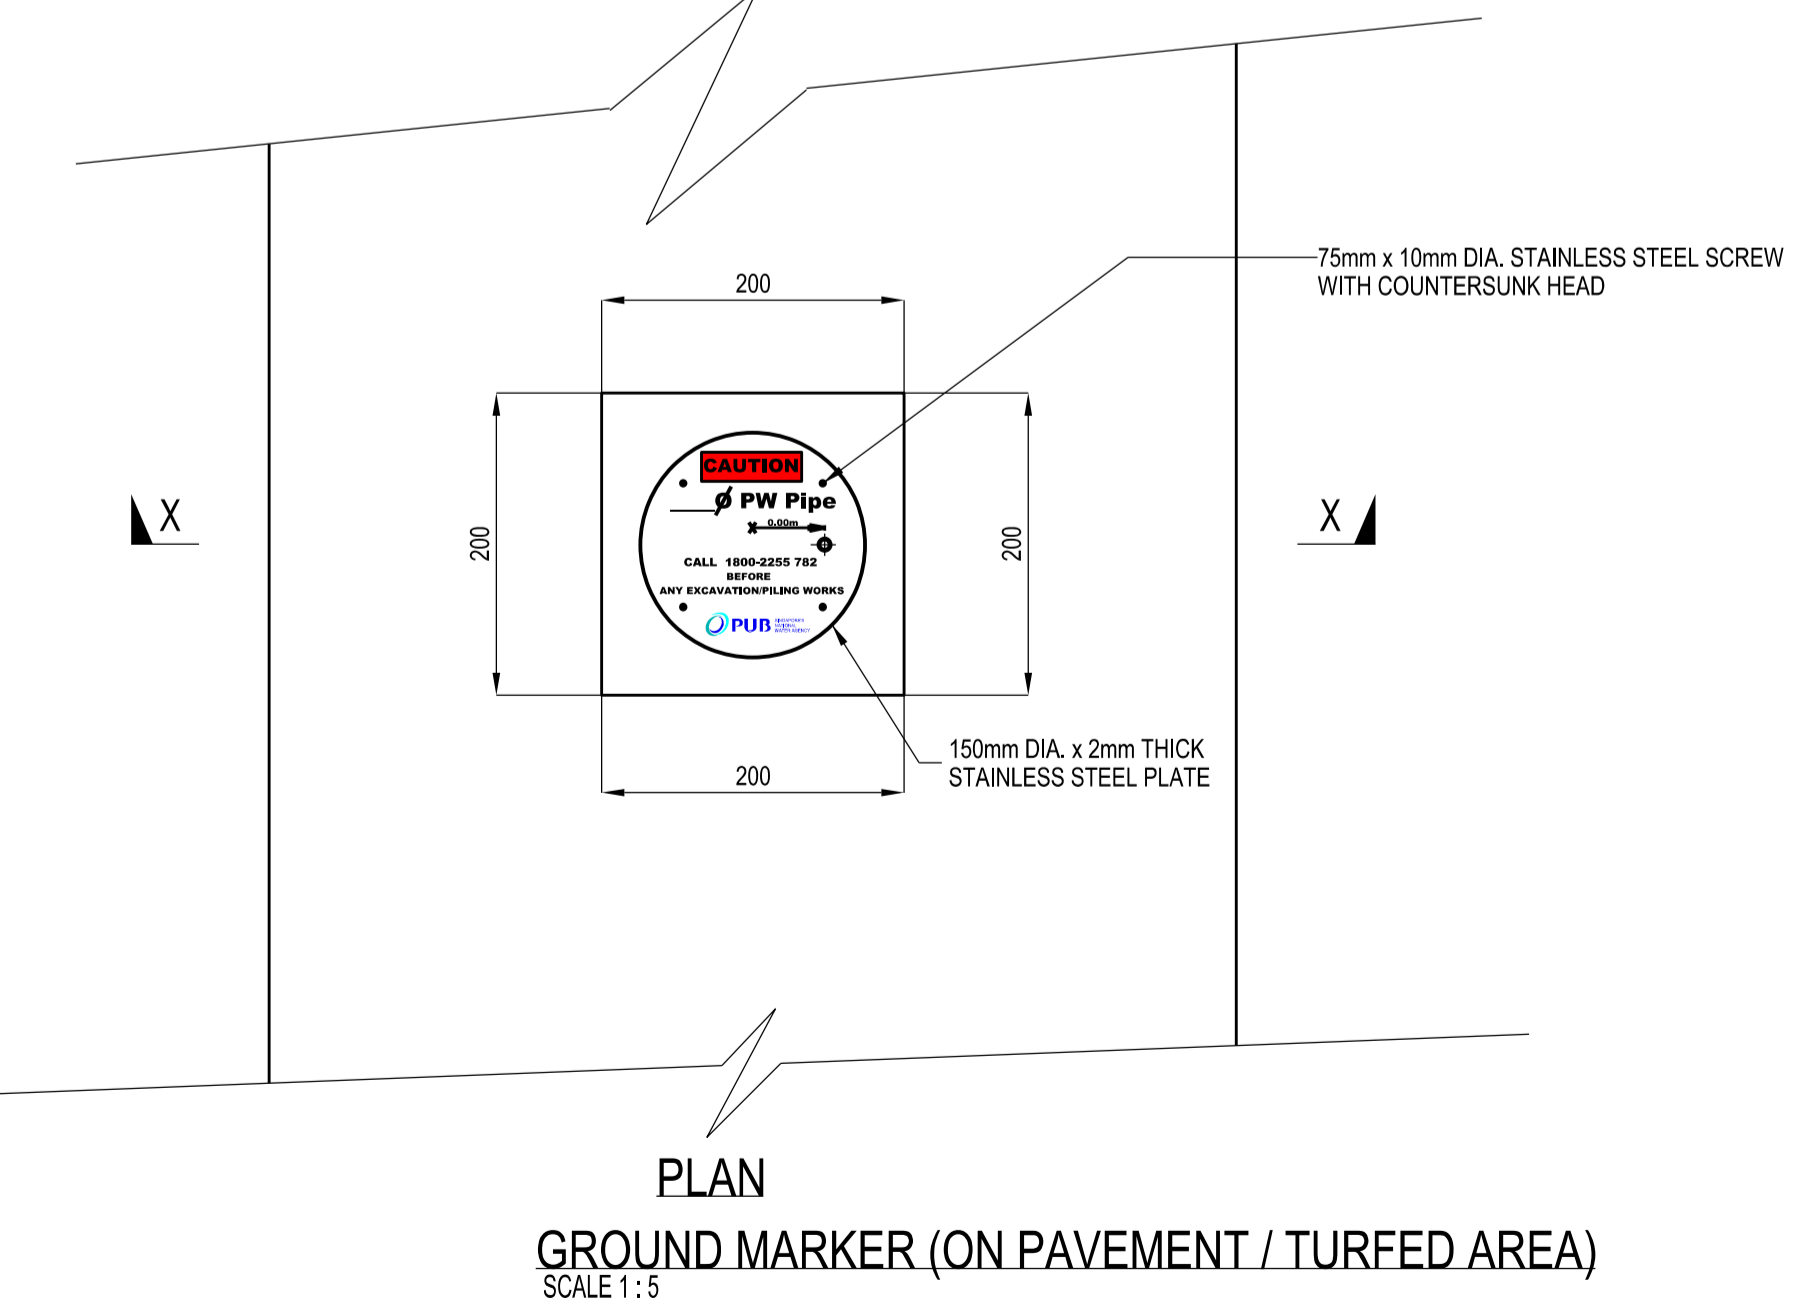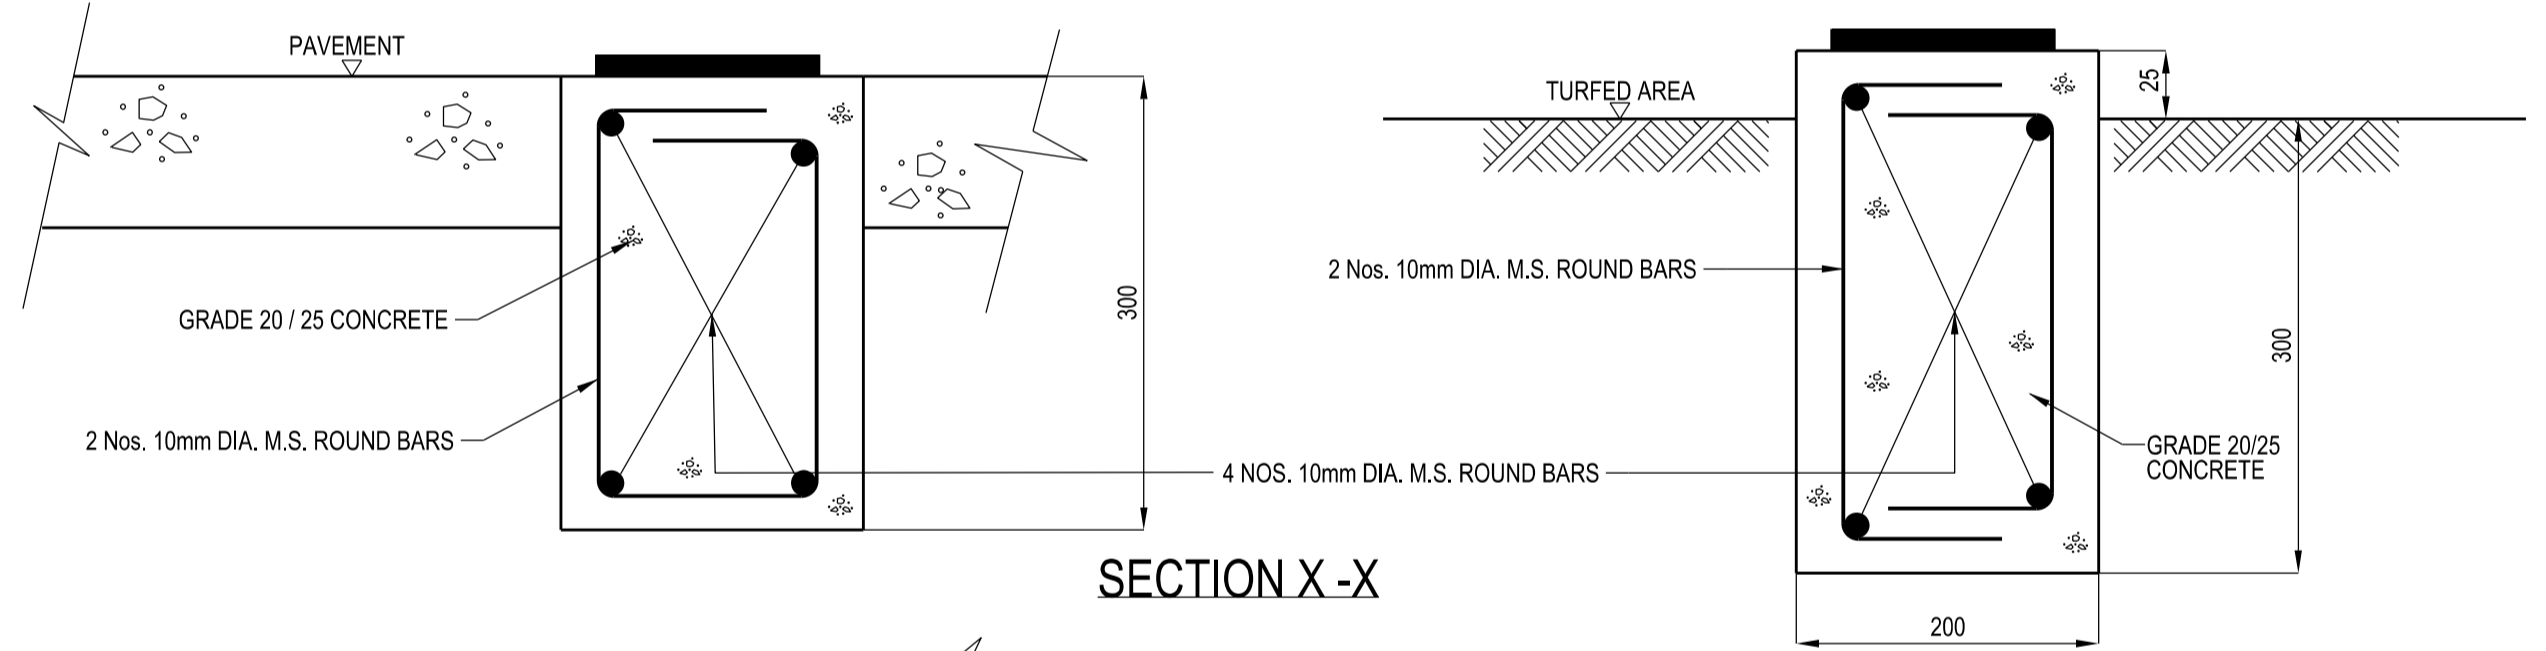

ISSUED: NOV 2020

SCALE
AS SHOWN

LAST REVIEWED: NOV 2020

GROUND AND SIGNBOARD MARKERS