



- NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
 2. THE CONTRACTOR SHALL REFER TO THE GENERAL NOTES IN DRAWING NO. PUB/WSN/GN/001.
 3. INSTALL BRICK CHAMBER WITH 200MM OR 300MM DIA. SLUICE VALVE IF THE LENGTH OF THE WASHOUT PIPE FROM THE WASHOUT CHAMBER IS EXCEEDS 5M.
 4. HEIGHT OF WASHOUT PIPE OUTLET SHALL BE AS HIGH AS POSSIBLE ABOVE THE DRAIN INVERT AND WHERE FEASIBLE, ABOVE THE TOP WATER LEVEL IN THE DRAIN. THE CONSULTANT SHALL CONSULT THE CATCHMENT AND WATERWAY DEPARTMENT, PUB THROUGH CORENET SUBMISSION ON THE LOCATION OF THE WASHOUT PIPE OUTLET AND LEVEL OF DISCHARGE INTO THE DRAIN.
 5. THE BRICK CHAMBER SHALL BE LOCATED OUTSIDE DRAINAGE RESERVE WHERE POSSIBLE OR AT LEAST 300MM AWAY FROM DRAIN STRUCTURE.

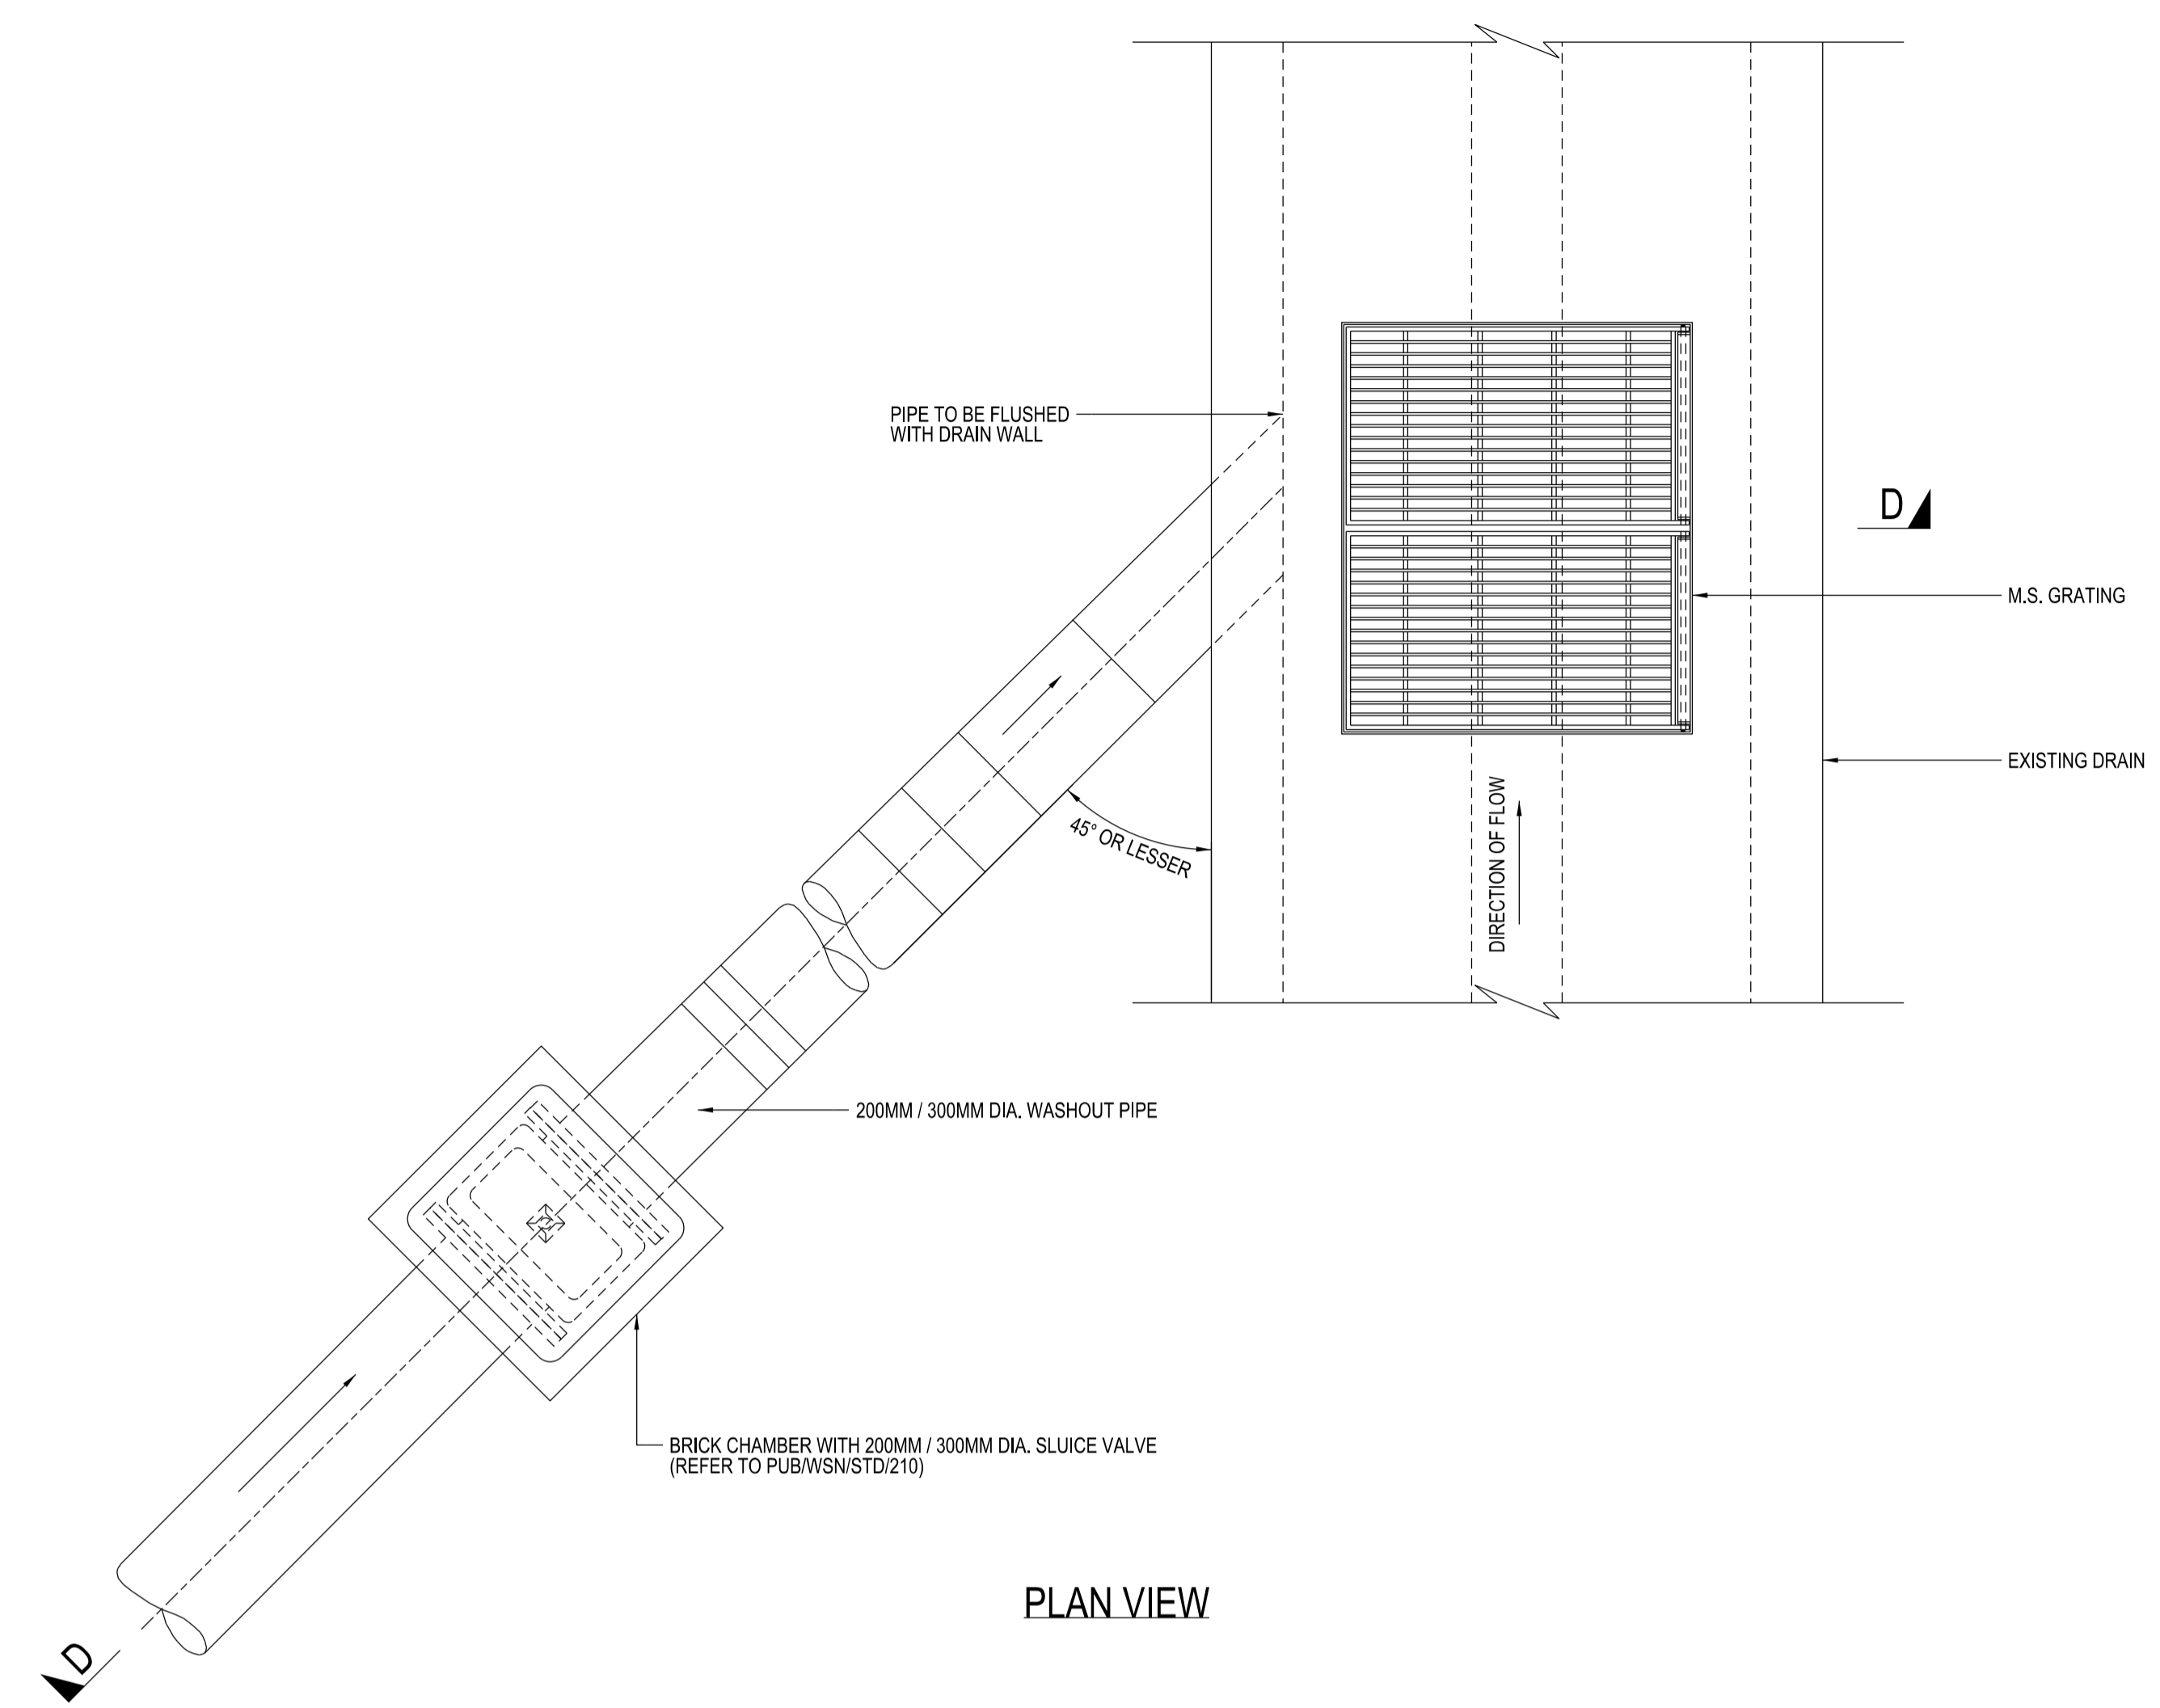

PLAN VIEW

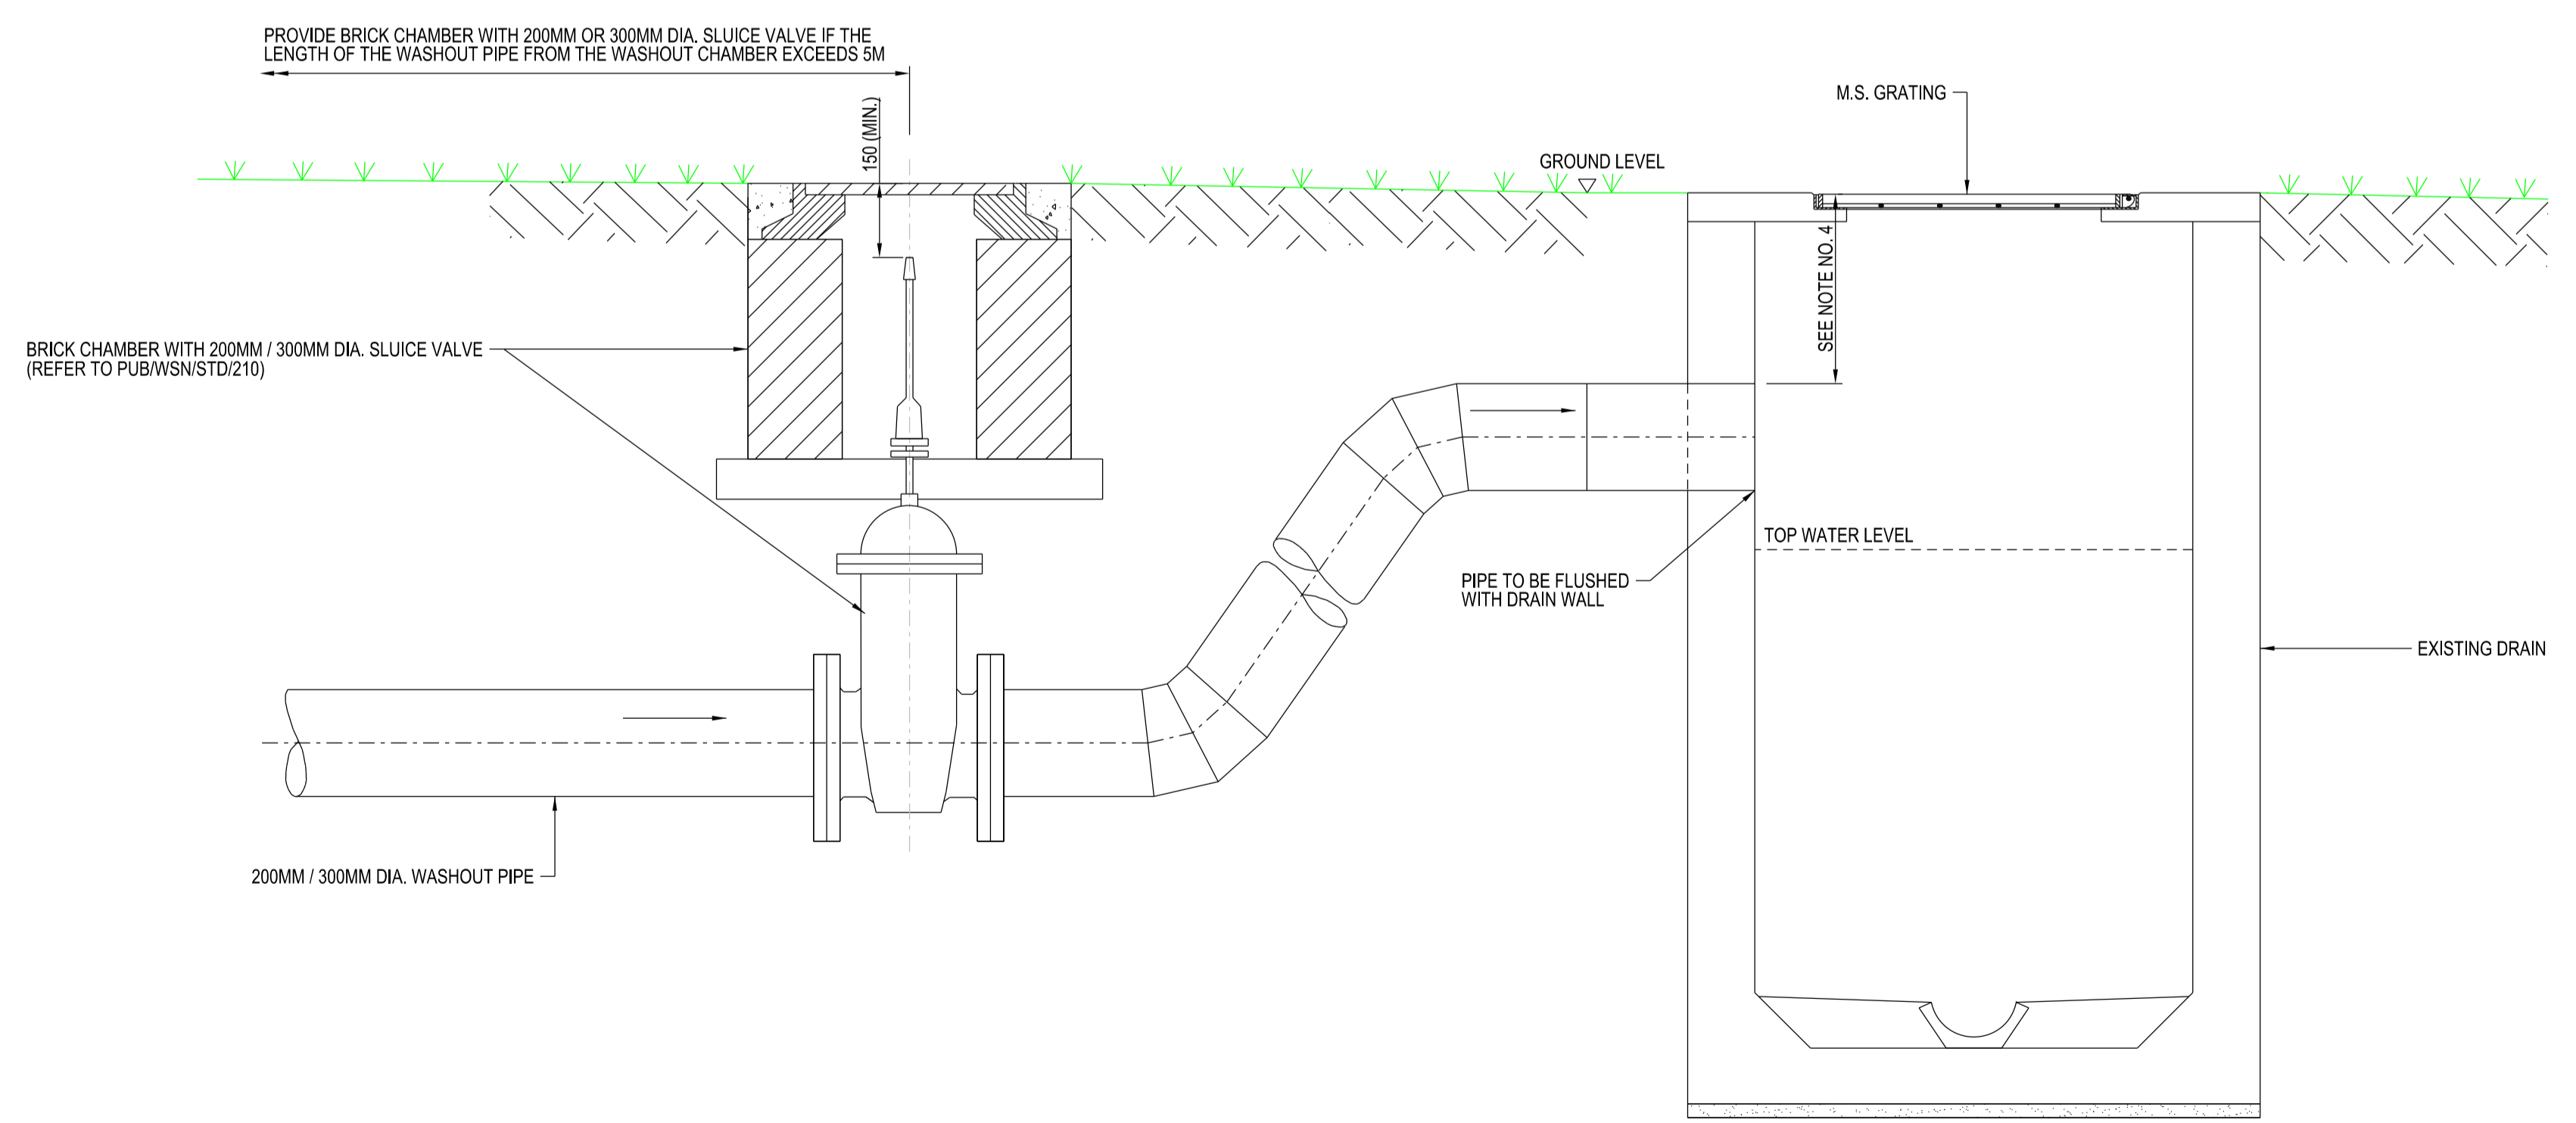

SECTION D - D

ISSUED: AUG 2021	SCALE	DRAWING NO.
LAST REVIEWED: AUG 2021	NTS	PUB/WSN/STD/119

CONNECTION OF WASHOUT PIPE TO DRAIN