



NOTE:
* FOR VALVE CHAMBER LOCATED ON ROAD

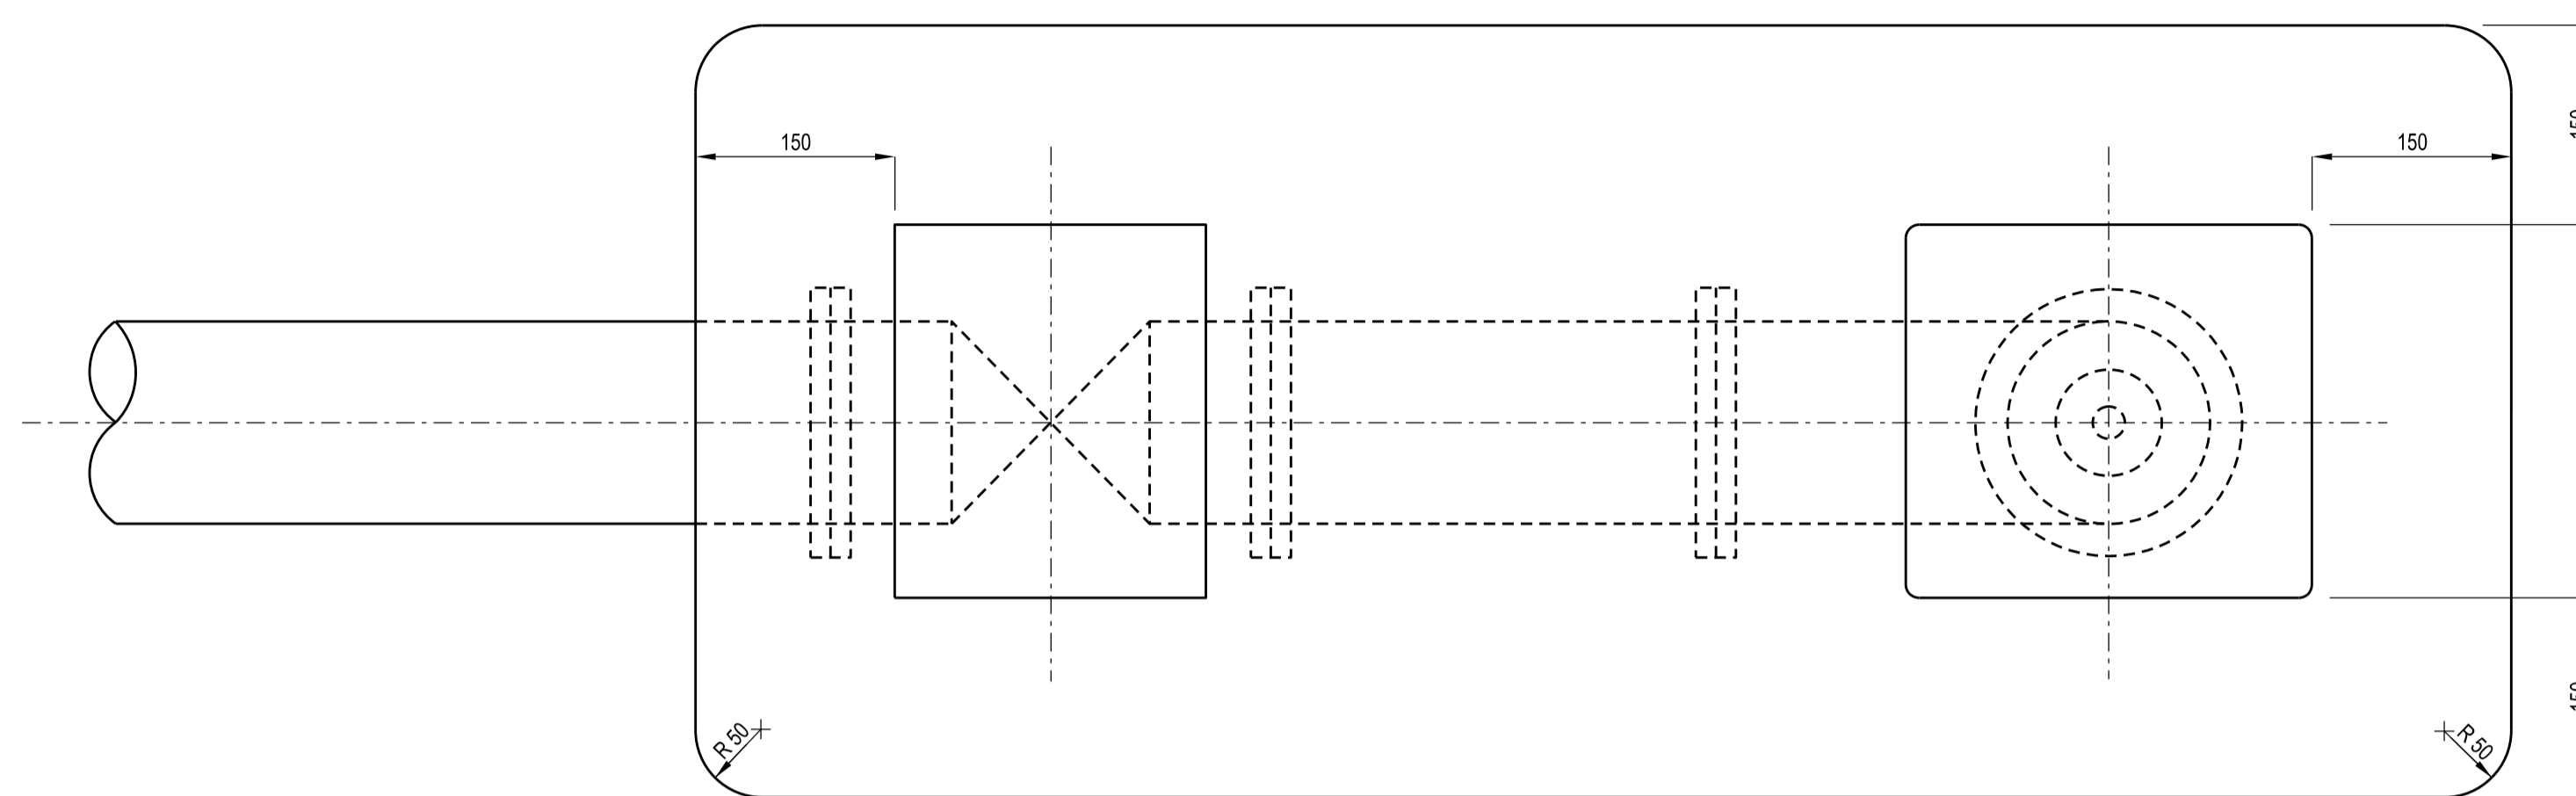

PLAN

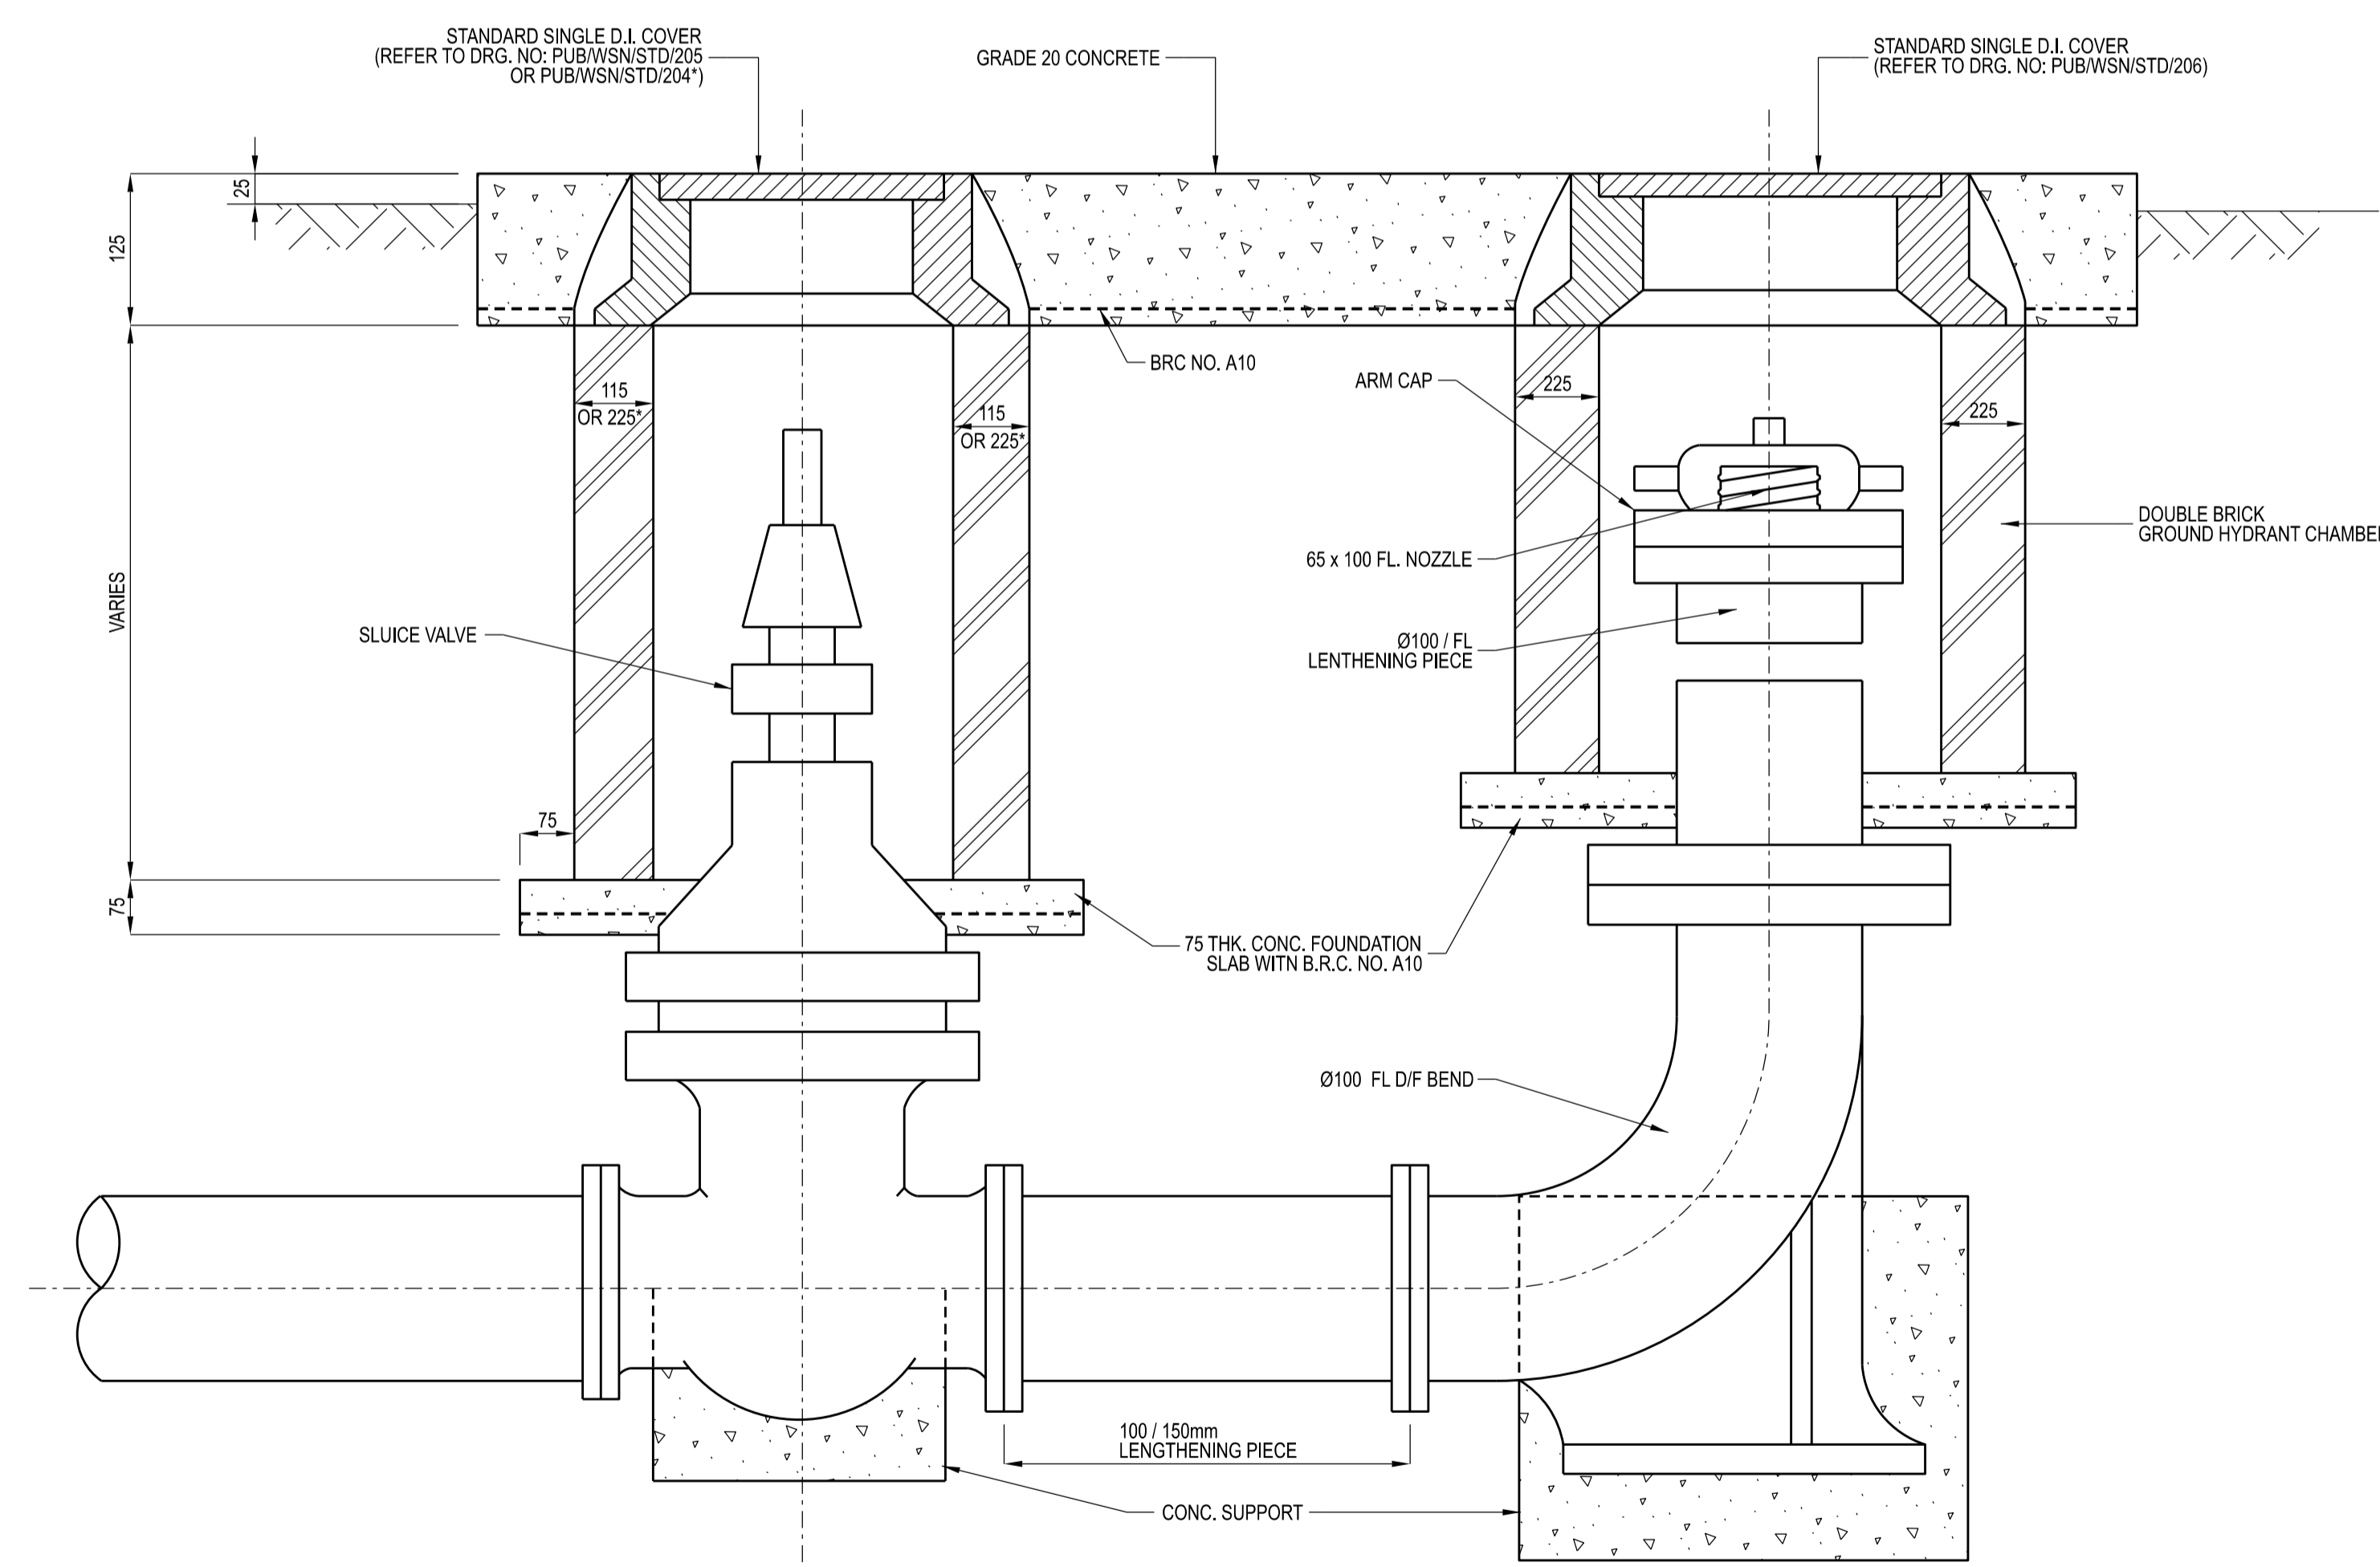

SECTION

DRAWING NO.: PUB/WSN/STD/304

DATE OF ISSUE: DEC 2022

SCALE: NTS

REV.: -

INSTALLATION OF GROUND HYDRANT FOR DUCTILE IRON PIPELINE