


PLAN

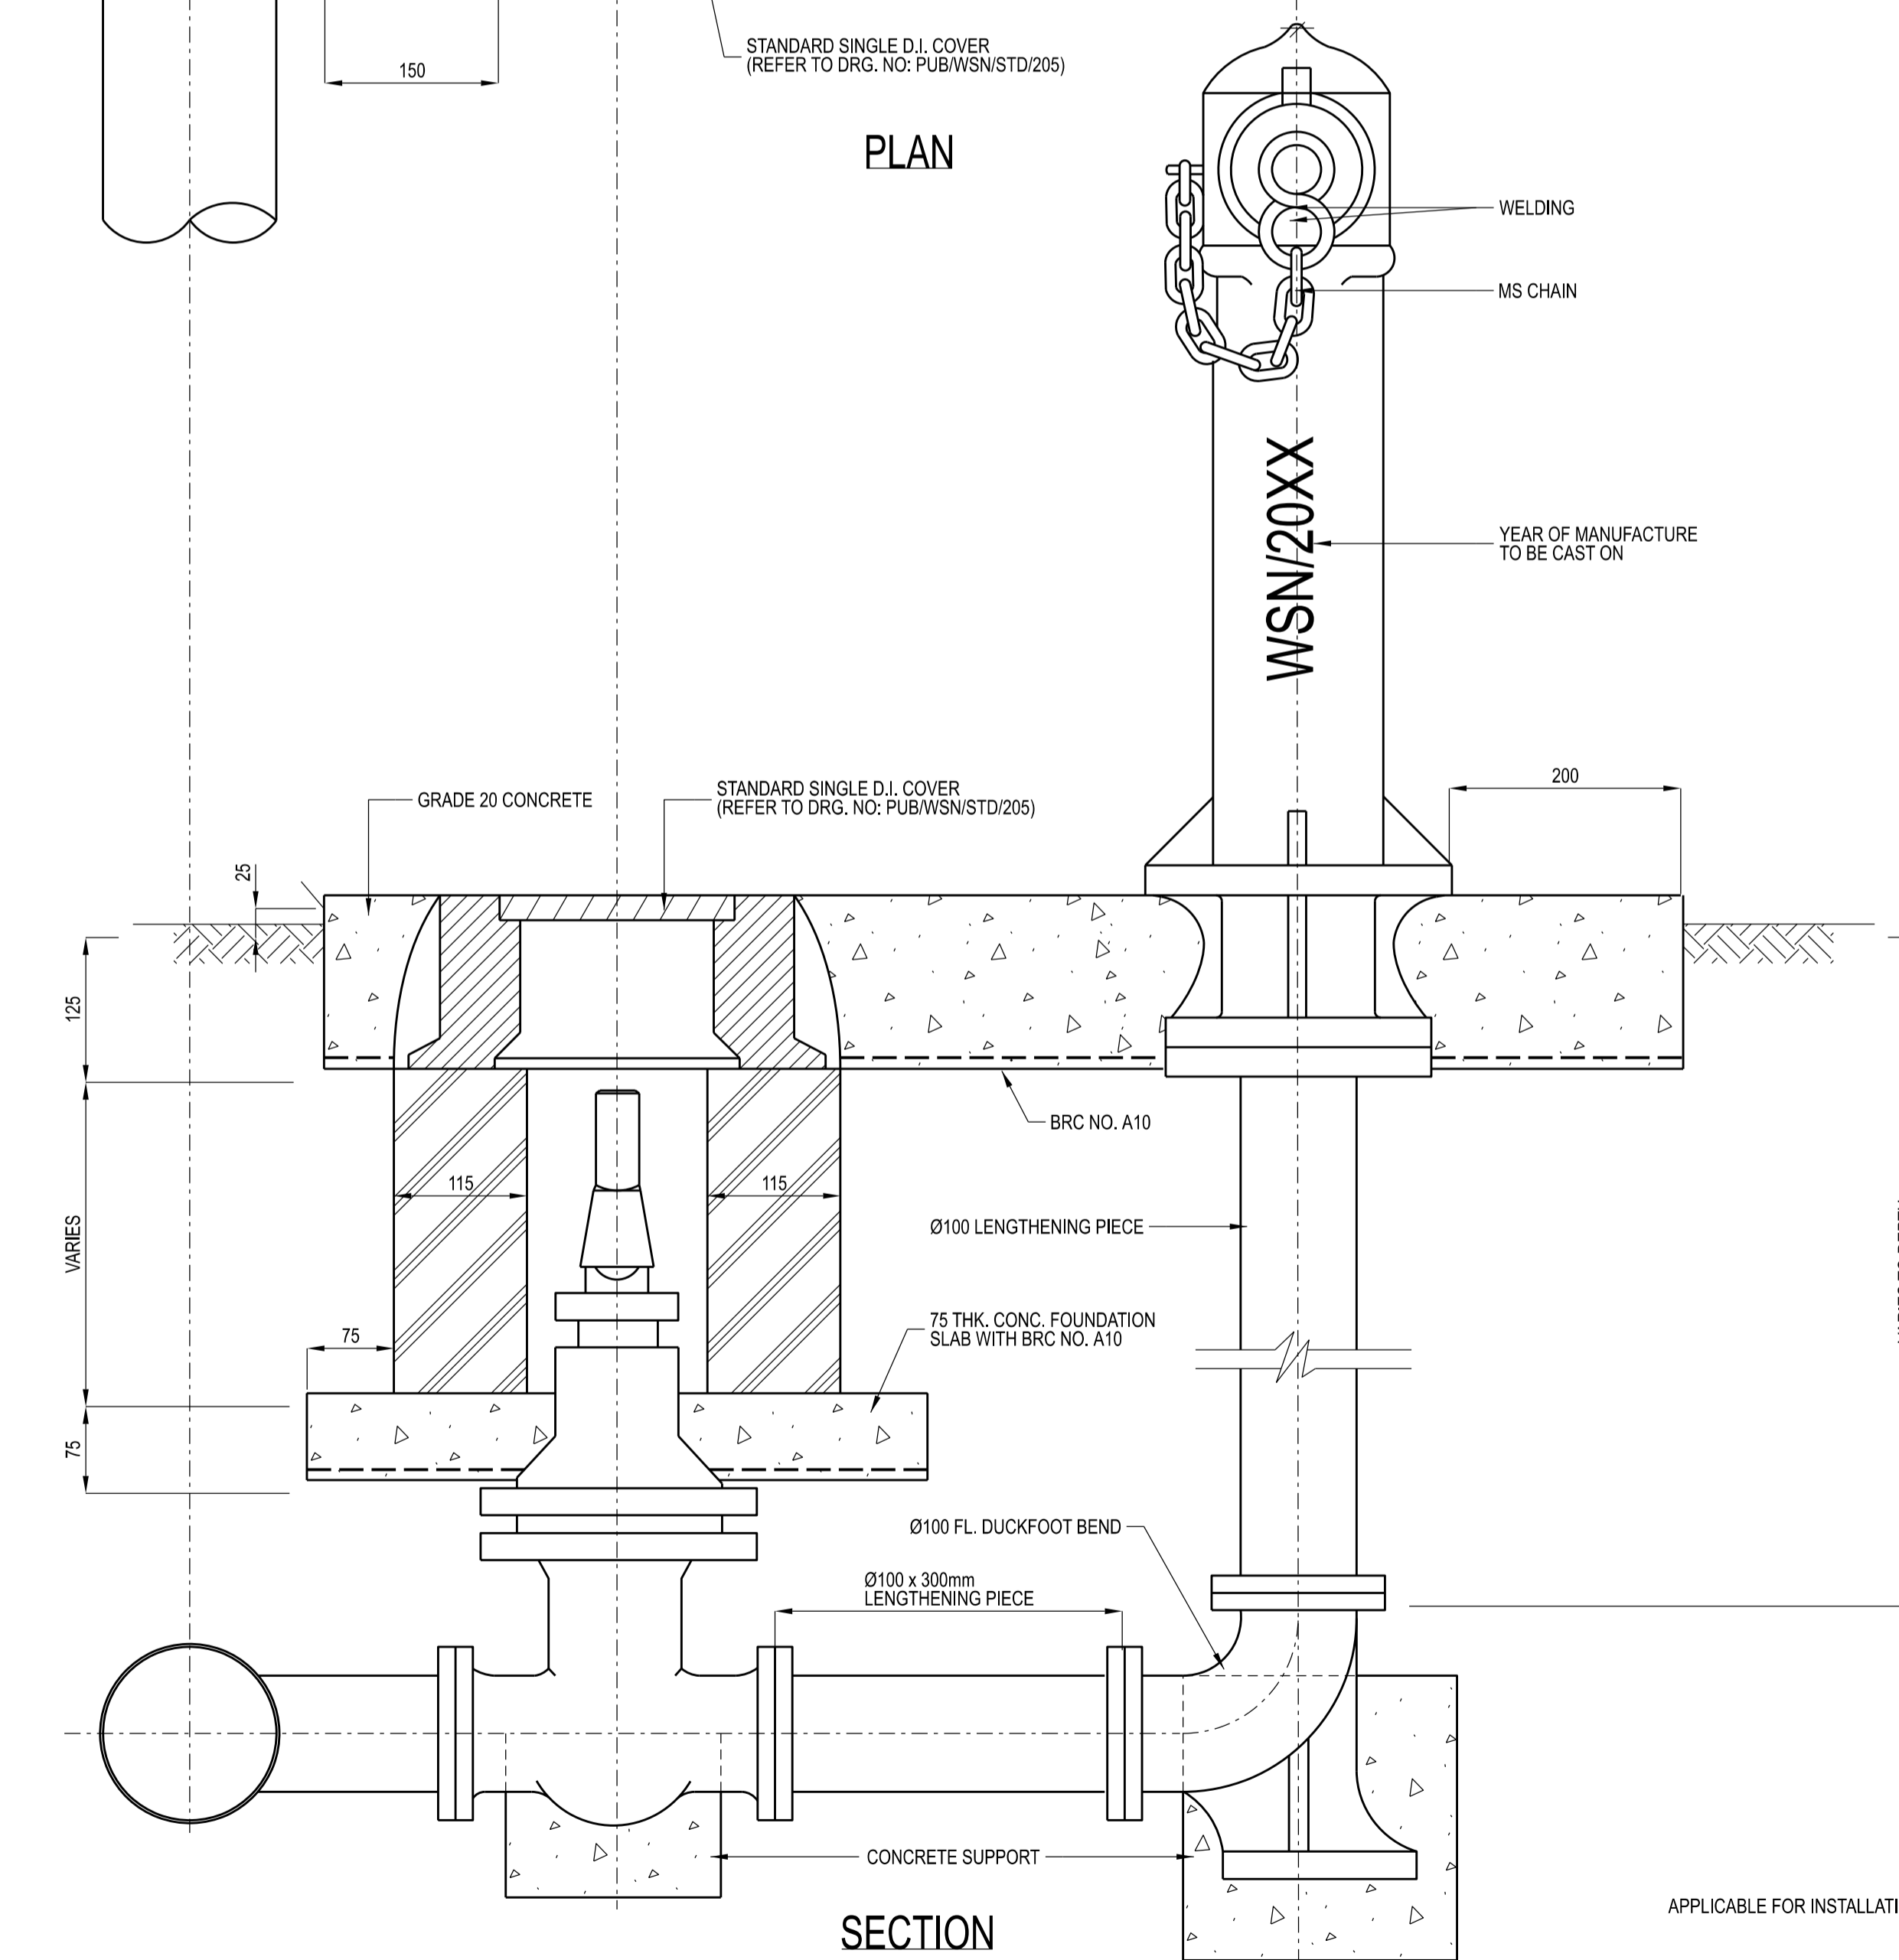

SECTION

NOTES:
 1) PIPE MUST BE DUCTILE IRON TO BS-EN 545
 2) FITTINGS MUST BE DUCTILE IRON BS-EN 545
 3) CAST IRON TO BS-EN 1562
 4) ALL PIPES & FITTINGS MUST BE CEMENT LINED INTERNALLY
 5) SIMILAR INSTALLATION TO BE APPLIED TO TRIPLE PILLAR HYDRANT (REFER TO DRG. NO: PUB/WSN/STD/313 FOR DETAILS) ON TURFED AREAS BUT USING PIPE/FITTINGS OF 150mm DIA. AND THE LENGTHENING PIECE BETWEEN SLUICE VALVE AND DUCK FOOT BEND SHALL BE 150mm DIA x 500mm
 THIS DRAWING SERVES AS A GUIDE ONLY. THERE WILL BE DEVIATIONS UNDER DIFFERENT SITE CONDITIONS. THE RATES ENTERED IN THE B/Q WILL BE HELD TO INCLUDE ALL SUCH DEVIATION. ALTERNATIVE FITTINGS MAY BE USED AT THE DISCRETION OF THE S.O.

DRAWING NO.: PUB/WSN/STD/303			
DATE OF ISSUE: DEC 2022	SCALE: NTS	REV.: -	
REV.	DATE		

INSTALLATION OF DOUBLE PILLAR HYDRANT ON TURFED AREAS